



GAMMA series  
 8 Functions  
 7 time ranges  
 Wide supply voltage range  
 2 change over contacts  
 Width 22.5 mm  
 Industrial design



## Technical data

### 1. Functions

E	ON delay
R	OFF delay with control input
Es	ON delay with control input
Wu	Single shot leading edge voltage controlled
Ws	Single shot leading edge with control input
Wa	Single shot trailing edge with control input
Bi	Flasher pulse first
Bp	Flasher pause first

### 2. Time ranges

Time range	Adjustment range	
1s	50ms	1s
10s	500ms	10s
1min	3s	1min
10min	30s	10min
1h	3min	1h
10h	30min	10h
100h	5h	100h

### 3. Indicators

GreenLED U/t ON:	indication of supply voltage
Green LED U/t flashes:	indication of time period
Yellow LED R ON/OFF:	indication of relay output

### 4. Mechanical design

Self-extinguishing plastic housing, IP rating IP40  
 Mounted DIN-rail TS 35 according to EN 60715  
 Mounting position: any  
 Shockproof terminal connection according to VBG 4 (PZ1 required), IP rating IP20  
 Tightening torque: max. 1Nm  
 Terminal capacity:  
 1 x 0.5 to 2.5mm<sup>2</sup> with/without multicore cable end  
 1 x 4mm<sup>2</sup> without multicore cable end  
 2 x 0.5 to 1.5mm<sup>2</sup> with/without multicore cable end  
 2 x 2.5mm<sup>2</sup> flexible without multicore cable end

### 5. Input circuit

Supply voltage:	12 to 240V AC/DC	terminals A1(+)-A2
Tolerance:		-10% to +10%
Rated consumption:		6VA (2W)
Rated frequency:		AC 48 to 63Hz
Duty cycle:		100%
Reset time:		100ms
Residual ripple of DC:		10%
Drop out voltage:		>30% minimum rated supply voltage
Overvoltage category:		III (in accordance with IEC 60664-1)
Rated surge voltage:		4kV

### 6. Output circuit

2 potential free change over contacts  
 Rated surge: 250V AC  
 Switching capacity: 750VA (3A / 250V AC)  
 If the distance between the devices is less than 5mm!

Switching capacity: 1250V (5A / 250V AC)  
 If the distance between the devices is greater than 5mm!

Fusing: 5A fast acting  
 Mechanical life: 20 x 10<sup>6</sup> operations  
 Electrical life: 2 x 10<sup>6</sup> operations

Switching frequency: max. 60/min at 100VA resistive load  
 max. 6/min at 1000VA resistive load  
 (in accordance with IEC 60947-5-1)

Overvoltage category: III (in accordance with IEC 60664-1)  
 Rated surge voltage: 4kV

### 7. Control input

Input not potential free: terminals A1-B1  
 Loadable: yes  
 Max. line length: 10m  
 Trigger level (sensitivity): automatic adaption to supply voltage  
 Min. control pulse length: DC 50 ms / AC 100 ms

### 8. Accuracy

Base accuracy: ±1% of maximum scale value  
 Adjusting accuracy: <5% of maximum scale value  
 Repetition accuracy: <0.5% or ±5ms  
 Voltage influence: -  
 Temperature influence: ≤0.01% / °C

### 9. Ambient conditions

Ambient temperature: -25 to +55°C (in accordance with IEC 60068-1)  
 Storage temperature: -25 to +70°C  
 Transport temperature: -25 to +70°C  
 Relative humidity: 15% to 85%  
 (in accordance with IEC 60721-3-3 Klasse 3K3)  
 Pollution degree: 3 (in accordance with IEC 60664-1)  
 Vibration resistance: 10 to 55 Hz 0.35mm  
 (in accordance with IEC 60068-2-6)  
 Shock resistance: 15g 11ms  
 (in accordance with IEC 60068-2-27)

## Functions

### ON delay (E)

When the supply voltage U is applied, the set interval t begins (green LED U/t flashes). After the interval t has expired (green LED U/t illuminated) the output relay R switches into on-position (yellow LED illuminated). This status remains until the supply voltage is interrupted. If the supply voltage is interrupted before the expiry of the interval t, the interval already expired is erased and is restarted when the supply voltage is next applied.




### OFF delay (R)

The supply voltage U must be constantly applied to the device (green LED U/t illuminated). When the control contact S is closed, the output relay R switches into on-position (yellow LED illuminated). If the control contact is opened, the set interval t begins (green LED U/t flashes). After the interval t has expired (green LED U/t illuminated) the output relay switches into off-position (yellow LED not illuminated). If the control contact is closed again before the interval t has expired, the interval already expired is erased and is restarted.




### Single shot leading edge with control input (Ws)

The supply voltage U must be constantly applied to the device (green LED U/t illuminated). When the control contact S is closed, the output relay R switches into on-position (green LED U/t illuminated) and the set interval t begins (green LED U/t flashes). After the interval t has expired (green LED U/t illuminated) the output relay switches into off-position (yellow LED not illuminated). During the interval, the control contact can be operated any number of times. A further cycle can only be started when the cycle run has been completed.

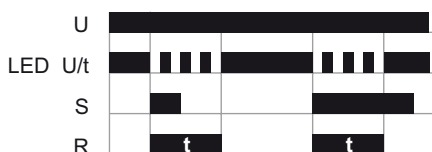


### Single shot trailing edge with control input (Wa)

The supply voltage U must be constantly applied to the device (green LED U/t illuminated). Closing the control contact S has no influence on the condition of the output R. When the control contact is opened, the output relay switches into on-position (yellow LED illuminated) and the set interval t begins (green LED U/t flashes). After the interval t has expired (green LED U/t illuminated), the output relay switches into off-position (yellow LED not illuminated). During the interval, the control contact can be operated any number of times. A further cycle can only be started when the cycle run has been completed.

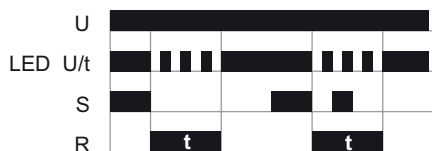

### ON delay with control input (Es)

The supply voltage U must be constantly applied to the device (green LED U/t illuminated). When the control contact S is closed, the set interval t begins (green LED U/t flashes). After the interval t has expired (green LED U/t illuminated) the output relay R switches into on-position (yellow LED illuminated). This status remains until the control contact is opened again. If the control contact is opened before the interval t has expired, the interval already expired is erased and is restarted with the next cycle.

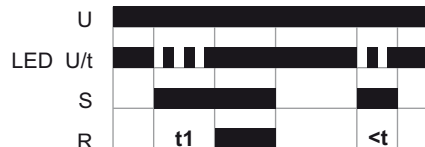


### Single shot leading edge voltage controlled (Wu)

When the supply voltage U is applied, the output relay R switches into on-position (yellow LED illuminated) and the set interval t begins (green LED U/t flashes). After the interval t has expired (green LED U/t illuminated) the output relay switches into off-position (yellow LED not illuminated). This status remains until the supply voltage is interrupted. If the supply voltage is interrupted before the interval t has expired, the output relay switches into off-position. The interval already is erased and is restarted when the supply voltage is next applied.



### Flasher pause first (Bp)

When the supply voltage U is applied, the set interval t begins (green LED U/t flashes). After the interval t has expired, the output relay R switches into on-position (yellow LED illuminated) and the set interval t begins again. After the interval t has expired, the output relay switches into off-position (yellow LED not illuminated). The output relay is triggered at a ratio of 1:1 until the supply voltage is interrupted.




### Flasher pulse first (Bi)

When the supply voltage U is applied, the output relay R switches into on-position (yellow LED illuminated) and the set interval t begins (green LED U/t flashes). After the interval t has expired, the output relay R switches into off-position (yellow LED not illuminated) and the set interval t begins again (green LED U/t flashes). The output relay is triggered at a ratio of 1:1 until the supply voltage is interrupted.




## Connections


with control contact

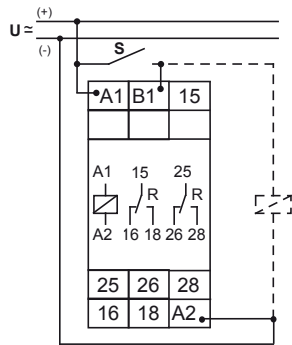

without control contact

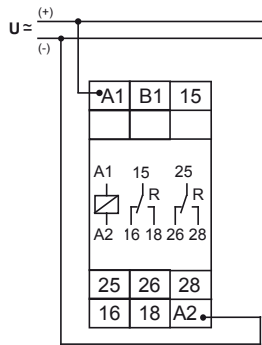

## Dimensions

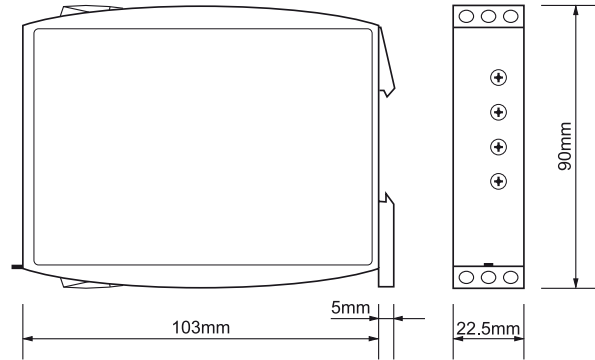

RELEASE 2009/07

Subject to alterations and errors