

DIGITAL TEMPERATURE & PROCESS CONTROLLERS

IR32 TEMPERATURE & PROCESS CONTROLLER



The IR32 series temperature controllers, with their analogue, thermocouple and RTD inputs and relay or SSR drive output options, combine simple control and programmability with flexibility of use for a wide range of applications. They are available with 1, 2 or 4 outputs /set-points, can be configured for

9 different control modes including on/off, P or PI action and can be used to control temperature, humidity, air pressure or other media using suitable sensors.

- 9 pre-set control modes
- Temperature, humidity or air-pressure input sensor options
- 1, 2 or 4 output/set-point options
- Relay or SSR drive output options
- Infra-red, hand-held remote control programming option
- RS232/485 programming and data analysis via serial link
- IP65 water and dust protection
- CE approval for emc and low voltage directives
- Programmable advanced control options

SPECIFICATION


Supply: 12-24Vac/dc +/- 10% 110/230V with transformers
 Supply drain: 3VA max.
 Probe supply: 10Vdc @ 30mA internal
 Inputs: 1 or 2 NTC, PT100, J, K T/c, 4-20mA, -0.5 to 1V
 Digital input: Programmable function to switch between set-points or to act as an alarm condition.
 Scale range: NTC : -40 to 90°C
 Pt100 : -99 to 600°C
 J T/c : -99 to 800°C
 K T/c : -99 to 999°C
 mA/V : -99 to 999 units
 Accuracy: +/- 0.5% of scale range
 Output types: See connection diagrams
 Output ratings: Relay: 8A @ 250Vac (10 A inrush)
 SSR: 10V/25mA
 Protection: IP65
 Approval: Conform to CE emc EN50081-1 & EN50082-1 and low voltage EN61010-1 directives.
 Ambient range: 0 to 50°C @ 90% rH (non-condensing)
 Weight: IR32A: 240 gms
 IR32D: 200 gms
 IR32V: 200 gms
 IR32W: 220 gms
 IR32Z: 240 gms

Part Numbering Options : IR32 A B C 000


A	Outputs	1 Relay 2 Relays 4 Relays 1 SSR 4 SSRs	8A/250Vac " " 10V/25mA "	V W Z D A
B	Input	NTC probe PT100 probe J/K Thermocouple Current Voltage	-50 to 90°C 99 to 600°C 0 to 999°C 4 to 20mA -0.5 to +1V	0 1 2 3 4
C	Options	Economic (V0 only) Standard "	No IR sensor or buzzer IR sensor & buzzer IR sensor & buzzer	E L 0

CONNECTION DIAGRAMS


NTC/Relay Versions

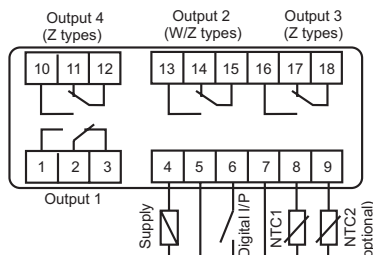


NTC/SSR Versions

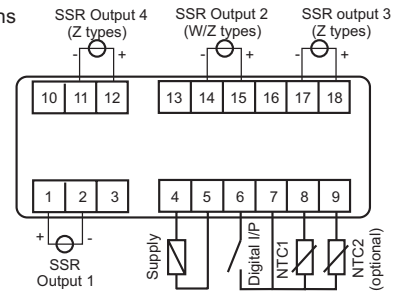


T/C, Voltage & Current Input/Relay Versions

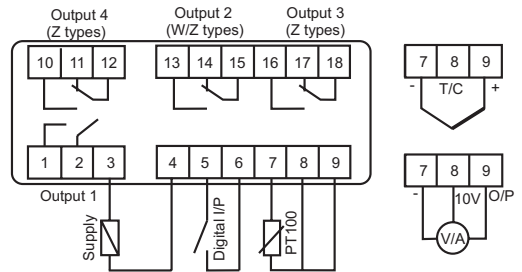

T/C, Voltage and Current Input/SSR Versions

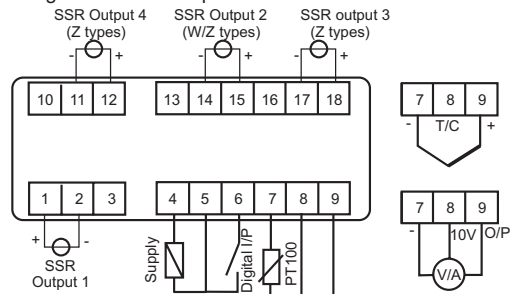

DIMENSIONS

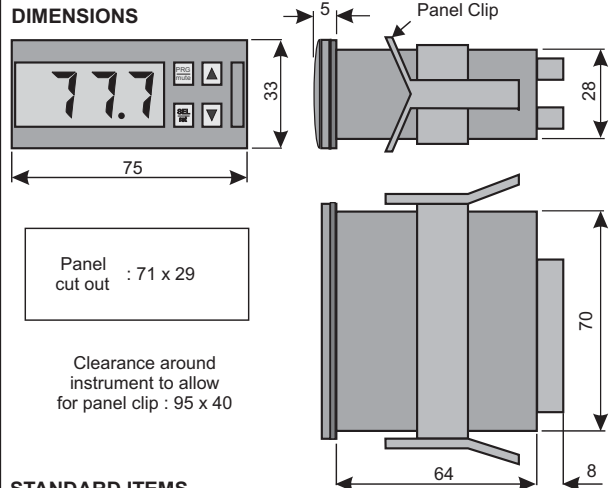


STANDARD ITEMS

OutputType	Input Type	Part Number
1 Relay	NTC, economic	IR32V0E000
	NTC	IR32V0L000
	PT100	IR32V1L000
	J/K thermocouple 4-20mA	IR32V2L000
	-0.5 to 1V	IR32V3L000
2 Relays	NTC	IR32V4L000
	PT100	IR32W00000
	J/K thermocouple 4-20mA	IR32W10000
	PT100	IR32W20000
4 Relays	PT100	IR32W30000
	J/K thermocouple	IR32Z10000
1 SSR	PT100	IR32Z20000
	J/K thermocouple	IR32D1L000
4 SSRs	PT100	IR32D2L000
	J/K thermocouple	IR32A10000
		IR32A20000

TEMPATRON

IR32 and IRDR Range of Controllers

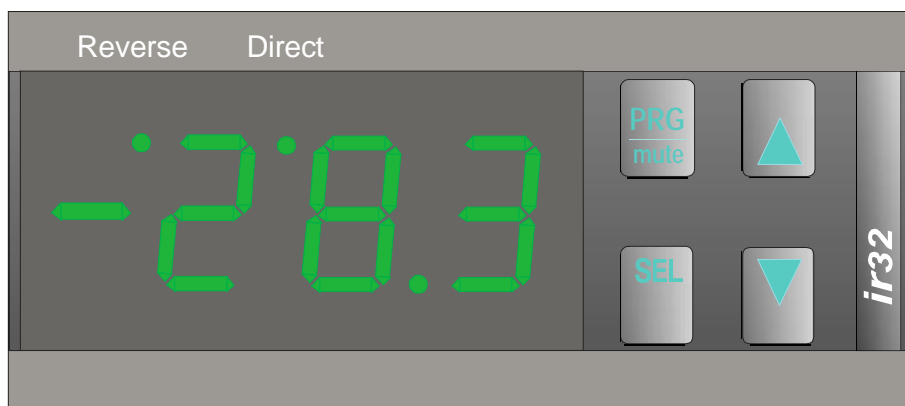

Tempatron Ltd, 5 Darwin Close, Reading, Berks, RG2 0TB.
Tel: 0118 9314062 Fax: 0118 9310175

IR32/DR Industrial Range of Temperature and Process Controllers

The IR32 range of controllers has been developed from the highly successful refrigeration thermostats manufactured by Carel in Italy. These controllers have revolutionised the thinking behind temperature and process control. Current developments in this type of instrument have been based on the assumption that industrial applications require ever increasing sophistication in control techniques, giving tight control and rapid response to the most stringent and variable processes.

However, the vast majority of applications do not require such complicated and sophisticated techniques. This is not to say that the IR32/DR is not sophisticated; programmable alarm functions, control action, time delays, output sequencing,selectable setpoints, Infra-red remote control and many other features justify such a description for this range of products. The point is that the basic control actions of On/Off and Proportional+Integral are quite sufficient to provide stable control for many applications, with the significant benefit of a price tag of better than 50% of the now common PID, autotuned controllers supplied elsewhere.

Another revolutionary concept incorporated in the IR32/DR range is the pre-determined and selectable control actions (Function Modes). Here the user can decide which Control action suits his application, for example; Heat+Cool with Deadband, Direct action plus Alarm or PI mode with selectable setpoints. Simply by selecting 1 of the 9 preset modes, he can dedicate the operation of the IR32/DR to a specific function.


Finally, for applications which require multiple controllers, such as supermarkets or building ventilation, it is possible to program the IR32/DR from either a remote, infra-red, hand-held programmer or a PC, via a RS485 communications network.

Key Features

- . 9 pre-determined and selectable Function Modes
- . 1, 2 or 4 output options incorporated in a single housing
- . 1 or 2 setpoints, selectable by a remote digital input
- . Direct, Reverse or Heat + Cool + Deadband control action
- . Programmable Alarm action, hysteresis and time delays
- . Programmable Control cycle and delay times
- . On/Off. Proportional or PI control Modes
- . Infra-red remote programming
- . RS232/485 communications option
- . Autoranging, three digit display with decimal point resolution
- . Output rotation on 2 or 4 output models, for load protection and optimal wear
- . IP65 water and dust protection(IR32 only)
- . 12-24Vac/dc and 24-240Vac (IR32V only) supply options
- . CE emc and low voltage compatibility

Part Number System

IR 32 V 1 E 000

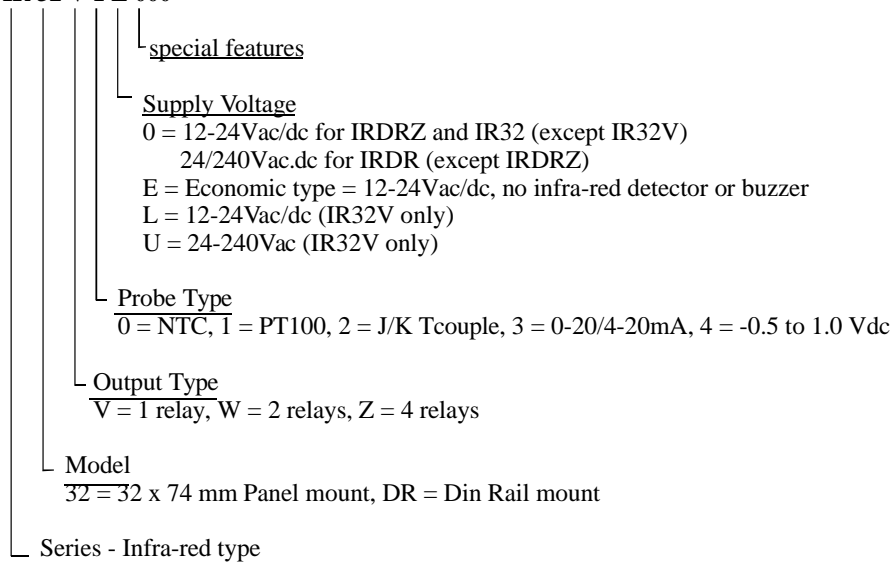

Front Panel Functions

**PROG
MUTE**

: When momentarily pressed, enters all new parameters selected from other keys.
When pressed for > 5 secs, accesses primary parameters.
When pressed simultaneously with **SEL** key, accesses Function Modes , via code 22.
When pressed simultaneously with **SEL** key, accesses Advanced Parameters, via code 77.
Cancels alarm buzzer when activated. Note: this does not reset the alarm conditions.

SEL

: When momentarily pressed, accesses Set-Point.
When pressed simultaneously with **PROG** key, accesses Function Modes and Advanced Parameters.
Once a parameter has been accessed, enables variable adjustment via and keys, and acknowledgement of new value.



: Allow forward or reverse rotation through program parameters and up or down adjustment of variables.

O Reverse : Reverse Action Led. Flashes cyclically for each output activated in Reverse Mode.

O Direct : Direct Action Led. Flashes cyclically for each output activated in Direct Mode.

888 : 3 digit, green Led display. Displays Process Value, Alarm Codes, Set-Point, parameter codes and parameter values, when in program mode.

Function Modes	
Mode No.	Function
1	Direct action mode with adjustable Set-Point (SP) and differential (Hysteresis) above SP.
2	Reverse action mode with adjustable Set-Point (SP) and Hysteresis below SP.
3	Reverse action mode with adjustable SP, Hysteresis and Dead-Band (DB). For 2 (W) and 4 (Z) output models, DB is equi-spaced about SP.
4	Proportional (P) action mode with adjustable SP, proportional Band (PB) and DB. As for Mode 3, DB is equi-spaced around SP for W and Z models. A Proportional + Integral (PI) mode is also available by selecting the correct variable in parameter C5.
5	Alarm Mode, operating as for Mode 3 but with one output dedicated as an alarm signal. For single output (V) models the output is an Alarm, for W models one output is dedicated to a high/low alarm and, for Z models, two outputs are dedicated to high and low alarms respectively.
6	Direct or Reverse action mode, selectable from the digital input (DI). DI open = Direct DI closed = Reverse.
7	Direct action mode with two Set-Points SP1 and SP2, each with its own adjustable Hysteresis and selectable from the digital input. DI open = SP1/HY1 and DI closed = SP2/HY2.
8	Reverse action mode with functions as for Mode 7.
9	Direct plus Reverse action mode (Heat + Cool) with each dedicated to one output (2 for Z models) providing two independent Set-Points. This mode is only available for W and Z models.

Error Messages

Message	Description	Cause	Solution
Er0	Probe error	Open or short circuit probe or connection.	Check connections and probe.
Er1(NTC2)	Probe error	As for Er0.	As for Er0.
Er2	Memory error	Supply disconnected during programming. Electrical noise.	Turn off, then on holding down SEL Replace unit, if persistent.
Er3	External Alarm	Digital Input contact open.	See C29, check external contacts.
Er4	High Alarm	Input has exceeded P26 for > P28 period	Check parameters P26 and P28.
Er5	Low Alarm	Input is below P25 for > P28 period	Check parameters P25 and P28

Note: Press **PROG/MUTE** to silence alarm buzzer but check appropriate parameters to reset outputs.


Parameter Table

Code	Function	Default Value	Range	Parameter Access		
				Prim	FM	Adv
St1	Set-Point 1	20	see spec.			
St2	Set-Point 2 (Function Modes 6, 7, 8, 9)	40	see spec.			
C0	Function Mode	2	1 to 9		X	X
P1	Hysteresis of SP1	2	0.1 to 99.9	X	X	X
P2	Hysteresis of SP2 (Function Modes 3, 4, 5, 7, 8, 9)	2	0.1 to 99.9	X	X	X
P3	Dead-Band (Function Modes 3, 4, 5)	2	0 to 99.9	X	X	X
C4	Compensation Coefficient - NTC only (see operation manual)	0.5	-2.0 to 2.0			X
C5	Control action in Function Mode 4. 0 = Prop (P), 1 = Prop + Integ (PI)	0	0 or 1			X
C6	Delay between on routines of two different outputs	5	0 to 999 secs			X
C7	Minimum time between on routines of the same output	0	0 to 15 mins			X
C8	Minimum off time of the same output	0	0 to 15 mins			X
C9	Minimum on time of the same output	0	0 to 15 mins			X
C10	Status of outputs with probe(temperature) alarm : 0 = all relays de-energised 1 = all relays energised 2 = Direct action relays energised, all others de-energised 3 = Reverse action relays energised, all others de-energised	0	0 to 3			X
C11	Output rotation (Function Modes 1, 2, 6, 7, 8 and Models W & Z only) 0 = no rotation 1 = rotation of 2 out of 4 outputs (model Z only) 2 = 2 + 2 rotation (Compressor on outputs 1 & 3, model Z only) 3 = 2 + 2 DWM rotation (model Z only)	0	0 to 3			X
C12	Cycle Time of proportional modes (P and PI)	20	0.2 to 999 secs			X
C13	Probe type: 0 = 4 - 20mA, 1 = 0 - 20mA or 0 = K T/c, 1 = J T/c	0	0 or 1			X
P14	Probe calibration or offset	0	-99 to 99.9	X	X	X
C15	Minimum value for scaling of analogue inputs	0	-99 to C16			X
C16	Maximum value for scaling of analogue inputs	100	C15 to 999			X
C17	Probe response time (noise filter)	5	1 to 14			X
C18	Temperature units: 0 = °C, 1 = °F	0	0 or 1			X
C19	Ambient compensation of 2nd probe - NTC only (see operation manual)	0	1 to 4			X
C21	Minimum Set-Point (SP1) limit (depends on probe type)	min probe	-99 to C22			X
C22	Maximum Set-Point (SP1) limit (depends on probe type)	max probe	C21 to 999			X
C23	Minimum Set-Point (SP2) limit (depends on probe type)	min probe	-99 to C24			X
C24	Maximum Set-Point (SP2) limit (depends on probe type)	max probe	C23 to 999			X
P25	Low absolute alarm set-point	min probe	-99 to P26	X	X	X
P26	High absolute alarm set-point	max probe	P25 to 999	X	X	X
P27	Alarm hysteresis	2	0.1 to 99.0	X	X	X
P28	Alarm delay	60	0 to 120 mins	X	X	X
C29	Alarm relay status with Digital Input (DI) (C0 = 5 only): 0 = Non active input 1 = Immediate alarm - all relays de-energise, automatic reset on clear 2 = Immediate alarm - all relays de-energise, manual reset(mute) on clear 3 = delayed alarm (P28) - all relays de-energise, manual reset(mute) on clear 4 = All alarm relays inactive with DI open (---) flashes Note: Whenever DI opens Er3 message occurs & buzzer sounds.	0	0 to 4			X
C30	Digital input 2 (IRDR models only). Options as for C29	0	0 to 4			X
C31	Status of output relays with Digital input (see C10)	0	0 to 3			X
C32	Address of unit for serial comms. connection	1	1 to 16			X
C33	Do not modify this parameter	0	0 or 1			X
C50	Activation of Keypad (KP) and Remote Control Unit (RC) : 0 = KP off, RC on (code 22) 1 = KP on, RC on (code 22) 2 = KP off, RC off 3 = KP on, RC off 4 = KP off, RC on (code 77)	0	0 to 4			X
C51	Code to activate Remote Control Unit	0	120			X

Note: Prim = Primary functions, FM = Function Modes, Adv = Advanced functions

Page 4

Program Parameter Map

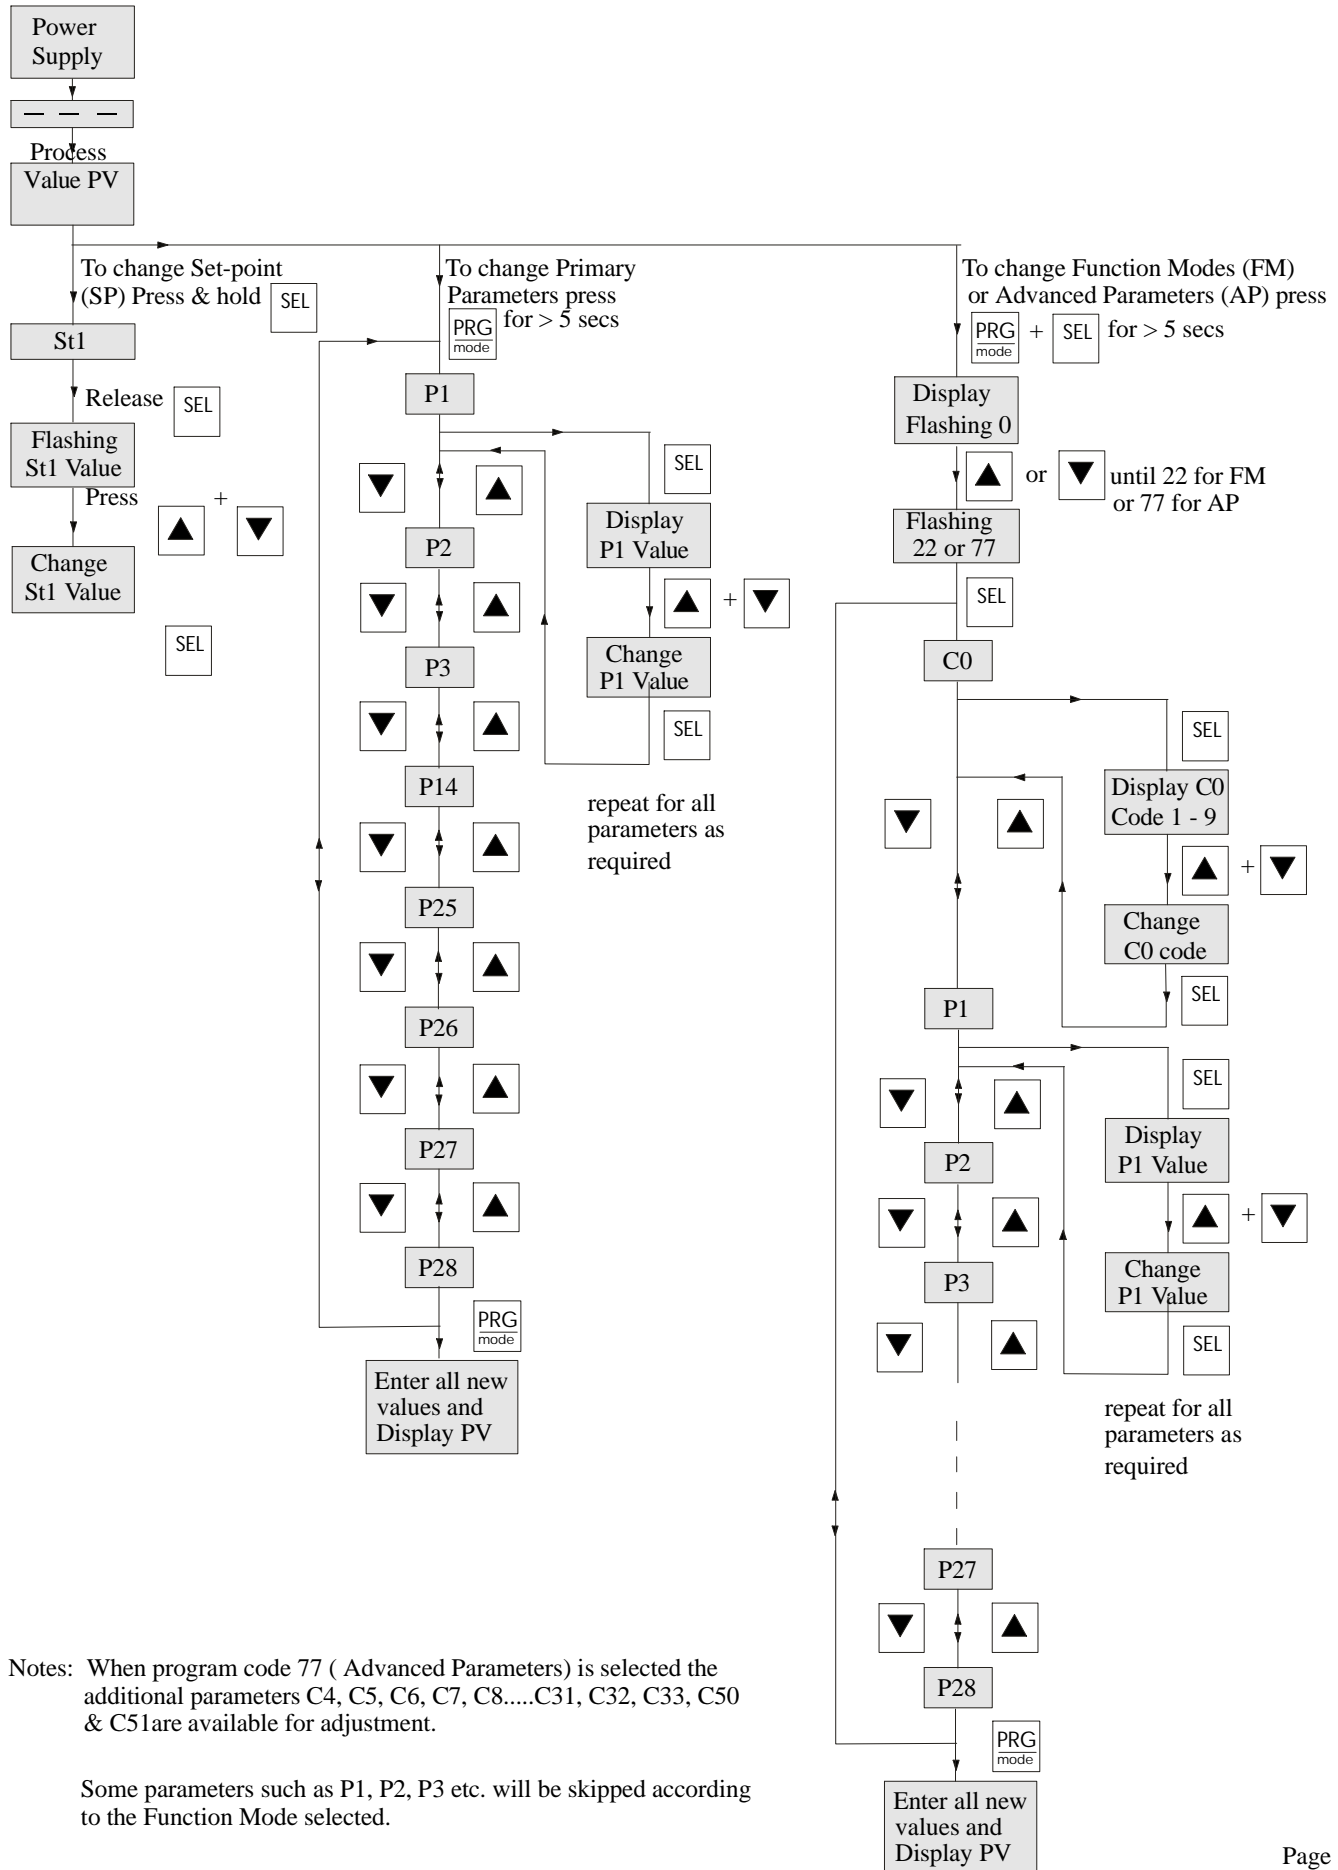


Notes: When program code 77 (Advanced Parameters) is selected the additional parameters C4, C5, C6, C7, C8.....C31, C32, C33, C50 & C51 are available for adjustment.

Some parameters such as P1, P2, P3 etc. will be skipped according to the Function Mode selected.


Technical Specification

Input Options:	NTC, PT100, J or K TCouple, 0 - 20mA, 4 - 20mA, -0.5 to 1.0 Vdc according to model (see part number).
Operating range:	NTC: -50 to +90 o C PT100: -99 to +600 o C J T/c: -99 to +800 o C K T/c: -99 to +999 o C mA/V: -99 to 999 scaleable
Resolution:	0.1 or 1 unit, according to displayed value (autoranging)
Accuracy:	+/- 0.5% of max. range
Supply Voltage:	See Part Numbering system. All values are +/- 10%.
Power Consumption:	3VA max.
Probe supply:	10Vdc @ 30mA max. supplied by controller.
Working Temperature:	0 to 50 o C
Storage Temperature:	-10 to 70 o C
Relative Humidity:	90% rH max, non-condensing.
Output Configuration:	IR32 for NTC: 1,2,or 4 SPDT relays IR32V: 1 SPDT relay IR32W: 1 SPST + 1 SPDT relays IR32Z: 1 SPST + 3 SPDT relays IRDR (except Z): 1 or 2 SPDT relays IRDRZ: 2 SPDT + 2 SPST relays
Relay Ratings:	Relays: 8A/250Vac max with 2000VA max switching power (10Amps inrush) SSR's: 8Vdc open-circuit, 4Vdc @ 8mA
Protection Index:	IR32: IP65, IRDR: IP40
Fire Retardancy:	Plastic case and relays: ECC EN 60730-1
EC Compatibility:	Comply to Directive 89/336/EEC(modified to 92/31/EEC) and are designed to meet the EN60555-2 standards on emmissions and EN50082-1 standards on immunity. These products may be assembled to machinery covered by Directive 89/392/EEC and meet the low volage Directive 73/23/EEC



Dimensions

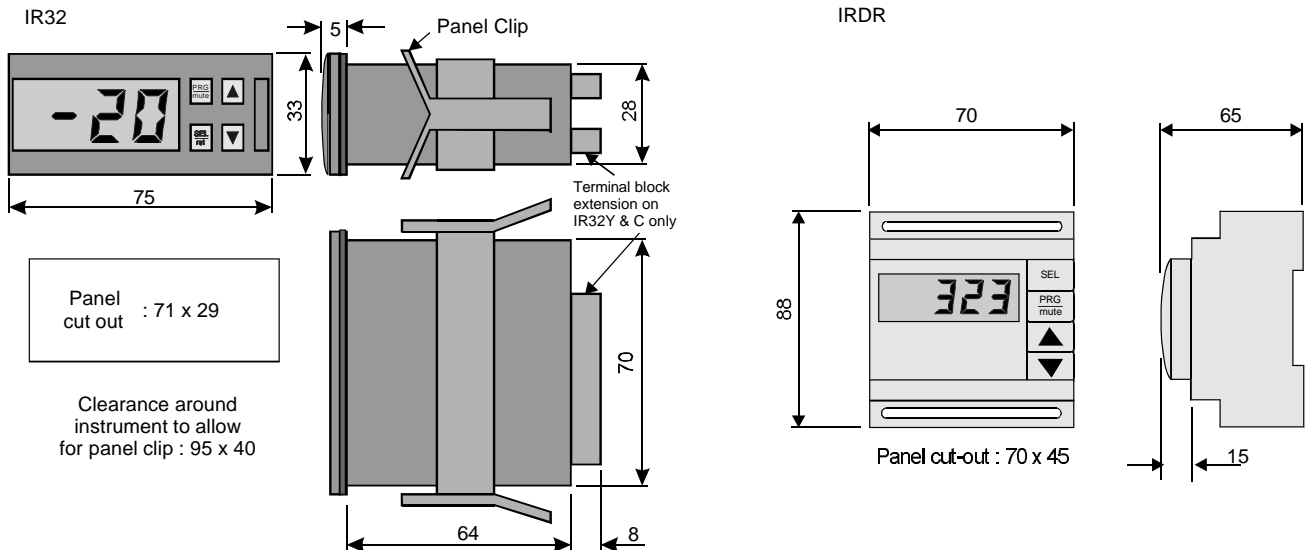


Connection Diagrams

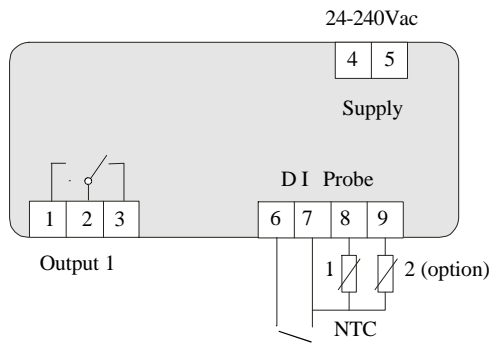


**IR32 Models
NTC only**

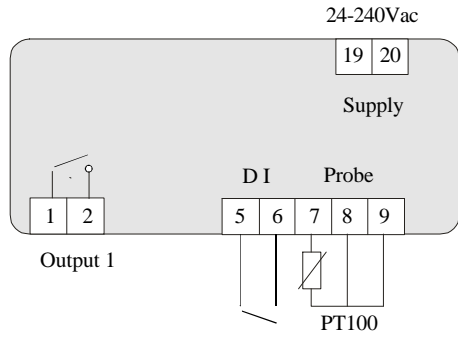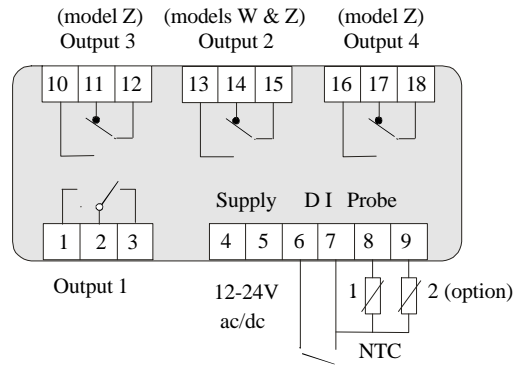



**IR32 Models
All other
Probe types**

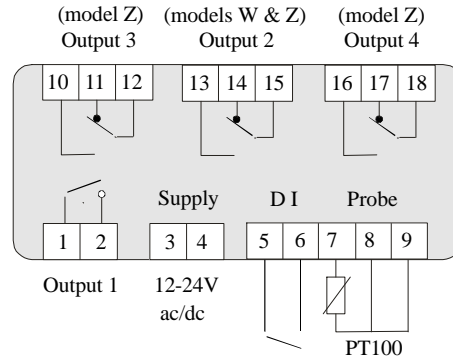


**IR32V U (high voltage)
version only**




**IR32V, W, Z low voltage
versions**

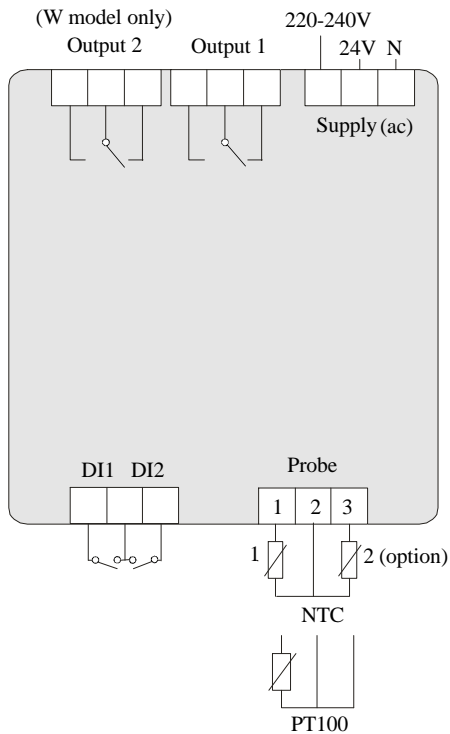

IRDR Models

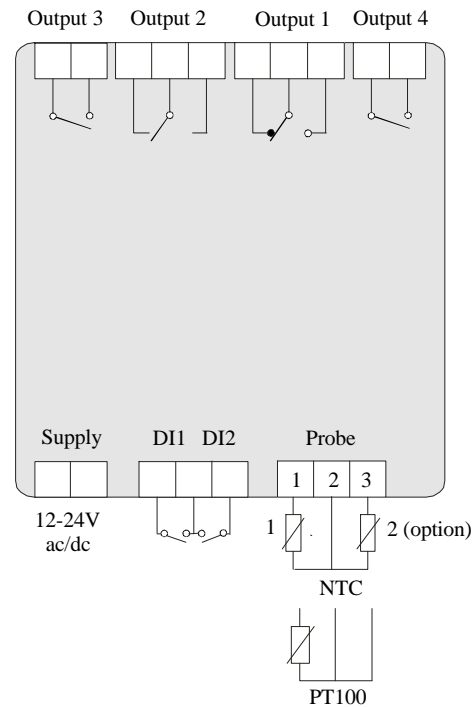

IRDRV & W
NB: IRDRTE does
not have 24V supply



IR32Z

