

## GT3A Series — Analog Timers



## Key features of the GT3A series include:

- 4 selectable operation modes on each model
- External start, reset, and pause inputs
- Panel mount or socket mount
- Large variety of timing functions
- Power and output status indicating LEDs



UL, c-uL Listed  
File No. E55996



	GT3A-1	GT3A-2	GT3A-3	GT3A-4,-5,-6
<b>Operation</b>	Multi-mode			Multi-mode with inputs (11 pins)
<b>Time Range</b>	0.05s to 180 hours			
<b>Rated Voltage</b>	100 to 240V AC, 50/60Hz 12V DC 24V AC, 50/60Hz / 24V DC			
<b>Contact Ratings</b>	125V AC/250V AC, 3A; 30V DC, 1A (resistive load)		125V AC/250V AC, 5A; 30V DC, 5A (resistive load)	
<b>Minimum Applicable Load</b>	5V, 10mA (reference value)			
<b>Voltage Tolerance</b>	AF20 (100V AC): 85 to 264V AC AD24: 20.4 to 26.4V AC/21.6 to 26.4V DC D12: 10.8 to 13.2V DC			
<b>Error</b>	±0.2%, ±10 msec (repeat, voltage, temperature)			
<b>Setting Error</b>	±10% maximum			
<b>Reset Time</b>	60msec maximum			
<b>Insulation Resistance</b>	100MΩ minimum			
<b>Dielectric Strength</b>	Between power and output terminals: 2,000V AC, 1 minute Between contacts of different poles: 2,000V AC, 1 minute Between contacts of the same pole: 750V AC, 1 minute			
<b>Power Consumption (approximate)</b>	Delayed SPDT	Delayed SPDT + instantaneous SPDT	Delayed DPDT	Delayed DPDT
	10.8VA (200V AC, 60Hz)	13.5VA (200V AC, 60Hz)	14.4VA (200V AC, 60Hz)	4.7VA (100V AC, 60Hz), 14.4VA (200V AC, 60Hz)
	—	12VDC/1W 24VDC/0.7W 24VAC/1.2VA	12VDC/1.1W 24VDC/0.6W 24VAC/1.3VA	12VDC/0.8W 24VDC/0.6W 24VAC/1.3VA
<b>Mechanical Life</b>	10,000,000 operations minimum		5,000,000 operations minimum	
<b>Electrical Life</b>	50,000 operations minimum (rated load)		100,000 operations minimum (rated load)	
<b>Weight (approximate)</b>	63g	73g	79g	80g
<b>Vibration Resistance</b>	100m/sec <sup>2</sup> (approximate 10G)			
<b>Shock Resistance</b>	Operating extremes: 100m/sec <sup>2</sup> (approximate 10G) Damage limits: 500m/sec <sup>2</sup> (approximate 50G)			
<b>Operating Temperature</b>	-10 to +50°C			<b>GT3A Table of Contents</b> Specifications — G-14 Part Number List — G-15 Timing Diagrams/Schematics — G-16 Instructions: Setting Timer — G-22 GT3 Accessories — G-48 GT3 Instructions: Wiring Inputs — G-50 GT3 Dimensions — G-52 Timing Diagrams Overview — G-4
<b>Operating Humidity</b>	45 to 85% RH			
<b>Storage Temperature</b>	-30 to +80°C			
<b>Housing Color</b>	Gray			

## Part Number List

### Part Numbers: GT3A-1, -2, -3

Mode Of Operation	Rated Voltage Code	Time Range	Output	Contact	Complete Part No.	
					8-Pin	11-Pin
A: ON-delay 1 B: Interval 1 C: Cycle 1 D: Cycle 3	AF20: 100 to 240V AC (50/60Hz)	0.05s. to 180 hours	250V AC, 3A, 30V DC, 1A (resistive load)	Delayed SPDT + Instantaneous SPDT	GT3A-1AF20	GT3A-1EAF20
	AF20: 100 to 240V AC (50/60Hz) D12: 12V DC AD24: 24V AC (50/60Hz)/24V DC				GT3A-2AF20	GT3A-2EAF20
					GT3A-2D12	GT3A-2ED12
			GT3A-2AD24	GT3A-2EAD24		
	240V AC, 5A, 24V DC, 5A (resistive load)		Delayed DPDT	GT3A-3AF20	GT3A-3EAF20	
				GT3A-3D12	GT3A-3ED12	
GT3A-3AD24		GT3A-3EAD24				



1. For wiring schematics and timing diagrams for GT3A-1, -2, -3, see pages G-16, G-17, or G-18 respectively.
2. For more details about time ranges, see instructions on page G-22.
3. For socket and accessory part numbers, see page G-48.

### Part Numbers: GT3A-4, -5, -6

Mode of Operation	Rated Voltage Code	Time Range	Output	Contact	Input	Complete Part No.	
						A (11-pin)	B (11-pin)
A: ON-Delay 2 B: Cycle 2 C: Signal ON/OFF-Delay 1 D: Signal OFF-Delay 1	AF20: 100 to 240V AC (50/60Hz) D12: 12V DC AD24: 24V AC (50/60Hz)/24V DC	0.05 seconds to 180 hours	250V AC, 5A, 24V DC, 5A (resistive load)	Delayed DPDT	Start Reset Gate	GT3A-4AF20	GT3A-4EAF20
						GT3A-4D12	GT3A-4ED12
						GT3A-4AD24	GT3A-4EAD24
A: Interval 2 B: One-Shot Cycle C: Signal ON/OFF-Delay 2 D: Signal OFF-Delay 2	AF20: 100 to 240V AC (50/60Hz) AD24: 24V AC (50/60Hz)/24V DC					GT3A-5AF20	GT3A-5EAF20
						GT3A-5AD24	GT3A-5EAD24
						A: One-Shot B: One-Shot ON-Delay C: One-Shot 2 D: Signal ON/OFF-Delay 3	GT3A-6AF20
GT3A-6AD24	GT3A-6EAD24						




4. For wiring schematics and timing diagrams GT3A-4,-5,-6, see pages G-19, G-20, and G-21 respectively.
5. For more details about time ranges, see instructions on page G-22.
6. A (11-pin) and B (11-pin) differ in the way inputs are wired.
7. For socket and accessory part numbers, see page G-48.
8. For the timing diagrams overview, see page G-4.

**Timing Diagrams/Schematics**

**GT3A- 1 Timing Diagrams**


**Delayed SPDT**

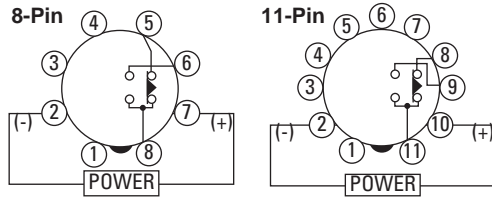

Operation Mode Selection


**ON-Delay 1**

MODE

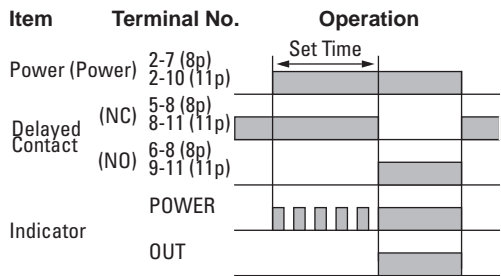

**Interval 1**


MODE

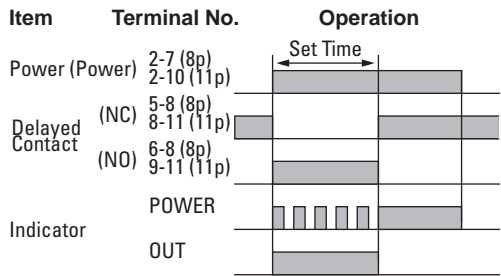

**Cycle 1**

(OFF first)


MODE

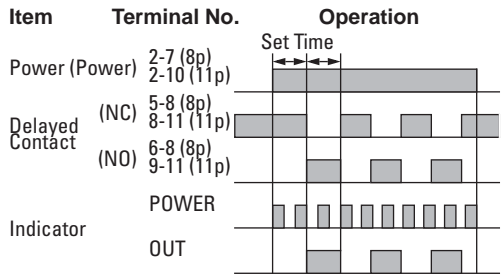

**Cycle 3**

(ON first)


MODE

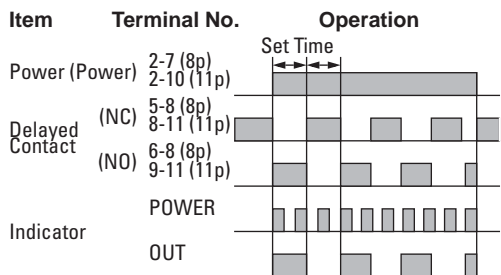

## GT3A- 2 Timing Diagrams


### Delayed SPDT + Instantaneous SPDT

Operation  
Mode Selection

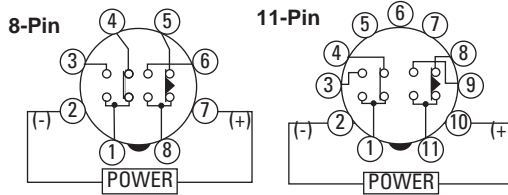


#### ON-Delay 1

MODE

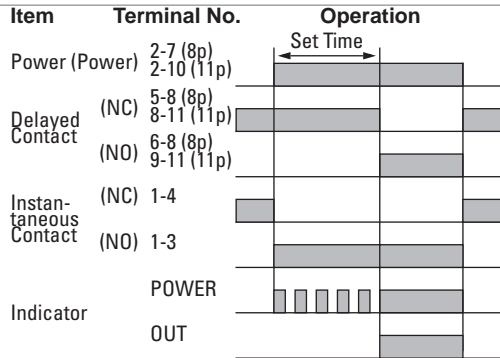


#### Interval 1

MODE

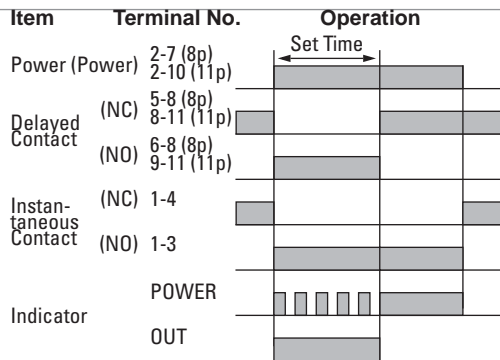


#### Cycle 1 (OFF first)

MODE

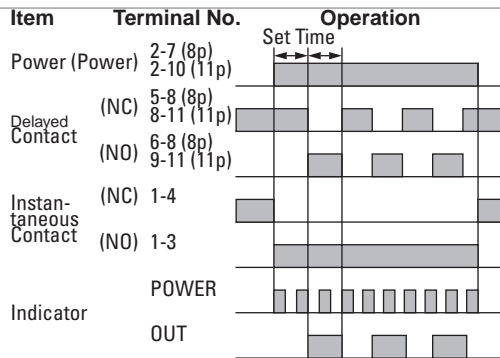


#### Cycle 3 (ON first)

MODE

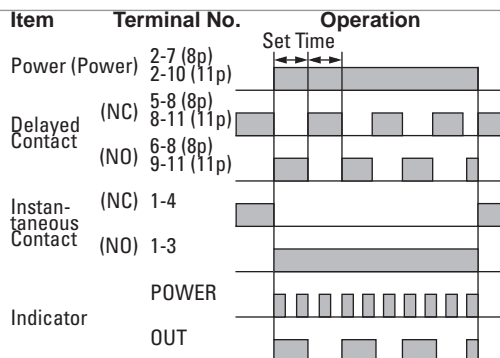

**GT3A-3 Timing Diagrams**


**Delayed DPDT**

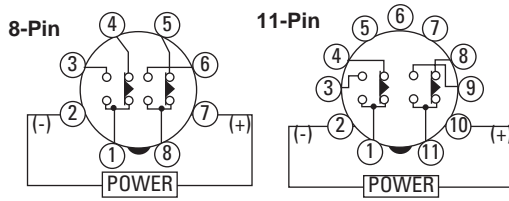

Operation  
Mode Selection

**ON-Delay 1**


MODE

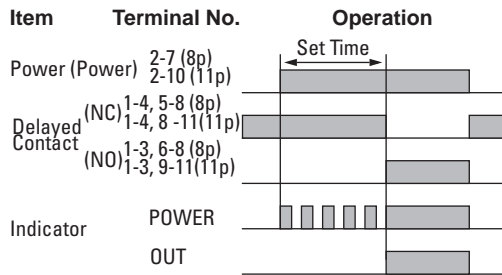

Timers


**Interval 1**

MODE

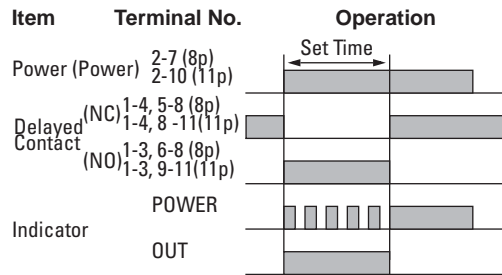


**Cycle 1  
(OFF first)**

MODE

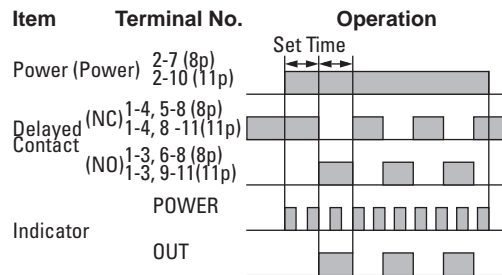


**Cycle 3  
(ON first)**

MODE

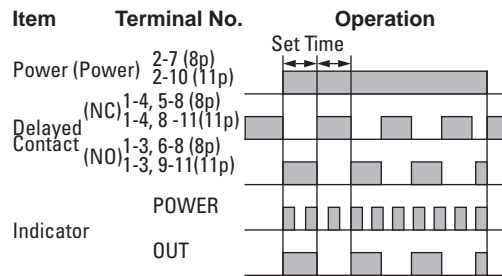

**GT3A-4 Timing Diagrams**


**Delayed DPDT**

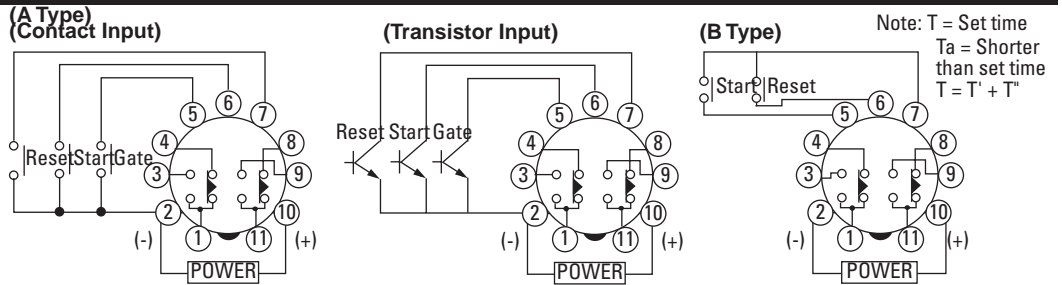

Operation Mode Selection


**ON-Delay 2**

MODE

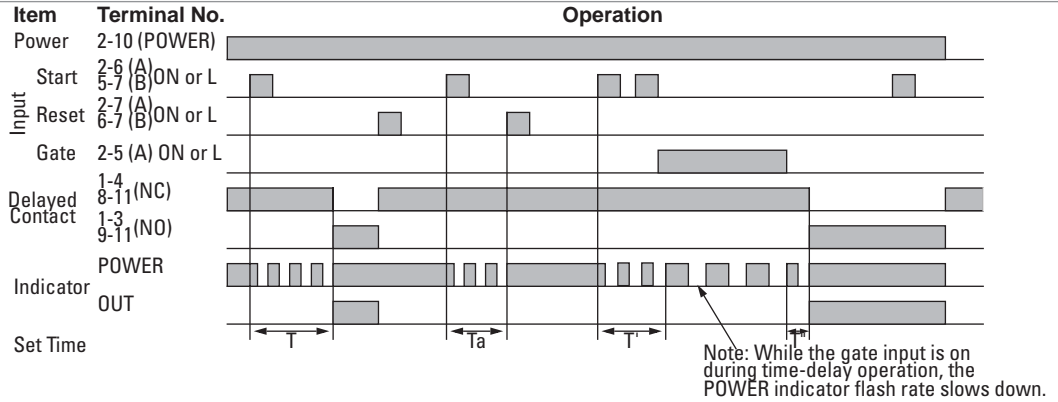


**Cycle 2**

MODE

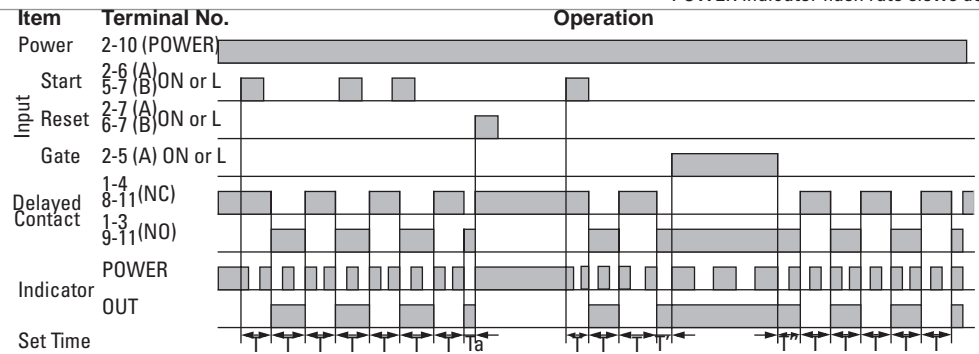


**Signal ON/OFF-Delay 1**

MODE

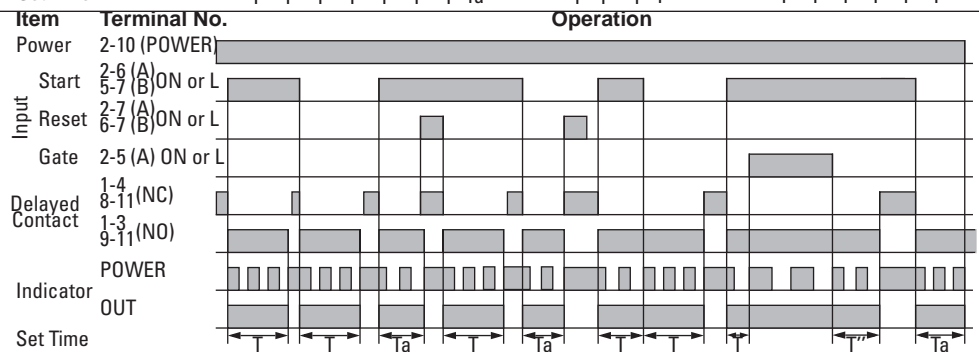

**Signal OFF-Delay 1**


MODE

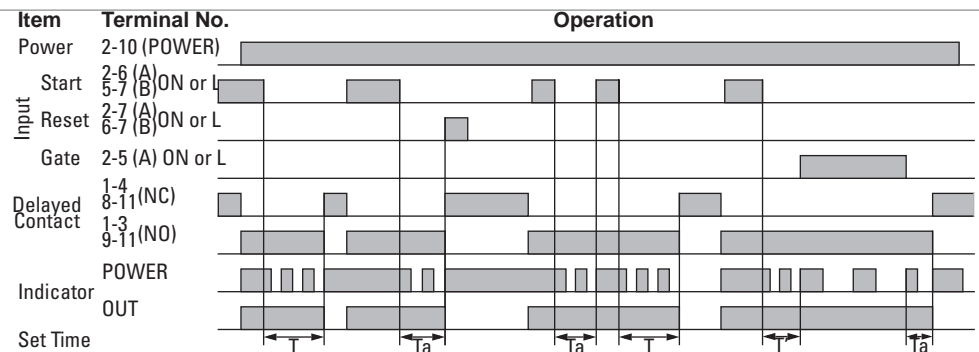

**Timers**

GT3A- 5 Timing Diagrams


Delayed DPDT

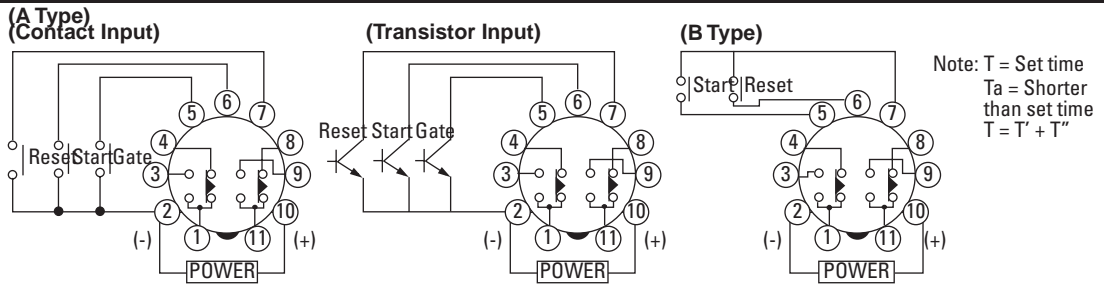

Operation Mode Selection


Interval 2

MODE

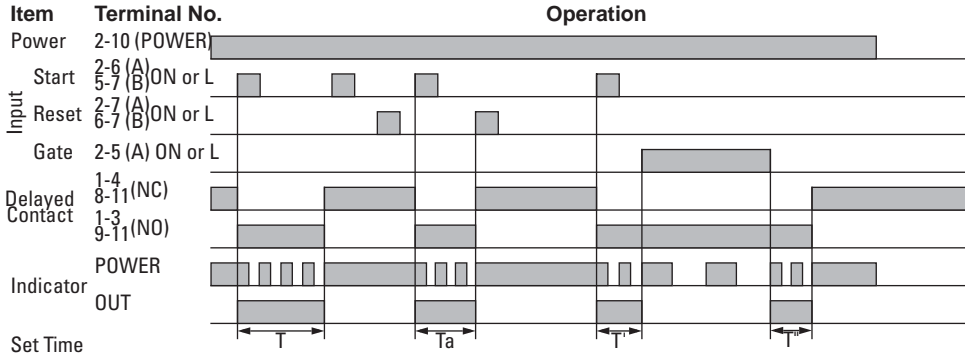


One-Shot Cycle

MODE

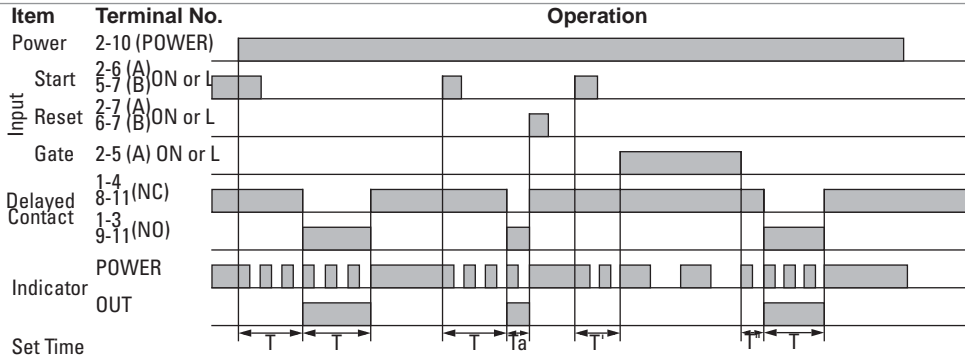


Signal ON/OFF-Delay 2

MODE

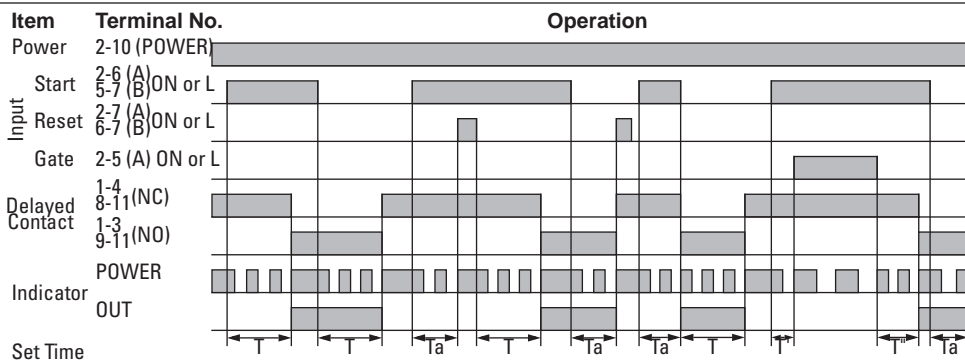


Signal OFF-Delay 2

MODE

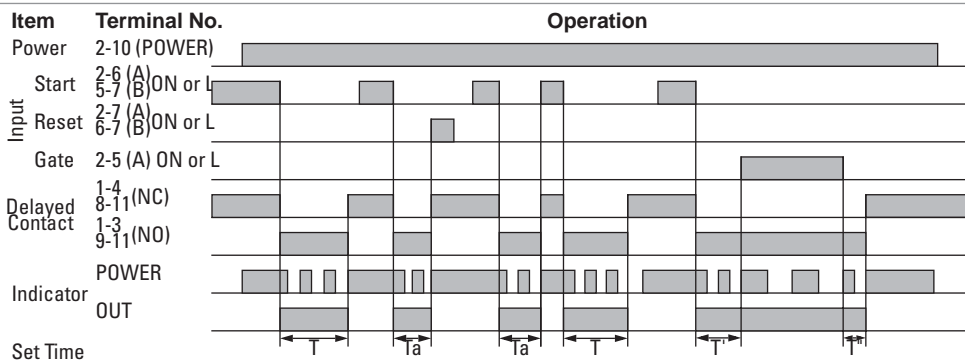


## GT3A- 6 Timing Diagrams

### Delayed DPDT

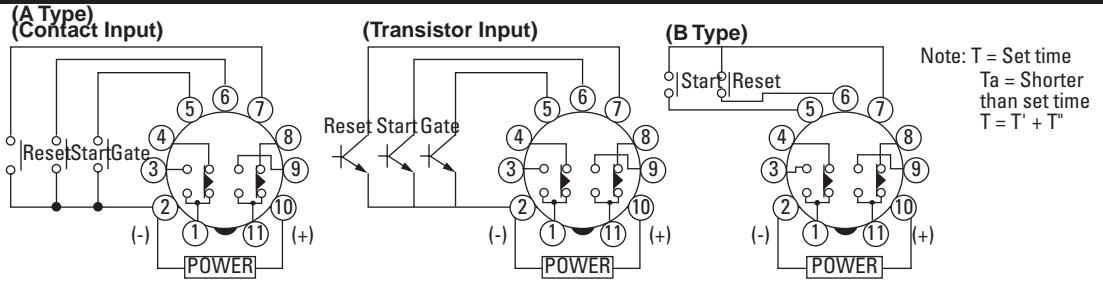


Operation Mode Selection


#### One-Shot 1

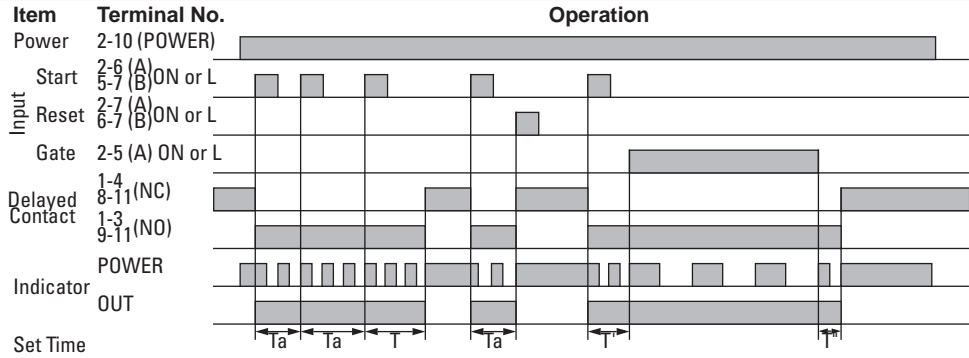


#### One-Shot ON-Delay

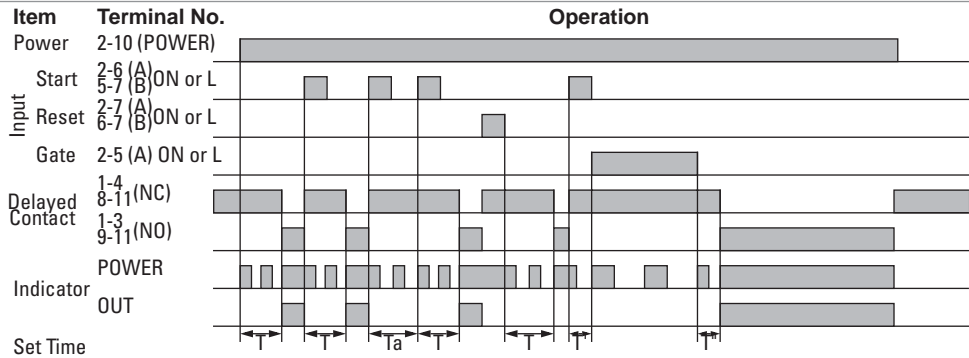

#### One Shot 2

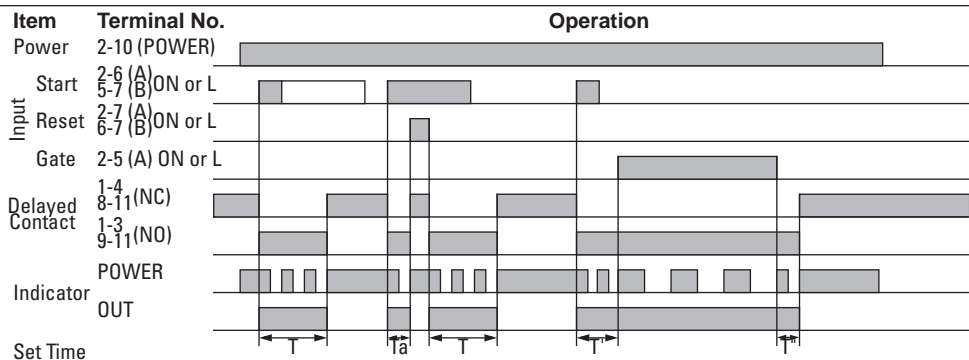


#### Signal ON/OFF-Delay 3

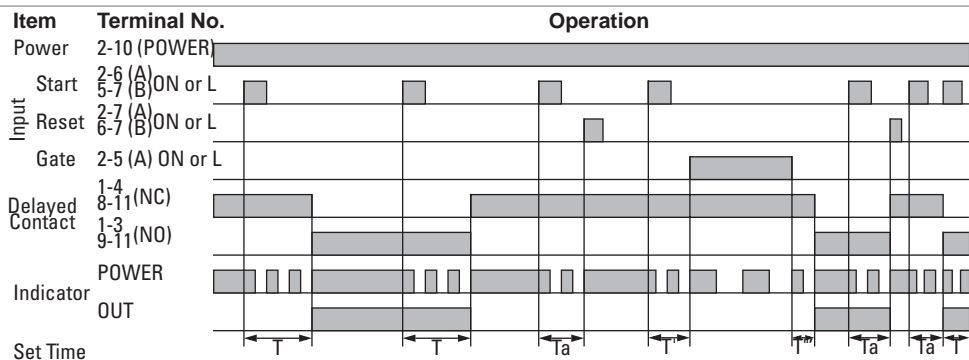

**G**  
Timers



**Instructions: Setting GT3A Series Timers**

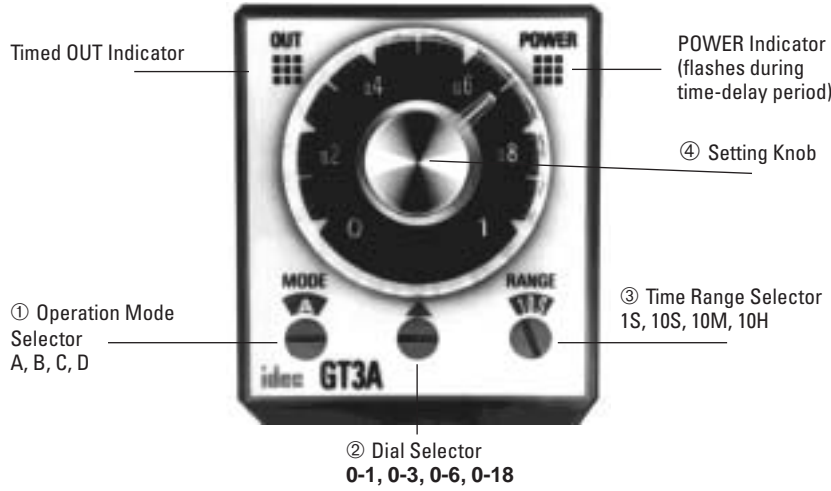

Step 1.	Desired Mode of Operation		Selection	Remarks
<p><b>Select the desired mode of operation.</b></p>	For Timers GT3A-1 GT3A-2 GT3A-3	Mode of Operation	① Operation Mode Selector	<p>The desired operation mode can be selected from the A, B, C, and D modes using the Operation Mode Selector. Change the operation mode from A to B, C, and D in turn by turning the operation mode selector clockwise using a flat screwdriver which is a maximum of 0.156" (4mm) wide. The selected mode is displayed in the window.</p>
		ON-delay 1	A	
		Interval 1	B	
		Cycle 1	C	
	GT3A-4	ON-delay 2	A	
		Cycle 2	B	
		Signal ON/OFF-delay 1	C	
		Signal OFF-delay 1	D	
	GT3A-5	Interval 2	A	
		One-shot cycle	B	
		Signal ON/OFF-delay 2	C	
		Signal OFF-delay 2	D	
	GT3A-6	One-shot 1	A	
One-shot ON-delay		B		
One-shot 2		C		
Signal ON/OFF-delay 3		D		

Step 2.	Desired Time Range		Selection		Remarks
<p><b>Select the time range that contains the desired time period.</b></p>	Time Ranges		② Dial Selector	③ Time Range Selector	<p>The desired time range is selected by setting both ② Dial Selector and ③ Time Range Selector.</p>
	0.05 seconds to 1 second		0-1	1S	
	0.05 seconds to 3 seconds		0-3		
	0.05 seconds to 6 seconds		0-6		
	0.15 seconds to 18 seconds		0-18		
	0.1 seconds to 10 seconds		0-1	10S	
	0.3 seconds to 30 seconds		0-3		
	0.6 seconds to 60 seconds		0-6		
	1.8 seconds to 180 seconds		0-18		
	6 seconds to 10 minutes		0-1	10M	
	18 seconds to 30 minutes		0-3		
	36 seconds to 60 minutes		0-6		
	108 seconds to 180 minutes		0-18		
	6 minutes to 10 hours		0-1	10H	
	18 minutes to 30 hours		0-3		
	36 minutes to 60 hours		0-6		
108 minutes to 180 hours		0-18			
Step 3.	Selection				

Set the precise period of time desired by using the ④ Setting Knob.

## GT3D Series — Digital Timers



**Key features of the GT3D series include:**

- Precise time setting using digital thumbwheel switches
- Elapsed or time remaining LED display
- 6 time ranges, 16 timing functions
- Time delays up to 99.9 hours



UL Recognized  
File No. E55996



CSA Certified  
File No. LR58183  
LR96764  
LR83814



Cert. No.  
BL9801133323911 (LVD)  
E9971113332388 (EMC)

		GT3D-2	GT3D-3	GT3D-4	GT3D-8	
<b>Specifications</b>	<b>Operation System</b>	Solid state CMOS circuitry				
	<b>Operation</b>	Multi-mode			Multi-mode, one-shot output	
	<b>Time Range</b>	0.01s to 99.9 hours				
	<b>Rated Voltage</b>	100 to 240V AC (50/60Hz), 24V AC (50/60Hz)/24V DC				
	<b>Contact Ratings</b>	125V AC/250V AC, 3A; 30V DC/1A (resistive load)	125V AC/250V AC, 5A; 30V DC/5A (resistive load)			
	<b>Contact Form</b>	Delayed SPDT + instantaneous SPDT	Delayed DPDT	Delayed DPDT	Delayed DPDT	
	<b>Minimum Applicable Load</b>	5V, 10mA (reference value)				
	<b>Voltage Tolerance</b>	AF20 (100–240V AC): 85 to 264V AC AD24 (AC): 20.4 to 26.4V AC AD24 (DC): 21.6 to 26.4V DC				
	<b>Error</b>	±0.3% ±50ms (voltage, repeat, and temperature)				
	<b>Setting Error</b>	±0.5% ±50ms				
	<b>Reset Time</b>	60ms maximum				
	<b>Insulation Resistance</b>	100MΩ minimum				
	<b>Dielectric Strength</b>	Between power and output terminals: 2,000V AC, 1 minute Between contacts of different poles: 2,000V AC, 1 minute Between contacts of the same pole: 750V AC, 1 minute				
	<b>Power Consumption (approximate)</b>	<b>AF20</b>	11.8VA	11.6VA	3.7VA (100V AC, 60Hz) 11.6VA (200V AC, 60Hz)	
		<b>AD24 AC/DC</b>	1VA/0.8W	2.1VA/0.9W	2.1VA /0.9W	
	<b>Mechanical Life</b>	10,000,000 operations minimum		5,000,000 operations minimum		
	<b>Electrical Life (at rated load)</b>	50,000 operations minimum		100,000 operations minimum		
	<b>Outputs</b>	<b>Relay</b>	250V AC, 3A, 30V DC, 1A (resistive load)	240V AC/, 24V DC, 5A (resistive load)		
<b>Vibration Resistance</b>	100N (approximate 10G)					
<b>Shock Resistance</b>	Operating extremes: 100N (approximate 10G) Damage limits: 500N (approximate 50G)					
<b>Operating Temperature</b>	–10 to +50°C					
<b>Storage Temperature</b>	–30 to +80°C					
<b>Operating Humidity</b>	45 to 85% RH					
<b>Weight (approximate)</b>	70g	75g	76g			
<b>Housing Color</b>	Gray					

**GT3D Table of Contents**

- Specifications — G-23
- Part Number List — G-24
- Timing Diagrams/ Schematics — G-25
- Instructions:
  - Setting Timer — G-33
- GT3 Accessories — G-48
- GT3 Instructions:
  - Wiring Inputs — G-50
- GT3 Dimensions — G-52
- Timing Diagrams Overview — G-4



## Part Number List

## Part Numbers: GT3D-1/GT3D-2/GT3D-3

Mode of Operation	Time Range	Output	Contact	Rated Voltage Code	Complete Part No.	
					8-Pin	11-Pin
1-A: ON-delay 1 1-B: Interval 1 first 1-C: Cycle 1 (OFF first) 1-D: Cycle 3 (ON first)	0.01s to 99.9 hours	250V AC, 3A, 30V DC, 1A (resistive load)	Delayed SPDT + instantaneous SPDT	100 to 240V AC (50/60Hz)	GT3D-2AF20	GT3D-2EAF20
				24V AC/DC	GT3D-2AD24	—
		240V AC/ 24V DC, 5A (resistive load)	Delayed DPDT	100 to 240V AC (50/60Hz)	GT3D-3AF20	GT3D-3EAF20
				24V AC/DC	GT3D-3AD24	—

## Part Numbers: GT3D-4

Mode of Operation	Time Range	Output	Contact	Rated Voltage Code	Complete Part No.	
					A (11-pin)	B (11-pin)
1-A: ON-delay 1 1-B: Interval 1 first 1-C: Cycle 1 (OFF first) 1-D: Cycle 3 (ON first) 2-A: ON-delay 2 2-B: Cycle 2 2-C: Signal ON/OFF-delay 1 2-D: Signal OFF-delay 1 2-E: Interval 2 2-F: One-shot cycle 3-A: Signal ON/OFF-delay 2 3-B: Signal OFF-delay 2 3-C: One-shot 1 3-D: One-shot ON-delay 3-E: One-shot 2 3-F: Signal ON/OFF-delay 3	0.01s to 99.9 hours	240V AC/24V DC, 5A (resistive load)	Delayed DPDT	100 to 240V AC (50/60Hz)	GT3D-4AF20	GT3D-4EAF20
				24V AC/DC	GT3D-4AD24	—

## Part Numbers: GT3D-8

Mode of Operation	Time Range	Output	Contact	Rated Voltage Code	Complete Part No. (11-pin)
1: ON-delay one-shot 1 2: Cycle one-shot 3: ON-delay one-shot 2	0.01s to 99.9 hours	240V AC/24V DC, 5A (resistive load)	Delayed DPDT	100 to 240V AC (50/60Hz)	GT3D-8AF20
				24V AC/DC	GT3D-8AD24




1. For wiring schematics and timing diagrams GT3D, see pages G-25 to G-32.
2. For more details about time ranges, see instructions on page G-33.
3. A (11-pin) and B (11-pin) differ in the way inputs are wired.
4. For socket and accessory part numbers, see page G-48.
5. For timing diagrams overview, see page G-4.



## GT3D-2 Timing Diagrams

Contact	Delayed SPDT + Instantaneous SPDT																							
<b>ON-Delay 1</b> Time Remaining  Time Elapsed 	<table border="1"> <thead> <tr> <th>Item</th> <th>Terminal No.</th> <th>Operation</th> </tr> </thead> <tbody> <tr> <td>Power</td> <td>(Power) 2-7 (8p) 2-10 (11p)</td> <td></td> </tr> <tr> <td rowspan="2">Delayed Contact</td> <td>(NC) 1-4, 5-8 (8p) 1-4, 8-11 (11p)</td> <td></td> </tr> <tr> <td>(NO) 1-3, 6-8 (8p) 1-3, 9-11 (11p)</td> <td></td> </tr> <tr> <td rowspan="2">Instantaneous Contact</td> <td>(NC) 1-4</td> <td></td> </tr> <tr> <td>(NO) 1-3</td> <td></td> </tr> <tr> <td>Indicator</td> <td>OUT</td> <td></td> </tr> <tr> <td>Digital Time Display</td> <td>DOWN UP</td> <td></td> </tr> </tbody> </table>	Item	Terminal No.	Operation	Power	(Power) 2-7 (8p) 2-10 (11p)		Delayed Contact	(NC) 1-4, 5-8 (8p) 1-4, 8-11 (11p)		(NO) 1-3, 6-8 (8p) 1-3, 9-11 (11p)		Instantaneous Contact	(NC) 1-4		(NO) 1-3		Indicator	OUT		Digital Time Display	DOWN UP		
	Item	Terminal No.	Operation																					
	Power	(Power) 2-7 (8p) 2-10 (11p)																						
	Delayed Contact	(NC) 1-4, 5-8 (8p) 1-4, 8-11 (11p)																						
		(NO) 1-3, 6-8 (8p) 1-3, 9-11 (11p)																						
	Instantaneous Contact	(NC) 1-4																						
(NO) 1-3																								
Indicator	OUT																							
Digital Time Display	DOWN UP																							
<b>Interval 1</b> Time Remaining  Time Elapsed 	<table border="1"> <thead> <tr> <th>Item</th> <th>Terminal No.</th> <th>Operation</th> </tr> </thead> <tbody> <tr> <td>Power</td> <td>(Power) 2-7 (8p) 2-10 (11p)</td> <td></td> </tr> <tr> <td rowspan="2">Delayed Contact</td> <td>(NC) 1-4, 5-8 (8p) 1-4, 8-11 (11p)</td> <td></td> </tr> <tr> <td>(NO) 1-3, 6-8 (8p) 1-3, 9-11 (11p)</td> <td></td> </tr> <tr> <td rowspan="2">Instantaneous Contact</td> <td>(NC) 1-4</td> <td></td> </tr> <tr> <td>(NO) 1-3</td> <td></td> </tr> <tr> <td>Indicator</td> <td>OUT</td> <td></td> </tr> <tr> <td>Digital Time Display</td> <td>DOWN UP</td> <td></td> </tr> </tbody> </table>	Item	Terminal No.	Operation	Power	(Power) 2-7 (8p) 2-10 (11p)		Delayed Contact	(NC) 1-4, 5-8 (8p) 1-4, 8-11 (11p)		(NO) 1-3, 6-8 (8p) 1-3, 9-11 (11p)		Instantaneous Contact	(NC) 1-4		(NO) 1-3		Indicator	OUT		Digital Time Display	DOWN UP		
	Item	Terminal No.	Operation																					
	Power	(Power) 2-7 (8p) 2-10 (11p)																						
	Delayed Contact	(NC) 1-4, 5-8 (8p) 1-4, 8-11 (11p)																						
		(NO) 1-3, 6-8 (8p) 1-3, 9-11 (11p)																						
	Instantaneous Contact	(NC) 1-4																						
(NO) 1-3																								
Indicator	OUT																							
Digital Time Display	DOWN UP																							
<b>Cycle 1 (OFF first)</b> Time Remaining  Time Elapsed 	<table border="1"> <thead> <tr> <th>Item</th> <th>Terminal No.</th> <th>Operation</th> </tr> </thead> <tbody> <tr> <td>Power</td> <td>(Power) 2-7 (8p) 2-10 (11p)</td> <td></td> </tr> <tr> <td rowspan="2">Delayed Contact</td> <td>(NC) 1-4, 5-8 (8p) 1-4, 8-11 (11p)</td> <td></td> </tr> <tr> <td>(NO) 1-3, 6-8 (8p) 1-3, 9-11 (11p)</td> <td></td> </tr> <tr> <td rowspan="2">Instantaneous Contact</td> <td>(NC) 1-4</td> <td></td> </tr> <tr> <td>(NO) 1-3</td> <td></td> </tr> <tr> <td>Indicator</td> <td>OUT</td> <td></td> </tr> <tr> <td>Digital Time Display</td> <td>DOWN UP</td> <td></td> </tr> </tbody> </table>	Item	Terminal No.	Operation	Power	(Power) 2-7 (8p) 2-10 (11p)		Delayed Contact	(NC) 1-4, 5-8 (8p) 1-4, 8-11 (11p)		(NO) 1-3, 6-8 (8p) 1-3, 9-11 (11p)		Instantaneous Contact	(NC) 1-4		(NO) 1-3		Indicator	OUT		Digital Time Display	DOWN UP		
	Item	Terminal No.	Operation																					
	Power	(Power) 2-7 (8p) 2-10 (11p)																						
	Delayed Contact	(NC) 1-4, 5-8 (8p) 1-4, 8-11 (11p)																						
		(NO) 1-3, 6-8 (8p) 1-3, 9-11 (11p)																						
	Instantaneous Contact	(NC) 1-4																						
(NO) 1-3																								
Indicator	OUT																							
Digital Time Display	DOWN UP																							
<b>Cycle 3 (ON first)</b> Time Remaining  Time Elapsed 	<table border="1"> <thead> <tr> <th>Item</th> <th>Terminal No.</th> <th>Operation</th> </tr> </thead> <tbody> <tr> <td>Power</td> <td>(Power) 2-7 (8p) 2-10 (11p)</td> <td></td> </tr> <tr> <td rowspan="2">Delayed Contact</td> <td>(NC) 1-4, 5-8 (8p) 1-4, 8-11 (11p)</td> <td></td> </tr> <tr> <td>(NO) 1-3, 6-8 (8p) 1-3, 9-11 (11p)</td> <td></td> </tr> <tr> <td rowspan="2">Instantaneous Contact</td> <td>(NC) 1-4</td> <td></td> </tr> <tr> <td>(NO) 1-3</td> <td></td> </tr> <tr> <td>Indicator</td> <td>OUT</td> <td></td> </tr> <tr> <td>Digital Time Display</td> <td>DOWN UP</td> <td></td> </tr> </tbody> </table>	Item	Terminal No.	Operation	Power	(Power) 2-7 (8p) 2-10 (11p)		Delayed Contact	(NC) 1-4, 5-8 (8p) 1-4, 8-11 (11p)		(NO) 1-3, 6-8 (8p) 1-3, 9-11 (11p)		Instantaneous Contact	(NC) 1-4		(NO) 1-3		Indicator	OUT		Digital Time Display	DOWN UP		
	Item	Terminal No.	Operation																					
	Power	(Power) 2-7 (8p) 2-10 (11p)																						
	Delayed Contact	(NC) 1-4, 5-8 (8p) 1-4, 8-11 (11p)																						
		(NO) 1-3, 6-8 (8p) 1-3, 9-11 (11p)																						
	Instantaneous Contact	(NC) 1-4																						
(NO) 1-3																								
Indicator	OUT																							
Digital Time Display	DOWN UP																							

**GT3D-3 Timing Diagrams**


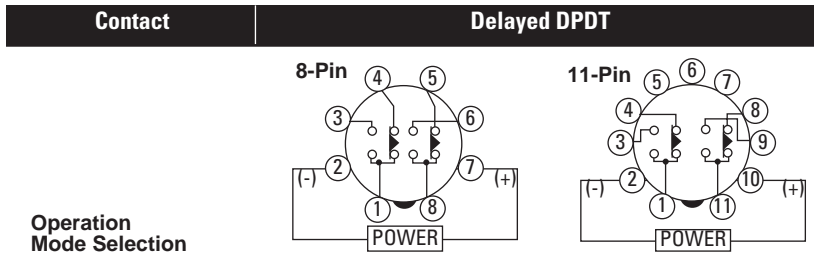


**ON-Delay 1**

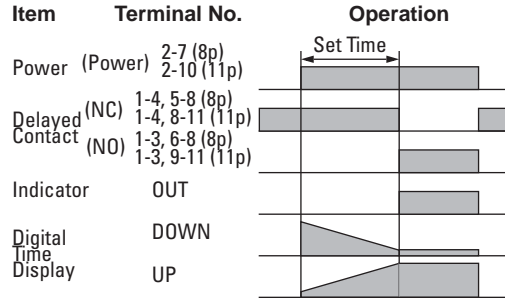



**Timers**



**Interval 1**

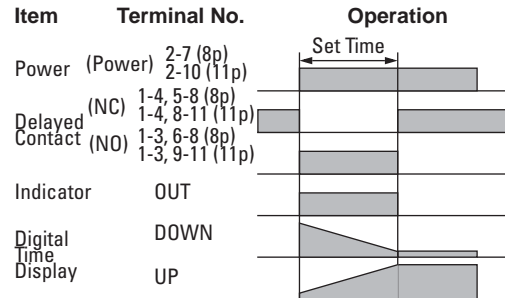

**Cycle 1 (OFF first)**

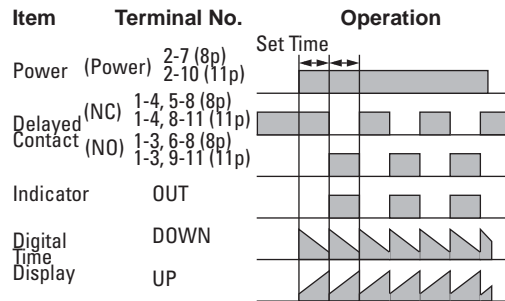

**Cycle 3 (ON first)**

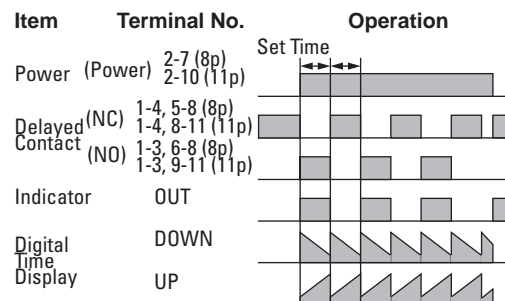


## GT3D-4 Timing Diagrams

These timers require a start input. A gate and reset input are optional. Inputs are controlled by external pushbuttons. Reset occurs when the power is removed or when the reset input is supplied. The gate signal can be used to interrupt (freeze) timer functions. Timer functions resume when the gate input is removed. B style timers are not equipped for gate input.

### GT3D-4

#### Delayed DPDT

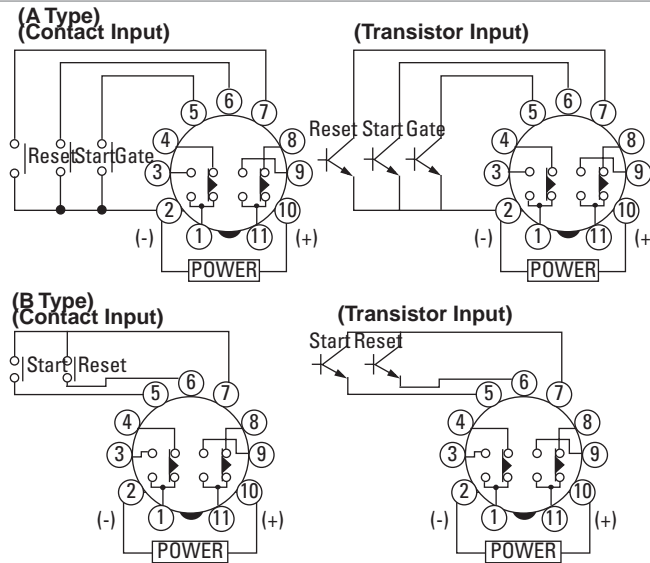



**G**  
Timers

#### ON-Delay 1

Time Remaining



Time Elapsed

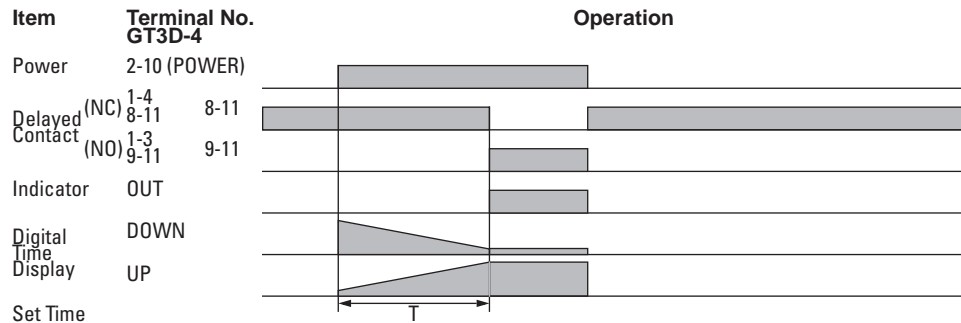



#### Interval 1

Time Remaining




Time Elapsed

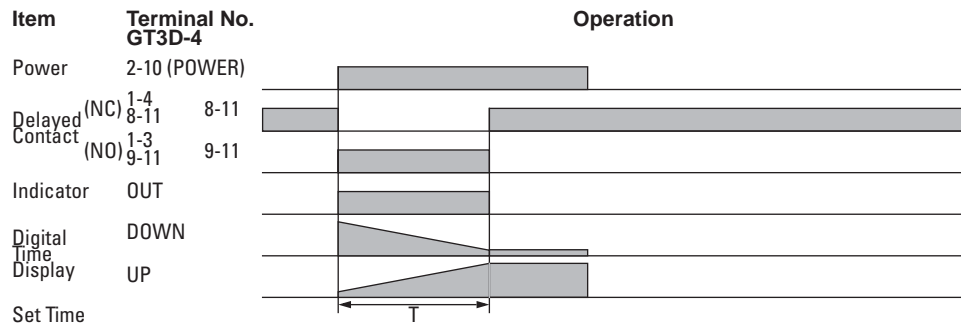


**GT3D-4 Timing Diagrams, continued**


**Cycle 1 (OFF first)**  
 Time Remaining  
**1** — **C**  
 Time Elapsed  
**1** — **C**

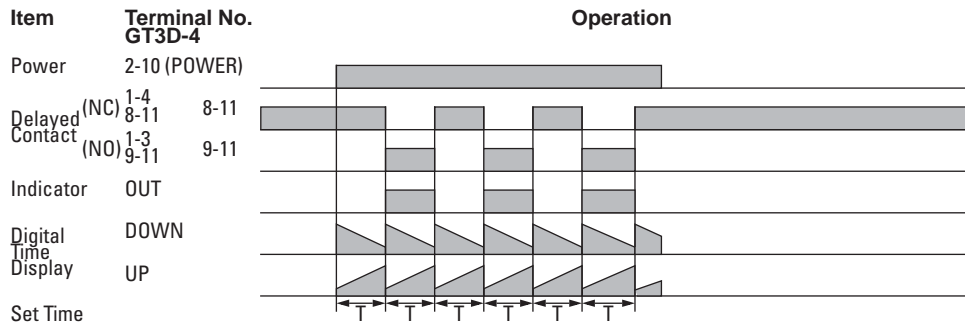

**Cycle 3 (ON first)**  
 Time Remaining  
**1** — **D**  
 Time Elapsed  
**1** — **D**

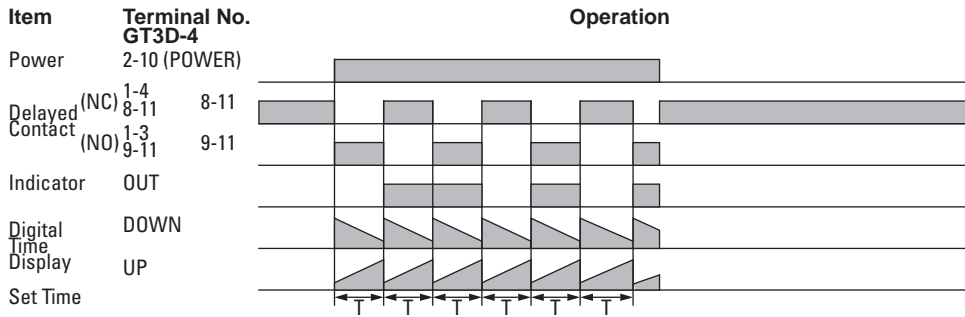



**ON-Delay 2**  
 Time Remaining  
**2** — **A**  
 Time Elapsed  
**2** — **A**

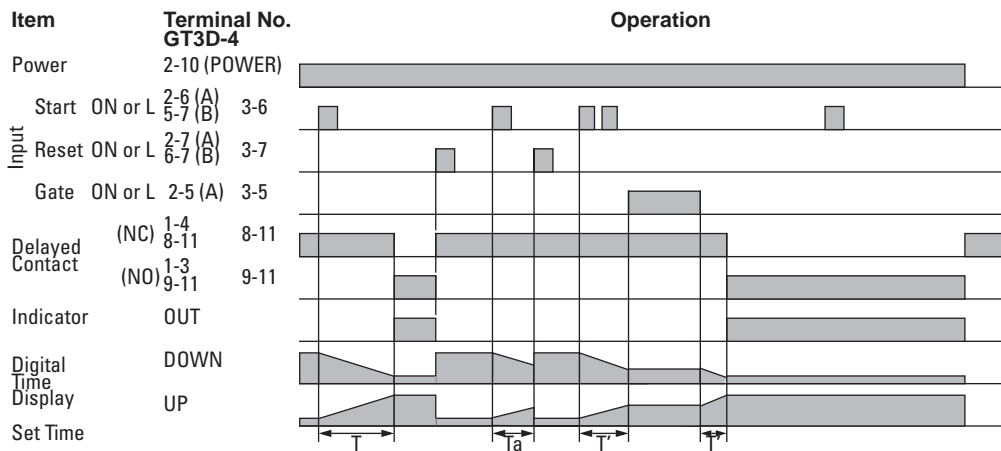



**Timers**

## GT3D-4 Timing Diagrams, continued



### Cycle 2

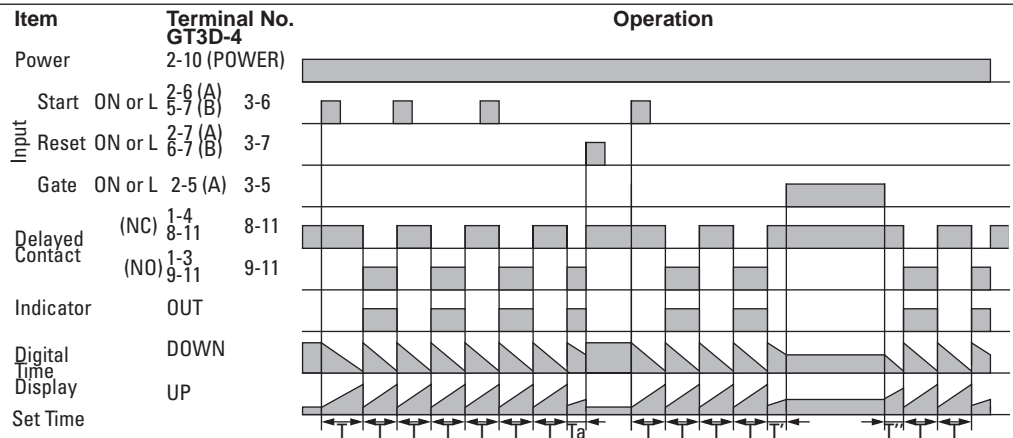



### Signal ON/OFF-Delay 1

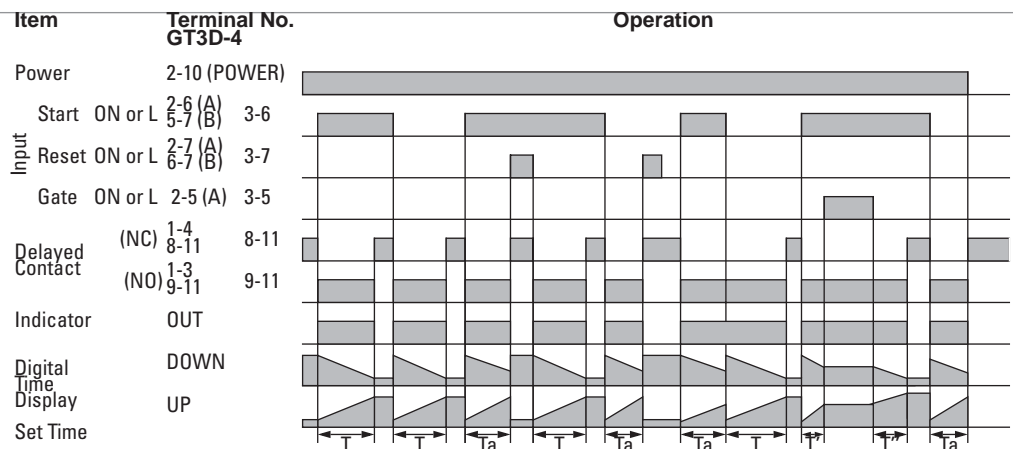

### Signal OFF-Delay 1

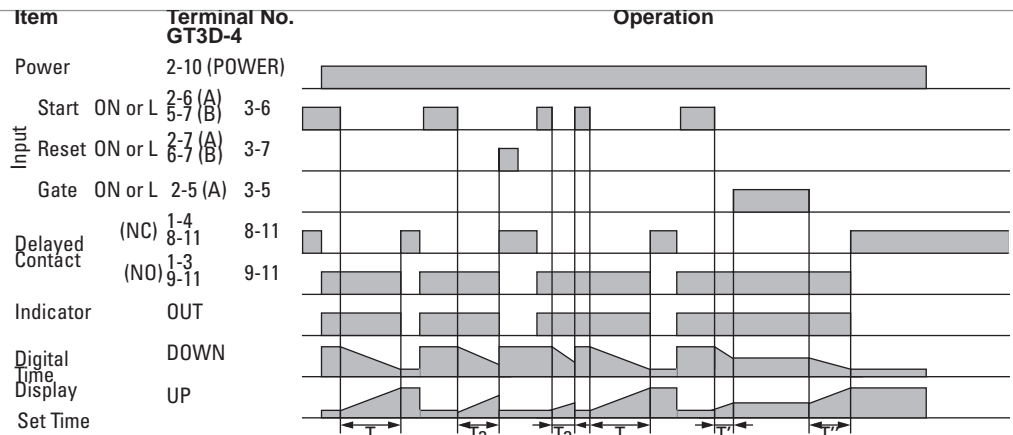

### Interval 2

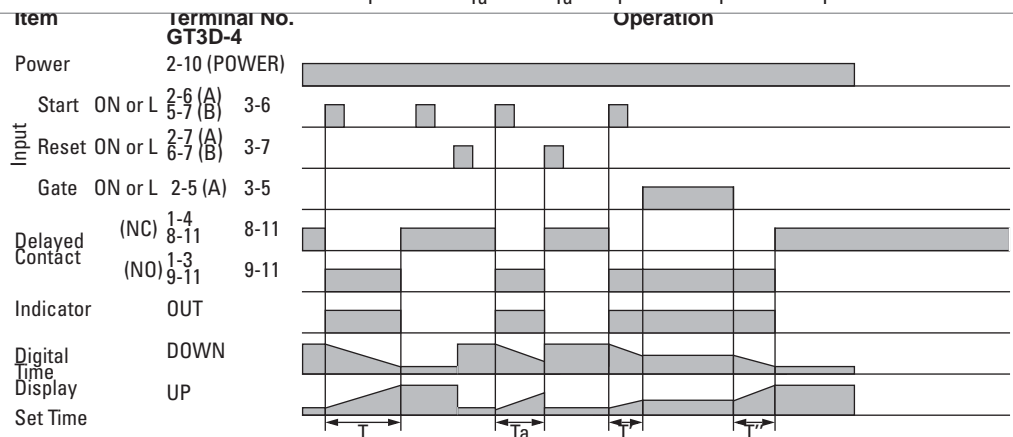

**GT3D Series**




**GT3D-4 Timing Diagrams, continued**

**One-Shot Cycle**

Time Remaining  



Time Elapsed  

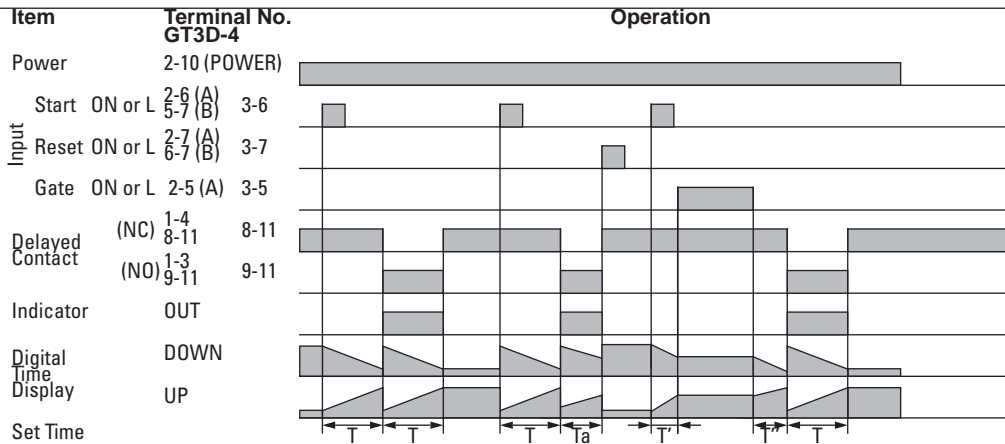**Signal ON/OFF-Delay 2**

Time Remaining  



Time Elapsed  

**Signal OFF-Delay 2**

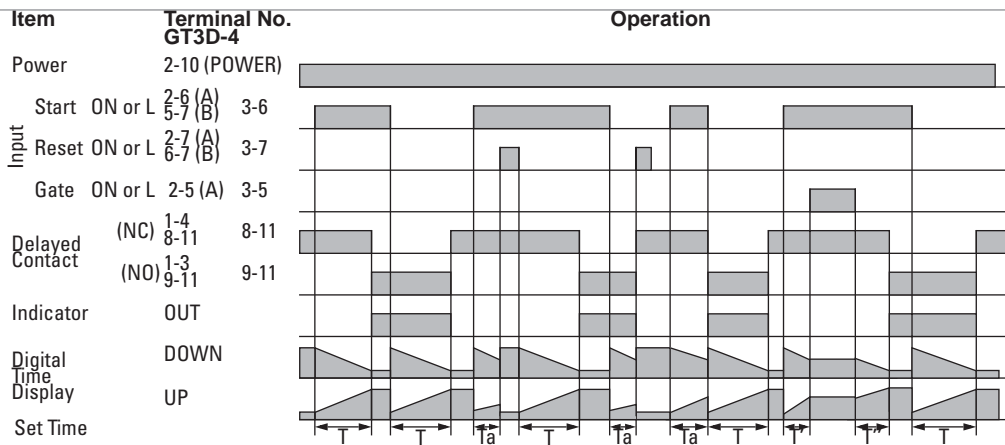Time Remaining  



Time Elapsed  

**One-Shot 1**

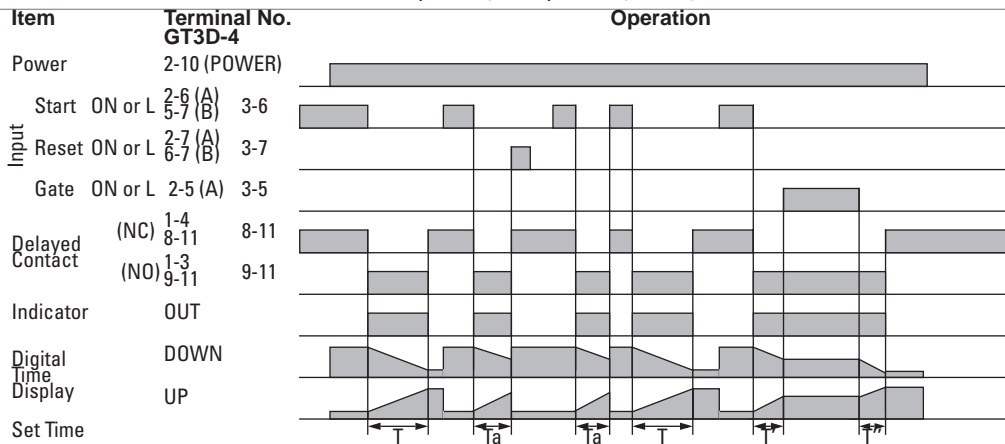Time Remaining  




Time Elapsed  



**Timers**

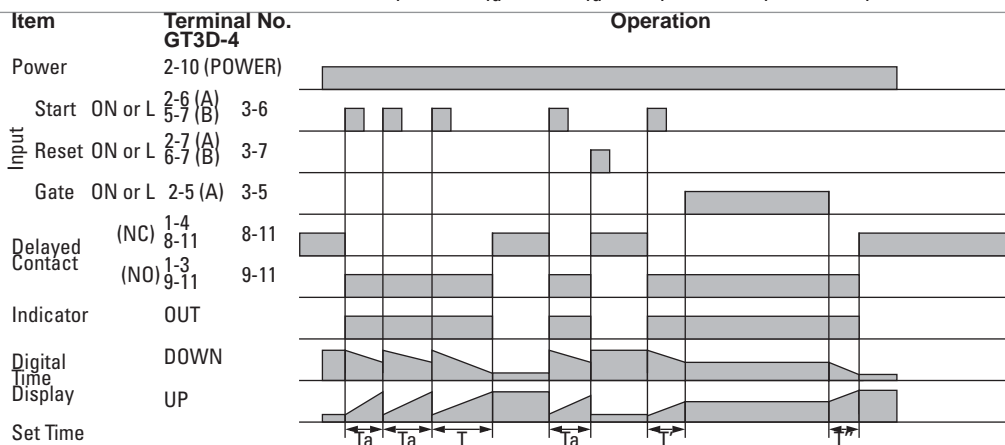**GT3D-4 Timing Diagrams, continued**



**One-Shot ON-Delay**

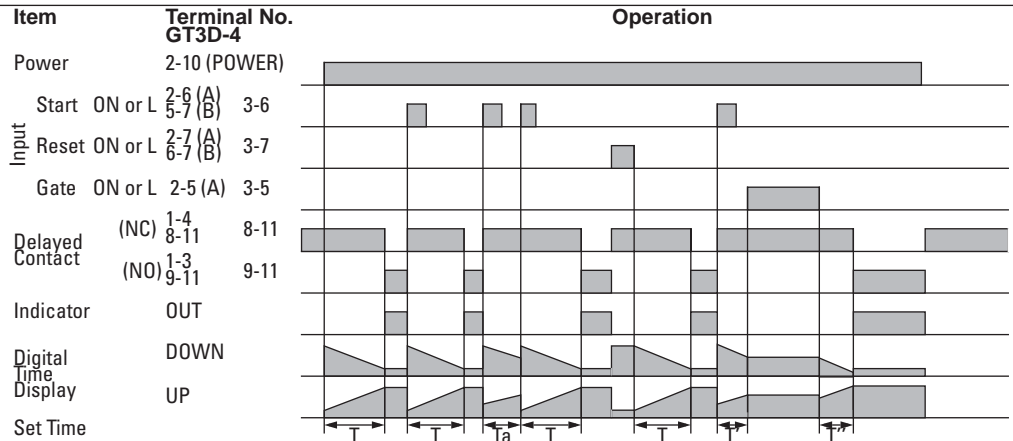

**One Shot 2**

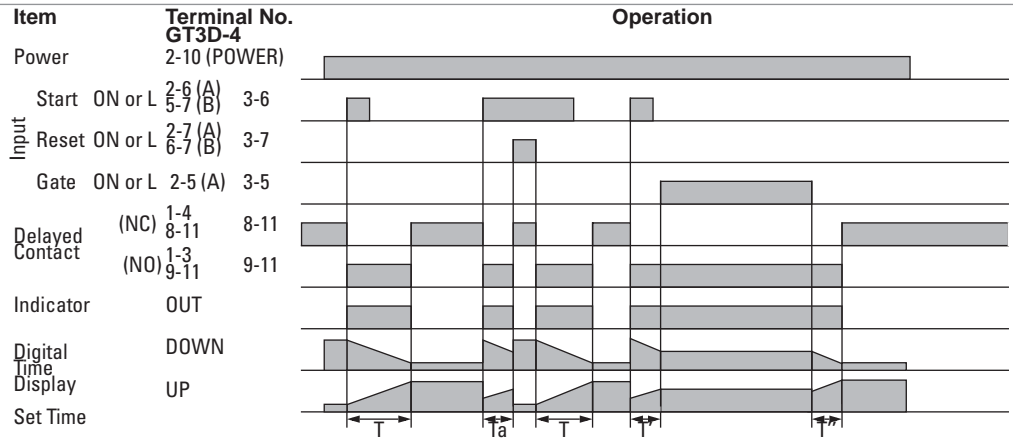


**Signal ON/OFF-Delay 3**

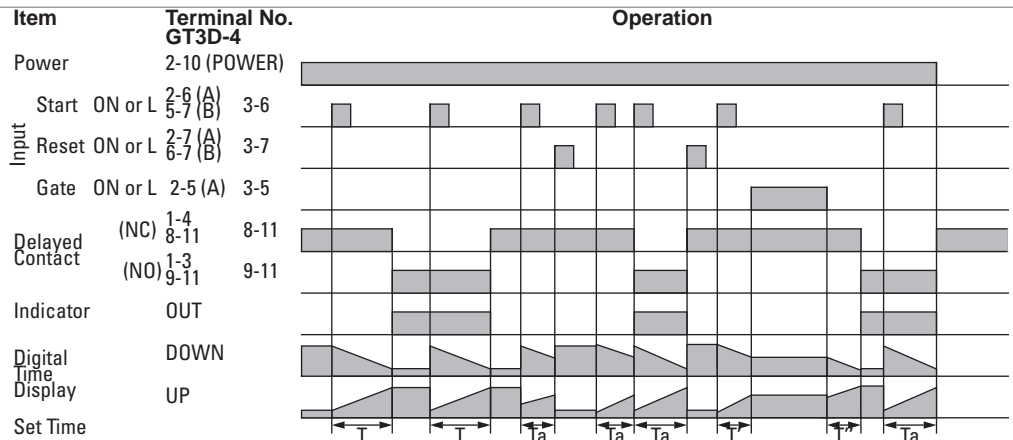


**GT3D-8 Timing Diagrams**

**Delayed DPDT**

**(Contact Input)**


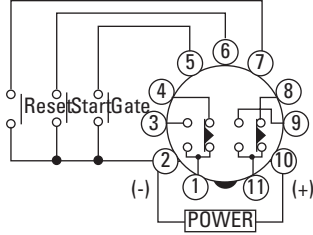


**(Transistor Input)**


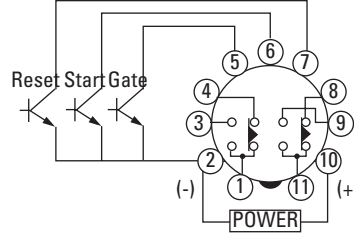


Note: T = Set time  
 Ta = Shorter than set time  
 Tb = Shorter than single-shot output time  
 $T = T' + T''$   
 T0 = Single-shot output time (selected from A, B, C, D, E or F)



**ON-Delay One-Shot 1**

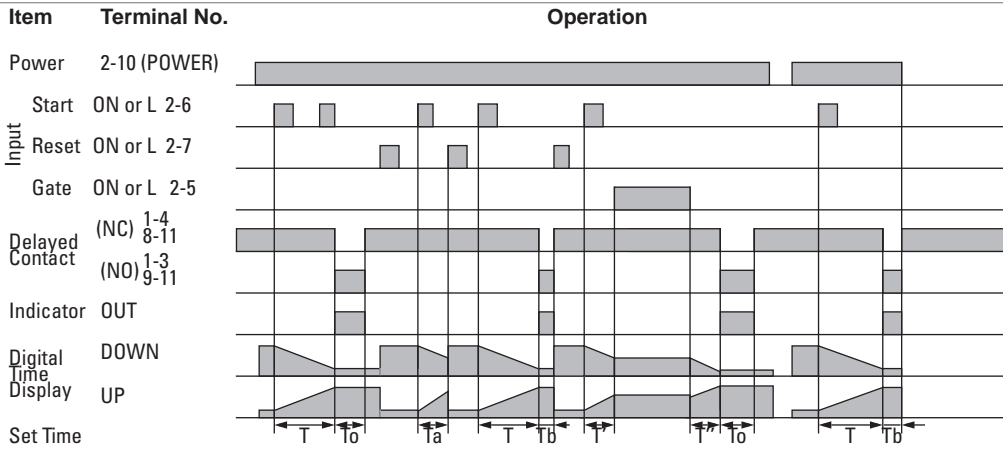

**Cycle One-Shot**

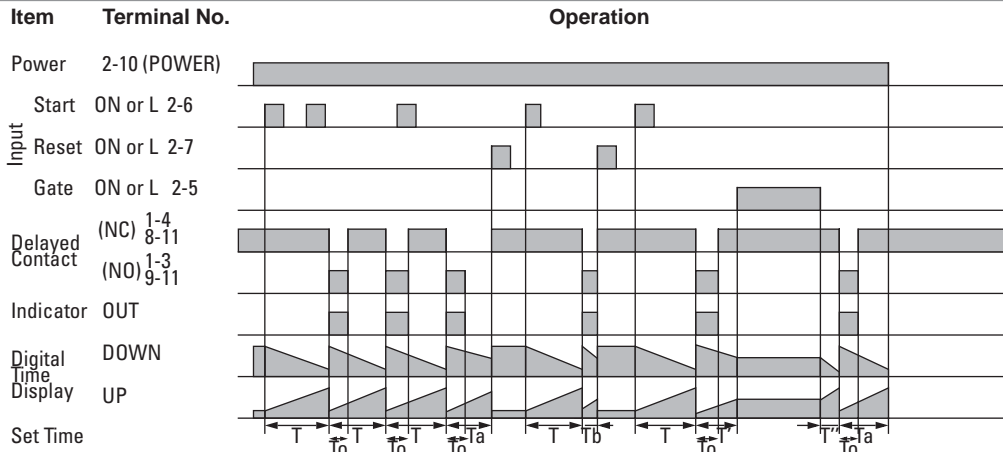


**ON-Delay One-Shot 2**

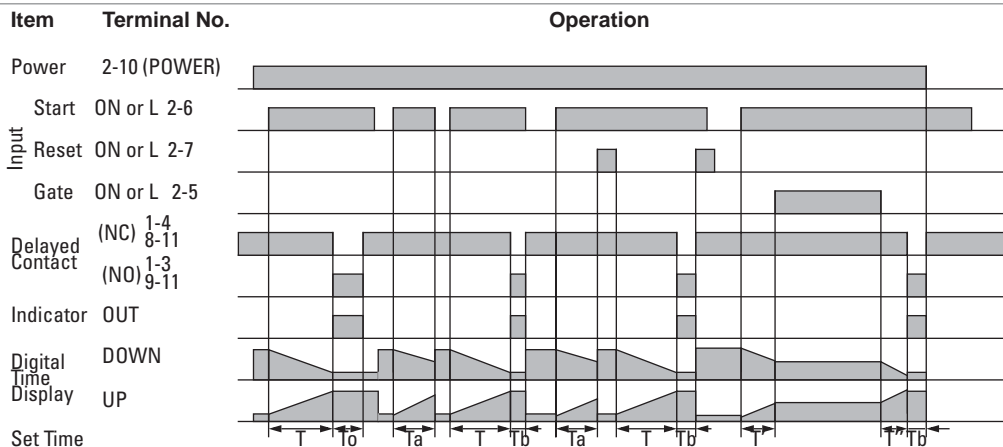

Timers

## Instructions: Setting GT3D-2, GT3D-3 Timers

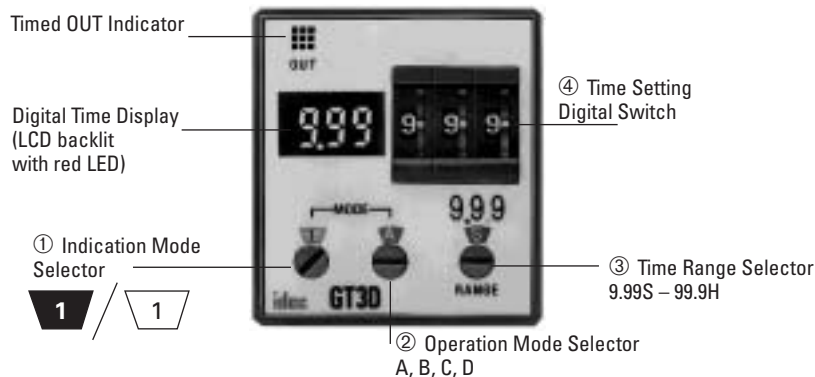


Step 1	Desired Mode/Selection				Remarks
Select the desired time display and operation modes.	<b>Time Display Mode</b>	<b>① Indication Mode Selector</b>	<b>Operation Mode</b>	<b>② Operation Mode Selector</b>	1. Use the flat screwdriver to set the selectors. Since selectors do not turn all the way around, both clockwise and counterclockwise rotation may be necessary.  2. The ① Indication Mode Selector determines whether the Digital Time Display shows the time elapsed or time remaining. The ② Operation Mode Selector determines the desired operation mode. Decide which display and mode is desired, then use these two selectors ①② to set the operation mode.  3. The ② Operation Mode Selector has two blank modes which are not intended for use. Always have this selector set to A, B, C, or D.
	Time elapsed		ON-delay 1	A	
	Time remaining				
	Time elapsed		Interval	B	
	Time remaining				
	Time elapsed		Cycle 1	C	
	Time remaining				
	Time elapsed		Cycle 3	D	
	Time remaining				
Step 2	Desired Operation	Selection		Remarks	
Select a time range that contains the desired period of time.	<b>Base Time Ranges</b>	<b>③ Time Range Selector</b>		1. The ③ Time Range Selector controls both the decimal point indicator (9.99, 99.9, 999) and the time increment indicators S (seconds), M (minutes), and H (hours).  2. Chose which base time range contains the targeted timer setting. Then use the ③ Time Range Selector to set the decimal point indicator and time increment indicator to its corresponding pair of settings.  3. Since these configurations offer a complete range of settings from 0.01 seconds to 99.9 hours, the setting of 9.99 for minutes and the 9.99 and 999 settings for hours are not listed and should not be used.	
		<b>Decimal Point Indicator</b>	<b>Time Increment Indicator</b>		
	0.01 seconds to 9.99 seconds	9.99			
	0.1 seconds to 99.9 seconds	99.9			
	1 second to 999 seconds	999			
	0.1 minutes to 99.9 minutes	99.9			
	1 minute to 999 minutes	999			
0.1 hours to 99.9 hours	99.9				
Step 3	Desired Operation	Selection		Remarks	
Set the precise period of time desired by using the ④ Time Setting Digital Switch.				Use the ④ Time Setting Digital Switch to set the desired period of time. It is important to remember that the setting of the ③ Time Range Selector determines the units of time measurement as well as the implied decimal point location.	



It is important to remember that the ③ Time Range Selector not only selects the time range but also influences the interpretation of the Digital Time Display. Changing the ③ Time Range Selector setting changes the units of time measurement (seconds, minutes, hours) as well as the decimal point location.

**Instructions: Setting GT3D-4 Timers**

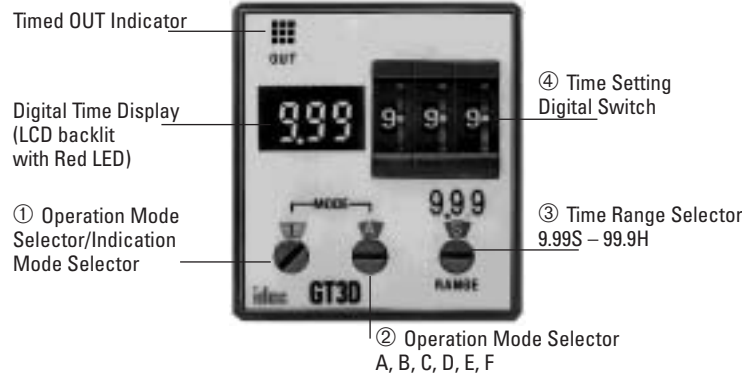


**Timers**

Step 1	Desired Mode/Selection				Remarks
<p><b>Select the desired time display and operation modes.</b></p>	<b>Time Display Mode</b>	<b>① Indicator Mode Selector</b>	<b>Operation Mode</b>	<b>② Operation Mode Selector</b>	<p>1. Use a flat screwdriver to set the selectors. Since selectors do not turn all the way around, both clockwise and counter-clockwise rotation is necessary.</p> <p>2. The ① Indicator Mode Selector determines whether the Digital Time Display shows the time elapsed or time remaining. The ② Operation Mode Selector determines the desired operation mode. Decide which display and mode is desired; then use these two selectors ①② to set the operation mode.</p> <p>3. When using the indicator mode setting "1," the ② Operation Mode Selector has two blank modes which are not intended for use. When using mode setting "1," always have the operation mode selector set to A, B, C, or D.</p>
	Time elapsed	1	ON-delay 1 Interval 1	A B C D	
	Time remaining	1	Cycle 1 D: Cycle 3		
	Time elapsed	2	ON-delay 2 Cycle 2	A B C D E F	
	Time remaining	2	Signal ON/OFF-delay 2 Signal OFF-delay 1 Interval 2 One-shot cycle		
	Time elapsed	3	Signal ON/OFF-delay 2 Signal OFF-delay 2 One-shot 1	A B C D E F	
	Time remaining	3	One-shot ON-delay One-shot 2 Signal ON/OFF-delay 3		
Step 2	Desired Operation	Selection		Remarks	
<p><b>Select a time range that contains the desired period of time.</b></p>	<b>Base Time Ranges</b>	<b>③ Time Range Selector</b>		<p>1. The ③ Time Range Selector controls both the decimal point indicator (9.99, 99.9, 999) and the time increment indicator: S (seconds), M (minutes), and H (hours).</p> <p>2. Choose the base time range which contains the targeted timer setting. Then use the ③ Time Range Selector to set the decimal point indicator and time increment indicator to its corresponding pair of settings.</p> <p>3. Since these configurations offer a complete range of settings from 0.01 seconds to 99.9 hours, the setting of 9.99 for minutes and the 9.99 and 999 settings for hours are not listed and should not be used.</p>	
			<b>Decimal Point Indicator</b>		<b>Time Increment Indicator</b>
	0.01 seconds to 9.99 seconds	9.99	S		
	0.1 seconds to 99.9 seconds	99.9			
	1 seconds to 999 seconds	999			
	0.1 minutes to 99.9 minutes	99.9	M		
1 minute to 999 minutes	999				
0.1 hours to 99.9 hours	99.9	H			
Step 3	Desired Operation	Selection		Remarks	
<p><b>Select the desired period of time by using the ④ Time Setting Digital Switch.</b></p>				<p>Use the ④ Time Setting Digital Switch to set the desired period of time. It is important to remember that the setting of the ③ Time Range Selector determines the units of time measurement as well as the implied decimal point location.</p>	



*It is important to remember that the ③ Time Range Selector not only selects the time range, but also influences the interpretation of the Digital Time Display. Changing the ③ Time Range Selector setting changes the units of time measurement (seconds, minutes, hours) as well as the implied decimal point location.*

## Instructions: Setting GT3D-8 Timers

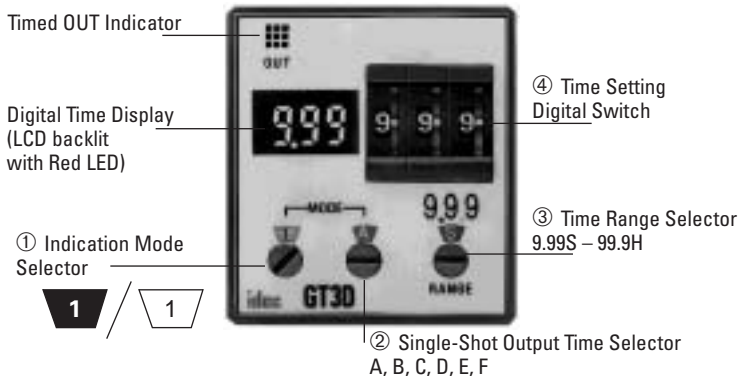

Step 1	Desired Mode of Operation	Selection	Remarks	
<b>Select the time display and operation modes.</b>	<b>Operation Mode</b>	<b>Time Display Mode</b>	<b>① Indicator Mode Selector</b>	
	ON-Delay One-Shot	Time elapsed		
		Time remaining		
	Cycle one-shot	Time elapsed		
		Time remaining		
	ON-delay one-shot 2	Time elapsed		
Time remaining				
<b>Step 2</b>	<b>Desired Mode of Operation</b>	<b>Selection</b>	<b>Remarks</b>	
<b>Select the single shot output time.</b>	<b>Desired Single-Shot Output Time</b>	<b>② Single-Shot Output Time Selector</b>	On the GT3D-8 timers, the desired single-shot output time can be selected from the A, B, C, D, E, and F modes using the ② One-Shot Output Time Selector.	
	0.1 seconds	A		
	0.5 seconds	B		
	1 second	C		
	5 seconds	D		
	10 seconds	E		
	50 seconds	F		
<b>Step 3</b>	<b>Desired Mode of Operation</b>	<b>Selection</b>	<b>Remarks</b>	
<b>Select the time range that contains the desired period of time.</b>	<b>Base Time Ranges</b>	<b>③ Time Range Selector</b>	1. The ③ Time Range Selector controls both the decimal point indicator (9.99, 99.9, 999) and the time increment indicator: S (seconds), M (minutes), and H (hours). 2. Chose which base time range contains the targeted timer setting. Then use the ③ Time Range Selector to set the decimal point indicator and time increment indicator to its corresponding pair of settings. 3. Since these configurations offer a complete range of settings from 0.01s to 99.9 hours, the setting of 9.99 for minutes and the 9.99 and 999 settings for hours are not listed and should not be used.	
	0.01 seconds to 9.99 seconds	9.99		
	0.1 seconds to 99.9 seconds	99.9		
	1 second to 999 seconds	999		
	0.1 minutes to 99.9 minutes	99.9		
	1 minute to 999 minutes	999		
0.1 hours to 99.9 hours	99.9			
<b>Step 4</b>	<b>Desired Mode of Operation</b>	<b>Selection</b>	<b>Remarks</b>	
<b>Select the desired period of time by using the ④ Time Setting Digital Switch.</b>			Use the ④ Time Setting Digital Switch to set the desired period of time. It is important to remember that the setting of the ③ Time Range Selector selects the units of time measurement as well as the implied decimal point location.	

**G Timers**



*It is important to remember that the ③ Time Range Selector not only selects the time range, but also influences the interpretation of the Digital Time Display. Changing the ③ Time Range Selector setting changes the units of time measurement (seconds, minutes, hours) as well as the decimal point location.*

## GT3F Series — True OFF Delay Timers



## Key features of the GT3F series include:

- Mountable in sockets or flush panel
- “True” power OFF-delay up to 10 minutes
- No external control switch necessary
- Available with reset inputs



UL, c-uL Listed  
File No. E55996



	GT3F-1	GT3F-2
<b>Operation</b>	True power OFF-delay	
<b>Time Range</b>	0.05 seconds to 600 seconds	
<b>Rated Voltage</b>	100 to 240V AC, 50/60Hz 24V AC/DC	
<b>Contact Rating</b>	250V AC/30V DC, 5A (resistive load)	250V AC/30V DC, 3A (resistive load)
<b>Contact Form</b>	SPDT	DPDT
<b>Minimum Power Application Time</b>	1 second	
<b>Voltage Tolerance</b>	AF20: 100 to 240V AC AD24: 21.6 to 26.4VDC, 20.4 to 26.4VAC	
<b>Repeat Error</b>	±0.2%, ±10 msec	
<b>Voltage Error</b>	±0.2%, ±10 msec	
<b>Temperature Error</b>	±0.2%, ±10 msec	
<b>Setting Error</b>	±10% maximum	
<b>Insulation Resistance</b>	100MΩ minimum	
<b>Dielectric Strength</b>	Between power and output terminals: 2,000V AC, 1 minute (SPDT) 1,500V AC, 1 minute (DPDT) Between contacts on different poles: 1,000V AC, 1 minute (DPDT) Between contacts of the same pole: 750V AC, 1 minute	
<b>Power Consumption</b>	AF20: 3.7VA (200V AC, 60Hz) AD24: 0.8W (DC), 1.2VA (AC)	
<b>Mechanical Life</b>	20,000,000 operations minimum	
<b>Electrical Life</b>	100,000 operations minimum	
<b>Vibration Resistance</b>	100m/sec <sup>2</sup> (approximate 10G)	
<b>Shock Resistance</b>	Operating extremes: 100 m/sec <sup>2</sup> (approximate 10G) Damage limits: 500 m/sec <sup>2</sup> (approximate 50G)	
<b>Operating Temperature</b>	-10 to +50°C	
<b>Storage Temperature</b>	-30 to +80°C	
<b>Operating Humidity</b>	45 to 85% RH	
<b>Weight (approximate)</b>	77g	79g

## GT3F Table of Contents

Specifications — G-36

Part Number List — G-37

Timing Diagrams/Schematics — G-37

Instructions: Setting Timer — G-39

Instructions: Wiring Inputs — G-40

GT3 Accessories — G-48

GT3 Instructions — G-50

GT3 Dimensions — G-52

Timing Diagrams Overview — G-4



1. An inrush current flows during the minimum power application time. AF20: approximate 0.3A, AD24: approximate 0.6A

2. GT3F does not read the preset time range shown on the knob after power is turned off. Note that minimizing the preset time, by turning the knob to zero, does not shorten the delay time after power is removed.

## Part Numbering List

### Part Numbers: GT3F

Mode of Operation	Rated Voltage Code	Time Range	Output	Contact	Optional Input	Complete Part Number	
						8-Pin	11-Pin
Power OFF-delay	AF20: 100 to 240VAC (50/60Hz)	0.05 seconds to 600 seconds	250V AC, 5A, 30V DC, 5A (resistive load)	Delayed SPDT	Reset	GT3F-1AF20	GT3F-1EAF20
						GT3F-1AD24	GT3F-1EAD24
	AD24: 24V AC/DC		250V AC, 3A, 30V DC, 3A (resistive load)	Delayed DPDT	None (8p) Reset (11p)	GT3F-2AF20	GT3F-2EAF20
						GT3F-2AD24	GT3F-2EAD24



1. Optional reset input resets the contact to the OFF state before time out.


## Timing Diagrams/Schematics

### GT3F-1 Timing Diagrams


GT3F-1 (8-pin)

GT3F-1E (11-pin)

Delayed SPDT Output, with Reset Input

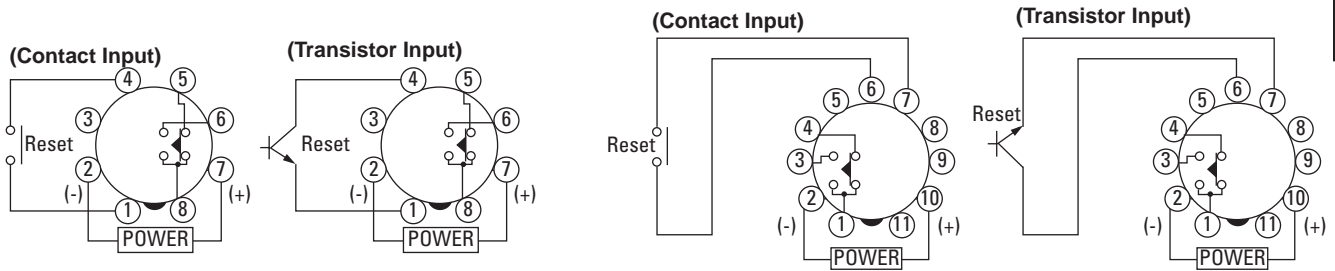

G Timers

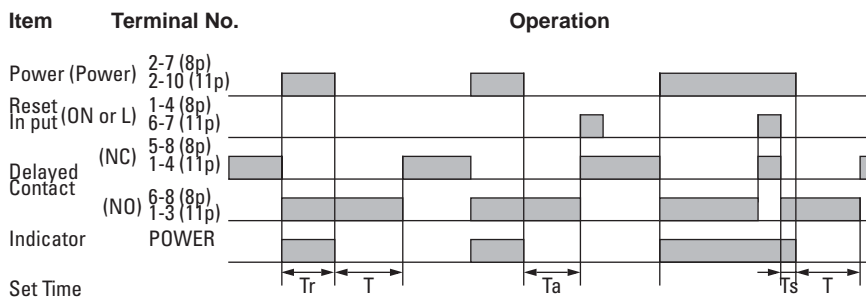

T = Set Time  
 Ta = Shorter than Set Time  
 Ts = 1 Second  
 Tr = Minimum Power Application Time  
 • GT3F-1: 1 Second



- For time ranges, see page G-39.
- For sockets and accessory part numbers, see page G-48.
- When power is applied, the NO output contact closes. When power is removed, the timing period begins. When time has elapsed, the NO contact opens.
- For the timing diagram overview, see page G-4.







**GT3F-2 Timing Diagrams**


**GT3F-2 (8-pin)**

**GT3F-2E (11-pin)**

**Delayed DPDT Output**

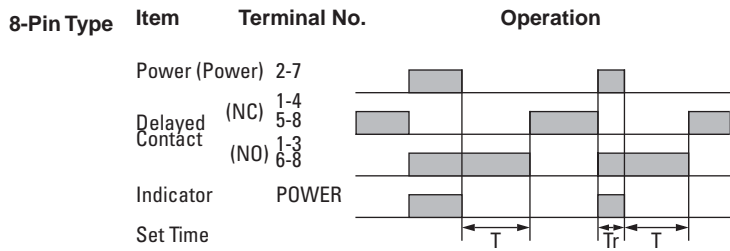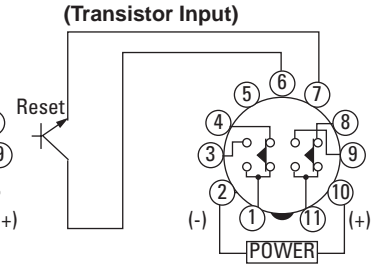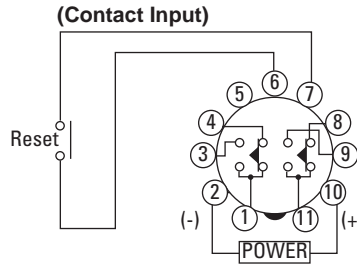

T = Set Time  
Tr = Minimum Power Application Time: 1 Second

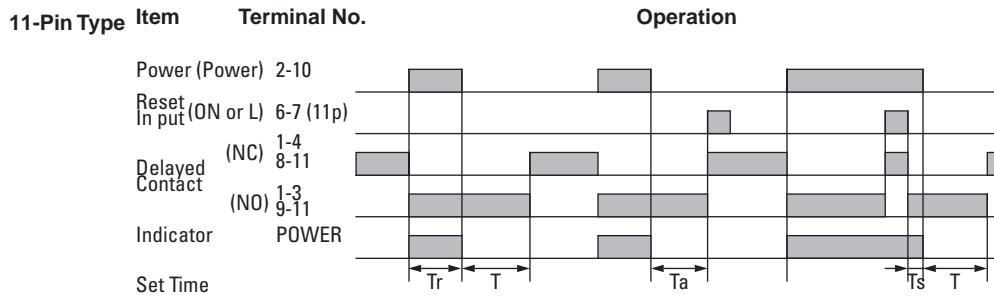


T = Set Time  
Ta = Shorter than Set Time  
Ts = 1 Second  
Tr = Minimum Power Application Time: 1 Second

When power is applied, the NO contact closes. When power is removed, the timing period begins. When time has elapsed, the NO contact opens. Optional reset input will return contacts to original state before time elapses.

**Timers**

**Instructions: Setting GT3F Timers**

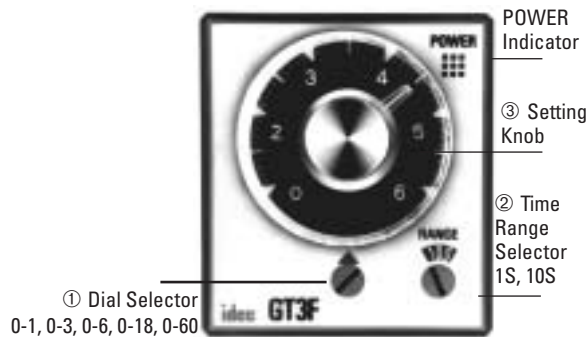


Steps	Desired Operation	Selection		Remarks
<b>1. Select a time range that contains the desired period of time.</b>	<b>Base Time Ranges</b>	<b>① Dial Selector</b>	<b>② Time Range Selector</b>	Time range can be selected from 1S and 10S using a flat screwdriver and five different dials of 0 to 1, 0 to 3, 0 to 6, 0 to 18, and 0 to 60 are displayed in the six windows by turning the Dial Selector, allowing for selecting the best suited scale. Note that the switch does not turn infinitely.
	0.05s to 1s	0 to 1	1S	
	0.05s to 3s	0 to 3		
	0.05s to 6s	0 to 6		
	0.1s to 10s	0 to 1	10S	
	0.3s to 30	0 to 3		
	0.6s to 60	0 to 6		
	1.8s to 180s	0 to 18		
6s to 600s	0 to 60			
<b>2. The set time is selected by turning the ③ Setting Knob.</b>				Setting Examples:  1) When the Setting Knob ③ is set at 2.5, with Dial Selector ① 0 to 3 and Time Range Selector ② 1S selected, then the set time is 2.5 seconds.  2) When the Setting Knob ③ is set at 5.0, with Dial Selector ① 0 to 60 and Time Range Selector ② 10S selected, then the set time is 500 seconds.

**G**  
Timers


## Instructions: Wiring Inputs

**Inputs of GT3F**

To avoid electric shock, do not touch the input signal terminal during power voltage application. Never apply the input signals to two or more GT3F timers using the same contact or transistor.

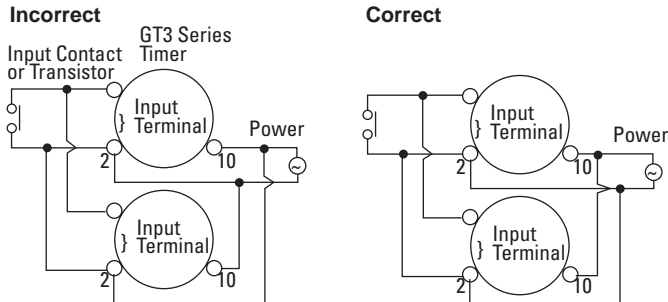

In a transistor circuit for controlling input signals, with its primary and secondary power circuits isolated, do not ground the secondary circuit.

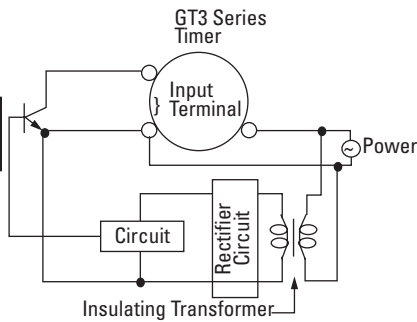


On the GT3F timers, connect the input signals to terminal No.1 and 4 only on the 8-pin type; connect the input signals to terminal No. 6 and 7 only on the 11-pin type. Never apply voltage to other terminals; otherwise, the internal circuit may be damaged.

Input signal lines must be made as short as possible and installed away from power cables and power lines. Use shielded wires or a separate conduit for input wiring.

The GT3F, consisting of a high-impedance circuit, may not be reset due to the influence of an inductive voltage or residual voltage caused by a leakage current. If not reset, connect an RC filter or bleeder resistor between power terminals so that the voltage between power terminals can be reduced to less than 15% of the rated voltage.

**GT3 (Star-Delta) Timers**


**Star-Delta**

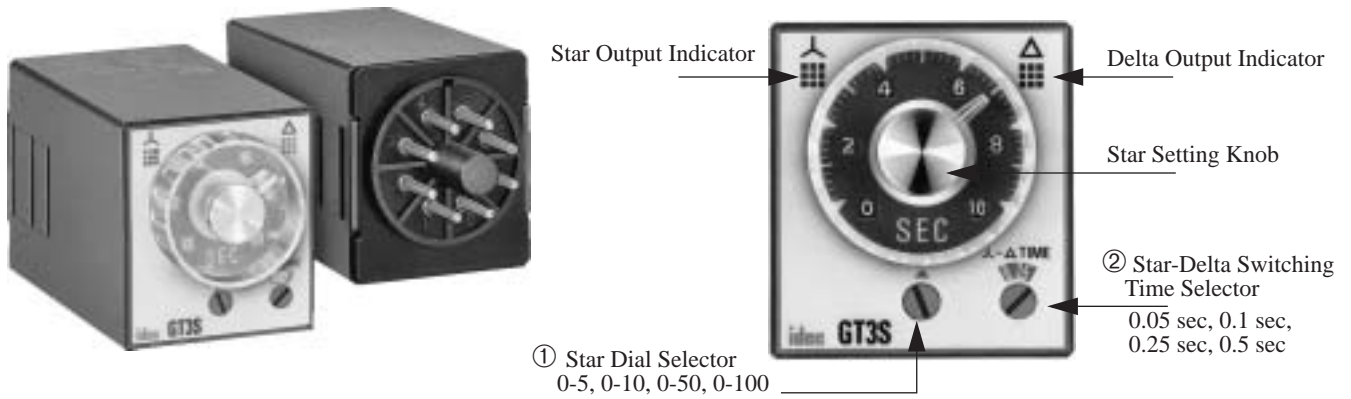

Operation Mode	Rated Input Voltage	Time Range	Output	Contact	Part No.
					8-pin Type
Star-Delta	AF20: 100 to 240V AC (50/60Hz)	Star: 0.05 to 100 sec Star-Delta switching time: 0.05 sec 0.1 sec 0.25 sec 0.5 sec	250V AC/30V DC, 5A (resistive load)	Star: Delayed SPST-NO Delta: Delayed SPST-NO	GT3S-1AF20
				Star: Delayed SPST-NO Delta: Delayed SPST-NO Instantaneous: SPST-NO	GT3S-2AF20

**Time Ranges:**

① Star Dial Selector		② Star-Delta Switching Time Selector
Dial	Time Range	Time
0-5	0.05 sec - 5 sec	0.05 sec
0-10	0.1 sec - 10 sec	0.1 sec
0-50	0.5 sec - 50 sec	0.25 sec
0-100	1 sec - 100 sec	0.5 sec

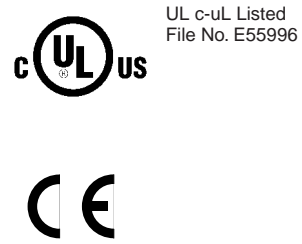

**Contact Ratings:**

Contact Ratings		250V AC/30V DC, 5A (resistive load)
Life	Mechanical	20,000,000 operations minimum
	Electrical	100,000 operations minimum (rated load)



**GT3S Table of Contents**

- Specifications — G-42
- Operation Charts — G-43
- GT3 Accessories — G-48
- GT3 Instructions — G-50
- GT3 Dimensions — G-52
- Timing Diagrams Overview — G-4

## General Specifications

<b>Operation System</b>	Solid state CMOS circuitry	
<b>Operation Type</b>	Star-delta	
<b>Time Range</b>	Star side: 0.05 to 100 sec Star-delta switching time: 0.05, 0.1, 0.25, 0.5 sec	
<b>Rated Operational Voltage</b>	100 to 240V AC (50/60Hz)	
<b>Operating Temperature</b>	-10 to +50°C	
<b>Storage Temperature</b>	-30 to +80°C	
<b>Operating Humidity</b>	45 to 85% RH	
<b>Voltage Tolerance</b>	85 to 264V AC	
<b>Repeat Error</b>	±0.2%, ±10 msec	
<b>Voltage Error</b>	±0.2%, ±10 msec	
<b>Temperature Error</b>	±0.2%, ±10 msec	
<b>Setting Error</b>	±10% maximum	
<b>Reset Time</b>	500 msec maximum	
<b>Insulation Resistance</b>	100MΩ minimum	
<b>Dielectric Strength</b>	Between power and output terminals: 2,000V AC, 1 minute Between contacts of different poles: 2,000V AC, 1 minute Between contacts of the same pole: 750V AC, 1 minute	
<b>Vibration Resistance</b>	100 m/sec <sup>2</sup> (Approx. 10G)	
<b>Shock Resistance</b>	Operating extremes: 100m/sec <sup>2</sup> (Approx. 10G) Damage limits: 500m/sec <sup>2</sup> (Approx. 50G)	
<b>Power Consumption (Approx.)</b>	<b>Type GT3S-1</b>	3.0VA (100V AC, 60Hz), 10.4VA (200V AC, 60Hz)
	<b>Type GT3S-2</b>	4.0VA (100V AC, 60Hz), 12.0VA (200V AC, 60Hz)

## Operation Charts

Product Series	Internal Connection & Terminal Arrangement	Operation Chart																							
<b>GT3S-1</b> Star: Delayed SPST-NO Delta: Delayed SPST-NO	(8-pin Type)  5-8: Star contact 6-8: Delta contact	<table border="1"> <thead> <tr> <th>Item</th> <th>Terminal No.</th> <th>Operation</th> </tr> </thead> <tbody> <tr> <td>Power</td> <td>2-7 (8p) : (POWER)</td> <td></td> </tr> <tr> <td>Star Delayed Contact</td> <td>5-8 (8p) (NO)</td> <td></td> </tr> <tr> <td>Delta Delayed Contact</td> <td>6-8 (8p) (NO)</td> <td></td> </tr> <tr> <td rowspan="2">Indicator</td> <td>Star</td> <td></td> </tr> <tr> <td>Delta</td> <td></td> </tr> <tr> <td>Set Time</td> <td></td> <td></td> </tr> </tbody> </table> <p>                     •The star delayed contact goes on when power is turned on and goes off after a set time for the star contact (<math>T_1</math>). The delta delayed contact goes on after star-delta switching time (<math>T_2</math>) and goes off when power is turned off.  <math>T_1</math> = Star ON time (Set Time), <math>T_2</math> = Star-delta switching time, <math>T_3</math> = Delta ON time                 </p>	Item	Terminal No.	Operation	Power	2-7 (8p) : (POWER)		Star Delayed Contact	5-8 (8p) (NO)		Delta Delayed Contact	6-8 (8p) (NO)		Indicator	Star		Delta		Set Time					
Item	Terminal No.	Operation																							
Power	2-7 (8p) : (POWER)																								
Star Delayed Contact	5-8 (8p) (NO)																								
Delta Delayed Contact	6-8 (8p) (NO)																								
Indicator	Star																								
	Delta																								
Set Time																									
<b>GT3S-2</b> Star: Delayed SPST-NO Delta: Delayed SPST-NO Instantaneous SPST-NO	(8-pin Type)  5-8: Star contact 6-8: Delta contact	<table border="1"> <thead> <tr> <th>Item</th> <th>Terminal No.</th> <th>Operation</th> </tr> </thead> <tbody> <tr> <td>Power</td> <td>2-7 (8p) (POWER)</td> <td></td> </tr> <tr> <td>Star Delayed Contact</td> <td>5-8 (8p) (NO)</td> <td></td> </tr> <tr> <td>Delta Delayed Contact</td> <td>6-8 (8p) (NO)</td> <td></td> </tr> <tr> <td>Instantaneous Contact</td> <td>1-3 (8p) (NO)</td> <td></td> </tr> <tr> <td rowspan="2">Indicator</td> <td>Star</td> <td></td> </tr> <tr> <td>Delta</td> <td></td> </tr> <tr> <td>Set Time</td> <td></td> <td></td> </tr> </tbody> </table> <p>                     •The star delayed contact goes on when power is turned on and goes off after a set time for the star contact (<math>T_1</math>). The delta delayed contact goes on after star-delta switching time (<math>T_2</math>) and goes off when power is turned off.                      •The instantaneous contact goes on when power is turned on and goes off when power is turned off.  <math>T_1</math> = Star ON time (Set Time), <math>T_2</math> = Star-delta switching time, <math>T_3</math> = Delta ON time                 </p>	Item	Terminal No.	Operation	Power	2-7 (8p) (POWER)		Star Delayed Contact	5-8 (8p) (NO)		Delta Delayed Contact	6-8 (8p) (NO)		Instantaneous Contact	1-3 (8p) (NO)		Indicator	Star		Delta		Set Time		
Item	Terminal No.	Operation																							
Power	2-7 (8p) (POWER)																								
Star Delayed Contact	5-8 (8p) (NO)																								
Delta Delayed Contact	6-8 (8p) (NO)																								
Instantaneous Contact	1-3 (8p) (NO)																								
Indicator	Star																								
	Delta																								
Set Time																									

**GT3W Series — Dual Time Range Timers**



**Key features of the GT3W series include:**

- Sequential start, sequential interval, on-delay, recycler, and interval ON timing functions
- 2 time settings in one timer
- 8 selectable operation modes on each model
- Mountable in sockets or flush panel
- Power and output status indicating LEDs
- Time ranges up to 300 hours



c-uL Listed  
UL Listed  
File No.E55996



Timers

General Specifications	
<b>Operation System</b>	Solid state CMOS Circuit
<b>Operation Type</b>	Multi-Mode
<b>Time Range</b>	1: 0.1sec to 6hours, 3: 0.1sec to 300hours
<b>Pollution Degree</b>	2 (IE60664-1)
<b>Over voltage category</b>	III (IE60664-1)
<b>Rated Operational Voltage</b>	AF20 100-240V AC(50/60Hz) AD24 24V AC(50/60Hz)/24V DC D12 12V DC
<b>Voltage Tolerance</b>	AF20 85-264V AC(50/60Hz) AD24 20.4-26.4V AC(50/60Hz)/21.6-26.4V DC D12 10.8-13.2V DC
<b>Disengaging value of Input Voltage</b>	Rated Voltage x10% minimum
<b>Range of Ambient Operating Temperature</b>	-10 to +50°C (without freezing)
<b>Range of Ambient Storage and Transport Temperature</b>	-30 to +75°C (without freezing)
<b>Range of Relative Humidity</b>	35 to 85%RH (without condensation)
<b>Atmospheric Pressure</b>	80kPa to 110kPa (Operating), 70kPa to 110kPa (Transport)
<b>Reset Time</b>	60msec maximum
<b>Repeat Error</b>	±0.2%, ±10msec*
<b>Voltage Error</b>	±0.2%, ±10msec*
<b>Temperature Error</b>	±0.6%, ±10msec*
<b>Setting Error</b>	±10% maximum
<b>Insulation Resistance</b>	100MΩ minimum (500V DC)
<b>Dielectric Strength</b>	Between power and output terminals: 2000V AC, 1 minute Between contacts of different poles: 2000V AC, 1 minute Between contacts of the same pole:750V AC, 1 minute
<b>Vibration Resistance</b>	10 to 55Hz amplitude 0.75mm2 hours in each of 3 axes
<b>Shock Resistance</b>	Operating extremes: 98m/sec <sup>2</sup> (approx.10G) Damage limits: 490m/sec <sup>2</sup> (approx. 50G) 3 times in each of 3 axes
<b>Degree of Protection</b>	IP40 (enclosure), IP20 (socket) (IEC60529)
<b>Power Consumption (Approx.)</b>	AF20 100V AC/60Hz 2.3VA 200V AC/60Hz 4.6VA AD24 (AC/DC) 1.8VA/0.9W
<b>Mounting Position</b>	Free
<b>Dimensions</b>	40Hx 36W x 70 mm
<b>Weight (Approx.)</b>	72g

Contact Ratings	
<b>Allowable Contact Power</b>	960VA/120W
<b>Allowable Voltage</b>	250V AC/150V DC
<b>Allowable Current</b>	5A
<b>Maximum permissible operating frequency</b>	1800 cycles per hour
<b>Rated Load</b>	1/8HP, 240V AC 3A, 240V AC (Resistive) 5A, 120V AC/30V DC (Resistive)
<b>Conditional Short Circuit</b>	Fuse 5A, 250V
<b>Life</b>	Electrical 100,000 op. minimum (Resistive) Mechanical 20,000,000 op. minimum

**GT3W Table of Contents**

- Specifications — G-44
- Part Number List — G-45
- Timing Diagrams / Schematics — G-46
- Instructions: Setting Timer — G-47
- GT3 Accessories — G-48
- GT3 Instructions — G-50
- GT3 Dimensions — G-52
- Timing Diagrams Overview — G-4



\*\* For the value of the error against a preset time, whichever the largest.

## Part Number List

### Part Numbers

Mode of Operation	Output	Contact	Time Range*	Rated Voltage	Pin Configuration	New Part Numbers
A: Sequential Start B: On-delay with course & fine C: Recycler & instantaneous D: Recycler outputs (OFF Start) E: Recycler outputs (ON Start) F: Interval ON G: Interval ON Delay H: Sequential Interval	3A, 240V AC	Delayed SPDT + Delayed SPDT	1: 0.1sec - 6 hours  *(See Time Range Settings for details.)	100 to 240V AC (50/60Hz)	8 pin	GT3W-A11AF20N
					11 pin	GT3W-A11EAF20N
				24V AC/DC	8 pin	GT3W-A11AD24N
					11 pin	GT3W-A11EAD24N
	5A, 120V AC/30V DC (Resistive Load)		12V DC	8 pin	GT3W-A11D12N	
				11 pin	GT3W-A11ED12N	
	100 to 240V AC (50/60Hz)		8 pin	GT3W-A33AF20N		
				24V AC/DC	GT3W-A33AD24N	
3: 0.1sec - 300 hours						



1. For schematics, see page G-46.
2. For socket and accessory part number information, see page G-48.
3. 8- and 11-pin models differ only in the number of pins (extra pins are not used).
4. For the timing diagram overview, see page G-4.
5. \*For details on setting time ranges, see the instructions on page G-47.





## Time Range Table

Time Range Code: 1			Time Range Code: 3		
Time Range Selector	Scale	Time Range	Time Range Selector	Scale	Time Range
1S	0-1	0.1 sec - 1 sec	1S	0 - 3	0.1 sec - 3 sec
10S		0.3 sec - 10 sec	1M		3 sec - 3 min
10M		15 sec - 10 min	1H		3 min - 3 hours
1S	0 - 6	0.1 sec - 6 sec	1S	0 - 30	0.6 sec - 30 sec
10S		1 sec - 60 sec	1M		36 sec - 30 min
1M		6 sec - 6 min	1H		36min - 30 hours
10M		1 min - 60 min	10H		6 hours - 300 hours
1H		6 min - 6 hours			




Timing Diagrams/Schematics



MODE	Operation chart			MODE	Operation chart		
A : Sequential Start	Item	Terminal No.	Operation	E : Recycler outputs (ON Start)	Item	Terminal No.	Operation
	Power	2-7(8p) 2-10(11p)	[Timing diagram showing power pulse]		Power	2-7(8p) 2-10(11p)	[Timing diagram showing power pulse]
B : On-delay with course and fine	Delayed Contact Ry1	1-4(8p) 1-4(11p) (NC) 1-3(8p) 1-3(11p) (NO)	[Timing diagram showing Ry1 output]	F : Interval ON	Delayed Contact Ry1	1-4(8p) 1-4(11p) (NC) 1-3(8p) 1-3(11p) (NO)	[Timing diagram showing Ry1 output]
	Delayed Contact Ry2	5-8(8p) 8-11(11p) (NC) 6-8(8p) 9-11(11p) (NO)	[Timing diagram showing Ry2 output]		Delayed Contact Ry2	5-8(8p) 8-11(11p) (NC) 6-8(8p) 9-11(11p) (NO)	[Timing diagram showing Ry2 output]
C : Recycler and instantaneous	Indicator	OUT1 OUT2	[Timing diagram showing OUT1 and OUT2]	G : Interval ON Delay	Indicator	OUT1 OUT2	[Timing diagram showing OUT1 and OUT2]
	Set Time		T1 T2		Set Time		T1 T2
D : Recycler outputs (OFF Start)	Indicator	OUT1 OUT2	[Timing diagram showing OUT1 and OUT2]	H : Sequential Interval	Indicator	OUT1 OUT2	[Timing diagram showing OUT1 and OUT2]
	Set Time		T1 T2 T1 T2		Set Time		T1 T2

Timers

## Instructions: Setting GT3W Timer

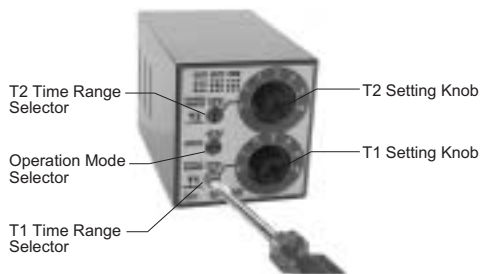

1. The switches should be securely turned using a flat screwdriver 4mm wide (maximum). Note that incorrect setting may cause malfunction. The switches, which do not turn infinitely, should not be turned beyond their limits.
2. Since changing the setting during timer operation may cause malfunction, turn power off before changing.

## Safety Precautions

Special expertise is required to use Electronic Timers.

- All Electronic Timer modules are manufactured under IDEC's rigorous quality control system, but users must add a backup or fail safe provision to the control system when using the Electronic Timer in applications where heavy damage or personal injury may occur should the Electronic Timer fail.
- Install the Electronic Timer according to instructions described in this catalog.
- Make sure that the operating conditions are as described in the specifications. If you are uncertain about the specifications, contact IDEC in advance.
- In these directions, safety precautions are categorized in order of importance to Warning and Caution.

### Warning

Warning notices are used to emphasize that improper operation may cause severe personal injury or death.

- Turn power off to the Electronic timer before starting installation, removal, Wiring, maintenance, and inspection on the Electronic Timer.
- Failure to turn power off may cause electrical shocks or fire hazard.
- Emergency stop and interlocking circuits must be configured outside the Electronic timer. If such a circuit is configured inside the Electronic Timer, failure of the Electronic timer may cause malfunction of the control system, or an accident.

### Caution

Caution notices are used where inattention might cause personal injury or damage to equipment.

- The Electronic Timer is designed for installation in equipment. Do not install the Electronic Timer outside equipment.
- Install the Electronic Timer in environments described in the specifications. If the Electronic Timer is used in places where it will be subjected to high-temperature, high-humidity, condensation, corrosive gases, excessive vibrations, or excessive shocks, then electrical shocks, fire hazard, or malfunction could result.
- Use an IEC60127-approved fuse and circuit breaker on the power and output line outside the Electronic Timer.
- Do not disassemble, repair, or modify the Electronic Timer.
- When disposing of the Electronic Timer, do so as industrial waste.

Accessories: GT3 Series



DIN Rail Mounting Accessories

Part Numbers: DIN Rail/Surface Mount Sockets and Hold-Down Springs


DIN Rail Mount Socket				Applicable Hold-Down Springs	
Style	Appearance	Use with Timers	Part No.	Appearance	Part No.
8-Pin Screw Terminal (dual tier)		GT3A-1, 2, 3 (8-pin) GT3D-1, 2, 3 (8-pin) GT3F-1, 2 (8-pin) GT3W (8-pin) GT3S	SR2P-05		SFA-203
11-Pin Screw Terminal (dual tier)		GT3A-1, 2, 3 (11-pin) GT3A-4, 5, 6 GT3D-1, 2, 3 (11-pin) GT3D-4, 8 GT3F-1, 2 (11-pin) GT3W (11-pin)	SR3P-05		
8-Pin Fingersafe Socket		GT3A-1, 2, 3 (8-pin) GT3D-1, 2, 3 (8-pin) GT3F-1, 2 (8-pin) GT3W (8-pin) GT3S	SR2P-05C		
11-Pin Fingersafe Socket		GT3A-1, 2, 3 (11-pin) GT3A-4, 5, 6 GT3D-1, 2, 3 (11-pin) GT3D-4, 8 GT3F-1, 2 (11-pin) GT3W (11-pin)	SR3P-05C		SFA-202
8-Pin Screw Terminal		GT3A-1, 2, 3 (8-pin) GT3D-1, 2, 3 (8-pin) GT3F-1, 2 (8-pin) GT3W (8-pin) GT3S	SR2P-06		
11-Pin Screw Terminal		GT3A-1, 2, 3 (11-pin) GT3A-4, 5, 6 GT3D-1, 2, 3 (11-pin) GT3D-4, 8 GT3F-1, 2 (11-pin) GT3W (11-pin)	SR3P-06		
DIN Mounting Rail Length 1000mm		—	BNDN1000		

Installation of Hold-Down Springs

DIN Rail Mount Socket

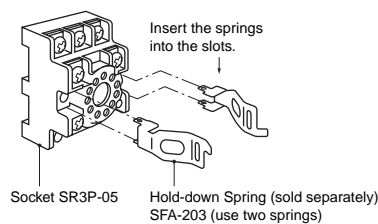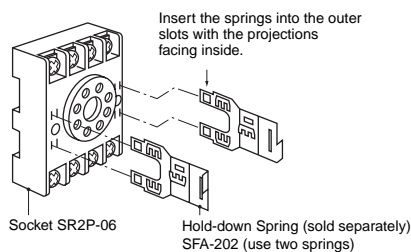




Panel Mount Socket



**Panel Mounting Accessories**





**Part Numbers: Panel Mount Sockets and Hold-Down Springs**

Panel Mount Socket				Applicable HD Springs	
Style	Appearance	Use with Timers	Part No.	Appearance	Part No.
8-Pin Solder Terminal		GT3A- (8-pin) GT3D- (8-pin) GT3W- (8-pin) GT3F- (8-pin) GT3S	SR2P-51		SFA-402
11-Pin Solder Terminal		GT3A- (11-pin) GT3D- (11-pin) GT3W- (11-pin) GT3F- (11-pin)	SR3P-51		



1. For information on installing the hold-down springs, see page G-48.

**Part Numbers: Flush Panel Mount Adapter and Sockets that use an Adapter**

Accessory	Description	Appearance	Use with Timers	Part No.
<b>Panel Mount Adapter</b>	Adaptor for flush panel mounting GT3 timers		All GT3 timers	RTB-G01
<b>Sockets for use with Panel Mount Adapter</b>	8-pin screw terminal	 (Shown: SR6P-M08G for Wiring Socket Adapter)	All 8-pin timers	SR6P-M08G
	11-pin screw terminal		All 11-pin timers	SR6P-M11G
	8-pin solder terminal		All 8-pin timers	SR6P-S08
	11-pin solder terminal		All 11-pin timers	SR6P-S11




2. No hold down springs are available for flush panel mounting.

**Instructions: Wiring Inputs for GT3 Series**

**Inputs**

To avoid electric shock, do not touch the input signal terminal during power voltage application.


When connecting the input signal terminals of two or more GT3A timers to the same contact or transistor, the input terminals of the same number should be connected. (Connect Terminals No.2 in common.)

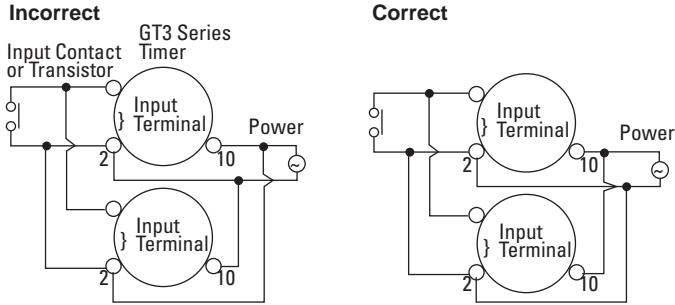


In a transistor circuit for controlling input signals, with its primary and secondary power circuits isolated, do not ground the secondary circuit.



Timers

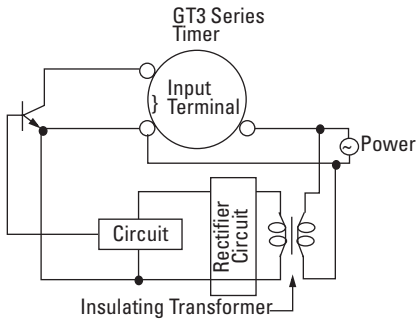


Connect the input signal terminals of the GT3A timers to Terminal No.2 only. Never apply voltage to other terminals; otherwise, the internal circuit may be damaged.

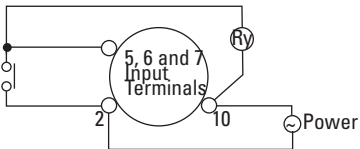


Input signal lines must be made as short as possible and installed away from power cables and power lines. Use shielded wires or a separate conduit for input wiring.

## Inputs Instructions: continued

For contact input, use highly reliable gold-plated contacts to make sure that the residual voltage is less than 1V when the contacts are closed.

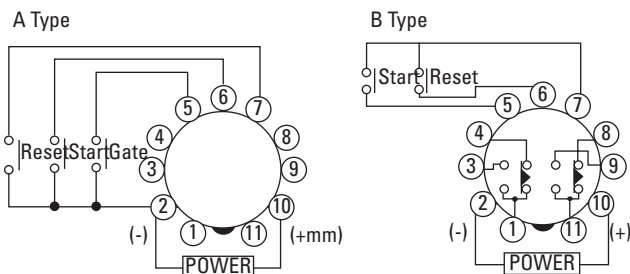


For transistor input, use transistors with the following specifications;  $V_{CE} = 40V$ ,  $V_{CES} = 1V$  or less,  $I_C = 50\text{ mA}$  or more, and  $I_{CBO} = 50\mu A$  or less. The resistance should be less than  $1k\Omega$  when the transistor is on. When the output transistor switches on, a signal is input to the timer.

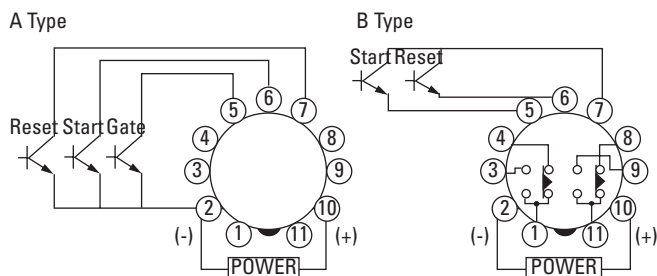

### Inputs: GT3A-1, -2, -3

Transistor output equipment such as proximity switches and photoelectric switches can input signals if they are voltage/current output type, with power voltage ranges from 18 to 30V and have 1V. When the signal voltage switches from H to L, a signal is input to the timer.


Transistor Output Circuit



### Inputs: GT3A-4, -5, -6


<b>Start Input</b>	The start input initiates a time-delay operation and controls output status.	No-voltage contact inputs and NPN open collector transistor inputs are applicable. 24V DC, 1mA maximum
<b>Reset Input</b>	When the reset input is activated, the time is reset, and contacts return to original state.	
<b>Gate Input</b>	The time-delay operation is suspended while the gate input is on (pause).	Input response time: 50msec maximum

**Dimensions: GT3 Series**

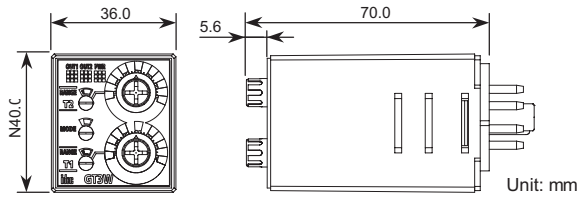


NOTE: GT3W series are UL Listed when used in combination with following IDEC's sockets:  
 GT3W-A11, A33: SR2P-06\* pin type socket.  
 GT3W-A11E, A33: SR3P-05\* pin type socket.  
 (\*-May be followed by A,B,C or U)  
 The socket to be used with these timers are rated:  
 -Conductor Temperature Rating 60°C min.  
 -Use 14AWG max.(2mm<sup>2</sup>max.) Copper conductors only  
 -Terminal Torque 1.0 to 1.3 N-m


**Analog GT3 Timer, 8-Pin with SR2P-06**

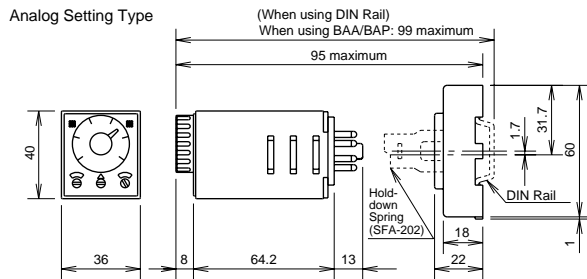


**Analog GT3 Timer, 11-Pin with SR3P-06**

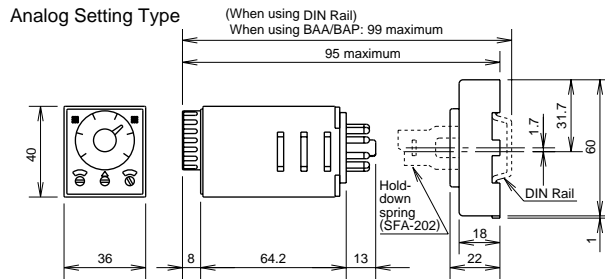


**Digital GT3 Timer, 8-Pin with SR2P-06**

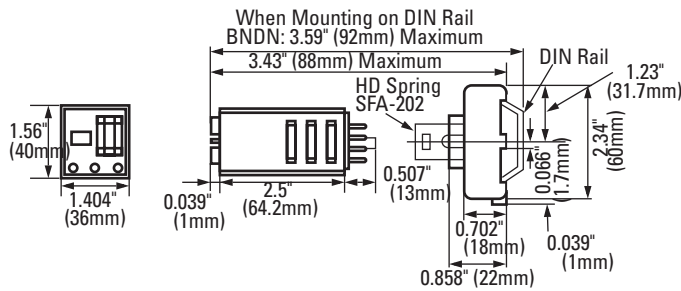


**Digital GT3 Timer, 11-Pin with SR3P-06**

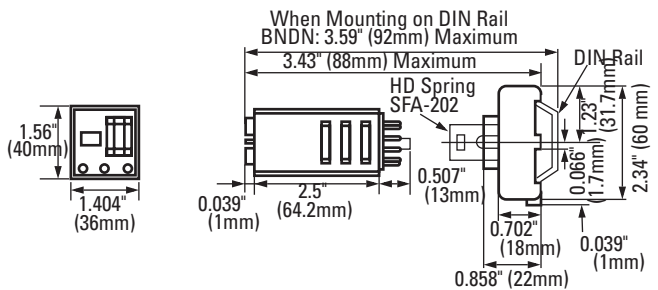

**Analog GT3 Timer, 11-Pin with SR3P-05**

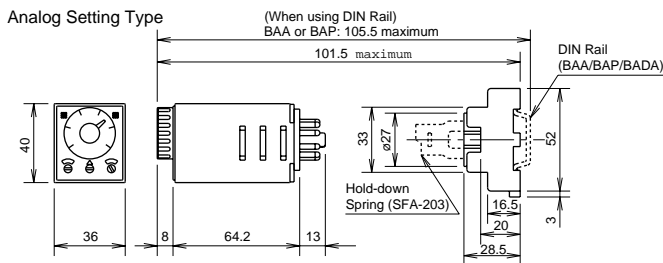


**Digital GT3 Timer, 11-Pin with SR3P-05**

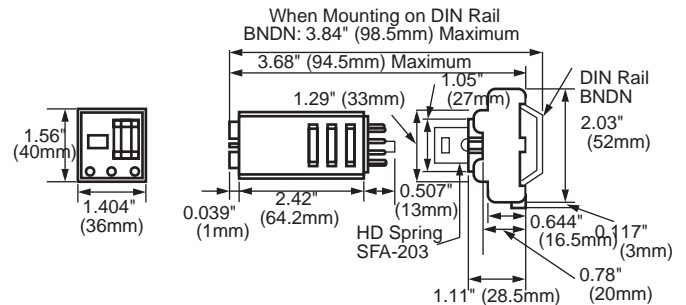


**Panel Mount Adapter**


**Analog GT3 Timer, 8-Pin and 11-Pin with SR6P-S08 or SR6P-S11**

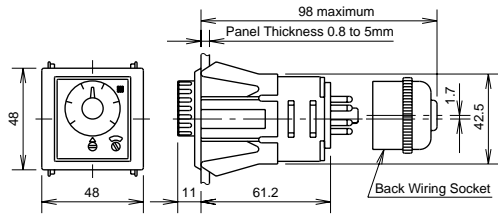


**Digital GT3 Timer, 8-Pin and 11-Pin with SR6P-S08 or SR6P-S11**

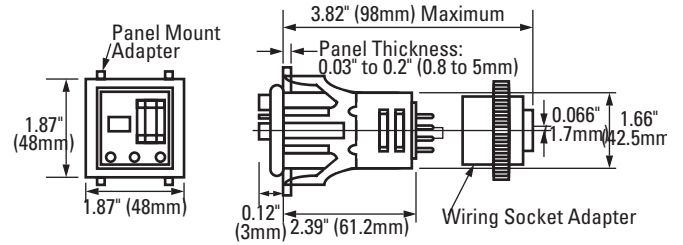


**Mounting Hole Layout**

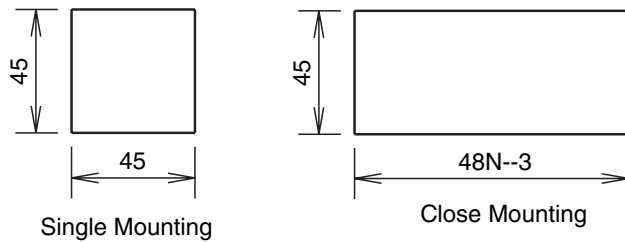

**Analog and Digital GT3 Timer, 8-Pin with SR6P-M08G**

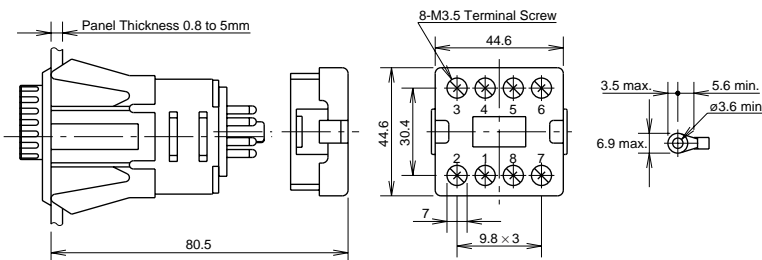

**Analog and Digital GT3 Timer, 11-Pin with SR6P-M11G**

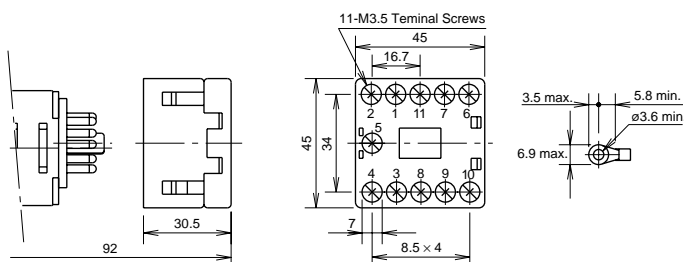



## General Instructions for All Timer Series

### Load Current

With inductive, capacitive, and incandescent lamp loads, inrush current more than 10 times the rated current may cause welded contacts and other undesired effects. The inrush current and steady-state current must be taken into consideration when specifying a timer.

### Contact Protection

Switching an inductive load generates a counter-electromotive force (back EMF) in the coil. The back EMF will cause arcing, which may shorten the contact life and cause imperfect contact. Application of a protection circuit is recommended to safeguard the contacts.

### Temperature and Humidity

Use the timer within the operating temperature and operating humidity ranges and prevent freezing or condensation. After the timer has been stored below its operating temperature, leave the timer at room temperature for a sufficient period of time to allow it to return to operating temperatures before use.

### Environment

Avoid contact between the timer and sulfurous or ammonia gases, organic solvents (alcohol, benzene, thinner, etc.), strong alkaline substances, or strong acids. Do not use the timer in an environment where such substances are prevalent. Do not allow water to run or splash on the timer.

### Vibration and Shock

Excessive vibration or shocks can cause the output contacts to bounce, the timer should be used only within the operating extremes for vibration and shock resistance. In applications with significant vibration or shock, use of hold down springs or clips is recommended to secure a timer to its socket.

### Time Setting

The time range is calibrated at its maximum time scale; so it is desirable to use the timer at a setting as close to its maximum time scale as possible. For a more accurate time delay, adjust the control knob by measuring the operating time with a watch before application.

### Input Contacts

Use mechanical contact switch or relay to supply power to the timer. When driving the timer with a solid-state output device (such as a two-wire proximity switch, photoelectric switch, or solid-state relay), malfunction may be caused by leakage current from the solid-state device. Since AC types comprise a capacitive load, the SSR dielectric strength should be two or more times the power voltage when switching the timer power using an SSR.

Generally, it is desirable to use mechanical contacts whenever possible to apply power to a timer or its signal inputs. When using solid state devices, be cautious of inrushes and back-EMF that may exceed the ratings on such devices. Some timers are specially designed so that signal inputs switch at a lower voltage than is used to power the timer (models designated as "B" type).

## Timing Accuracy Formulas

Timing accuracies are calculated from the following formulas:

$$\text{Repeat Error} = \pm \frac{1}{2} \times \frac{\text{Maximum Measured Value} - \text{Minimum Measured Value}}{\text{Maximum Scale Value}} \times 100\%$$

$$\text{Voltage Error} = \pm \frac{T_v - T_r}{T_r} \times 100\%$$

$T_v$ : Average of measured values at voltage V  
 $T_r$ : Average of measured values at the rated voltage

$$\text{Temperature Error} = \pm \frac{T_t - T_{20}}{T_{20}} \times 100\%$$

$T_t$ : Average of measured values at °C  
 $T_{20}$ : Average of measured values at 20°C

$$\text{Setting Error} = \pm \frac{\text{Average of Measured Values} - \text{Set Value}}{\text{Maximum Scale Value}} \times 100\%$$