

for INSTALLATION OPERATION and MAINTENANCE

The right to make engineering refinements on all products is reserved. Dimensions and other details are subject to change.

VARIABLE TRANSFORMERS

10C, 10C-40 and 12C Series





28 SPRING LANE • SUITE 3 • FARMINGTON, CT 06032 USA

www.superiorelectric.com ECN 96200

002105-280 REV G

Telephone and Fax Numbers

860-507-2025 Telephone Fax 860-507-2050 860-507-2025, Ext. 70782 **Customer Service** Product Application 860-507-2025, Ext. 72058 Toll-Free (in USA and Canada only) Printed in USA

1-800-787-3532 Telephone Fax 1-800-821-1369

1-800-787-3532, Ext. 70782 **Customer Service Product Application** 1-800-787-3532, Ext. 72058

INSPECTION

Your new POWERSTAT Variable Transformer has been carefully packed for shipment. However, damage may occur in transit. After receiving a unit, check all components (brush contact primarily) to satisfy yourself that there is no damage. Also make sure that the dial, knob, lock-washer and mounting nuts are in the package. The "Damage and Shortage" Instructions packed with the unit outline the proper procedure to follow if any parts are damaged or missing.

INSTALLATION

POWERSTAT Variable Transformers of the 10C, 10C-40 and 12C Series are designed for mounting in the back-of-panel position only.

Single Units

The single hole mounting of single units is fast and simple. For keying to the panel, a 1/16 inch projection is provided. To facilitate mounting, a drilling template is supplied as part of these instructions. Actually, the drilling template must be used only when the hole for the 1/16 inch projection is required.

To mount, proceed as follows:

- 1. Using the drilling template, locate the panel holes. In order for the terminals to be on top, the template should be upright. Drill the
- 2. Mount the POWERSTAT Variable Transformer as shown. Mount the unit flush to the back of the panel and the dial flush to the front. A single nut and lockwasher hold the unit and dial in place. The knob, when mounted on the shaft, covers the nut and lockwasher.
- 3. If the unit is not to be keyed to the panel, only the hole for the 3/8 inch center shaft should be drilled. The extra nut provided is placed on the shaft between the unit and the back of the panel. Otherwise the mounting is as explained above.

Ganged Assemblies

Ganged units require four panel holes for mounting. Three are needed for the mounting bolts and a clearance hole is necessary for the center


To mount, proceed as follows:

- 1. Using the drilling template, locate the four panel holes. If the template is upright the terminals will not be directly on top. When terminals are required at the top, line marked "T" should be vertical. Drill the holes.
- 2. Mount the unit behind the panel as shown using the three 1/4"-20 mounting bolts provided. Mount the dial on the front panel, securing it in place with the 3/8" -32 nut and lockwasher provided. The knob, when mounted on the shaft covers the nut and lockwasher

PANEL DRILLING TEMPLATE

(Viewed from Knob End)

Single Units

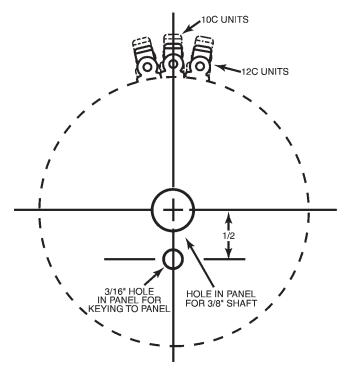

MAINTENANCE

When installed and operated in accordance with these instructions, a POWERSTAT Variable Transformer should require no servicing except possible replacement of the brush assembly. The brushes should be inspected periodically and replaced if arcing takes place or if they are badly worn. Use only the correct Superior Electric replacement brush assembly. The brushes must be of a special material if proper operation is to be attained.

REPLACEMENT BRUSH **ASSEMBLIES**

TYPE	PART NO.	DESCRIPTION
10C	030098-001	RB10C/RB10B
10C-40	030098-004	RB10C-40/RB10B-40
12C	030098-001	RB12C

Note: 10C and 12C Replacement Brush Assembly are the same.

Whenever unusual mechanical or electrical difficulties are encountered in the installation or operation of your POWERSTAT Variable Transformer, consult Superior Electric.

CONNECTIONS AND RATINGS


Important connection notes. Please read carefully.

POWERSTAT Variable Transformers of the 10C, 10C-40 and 12C Series may be connected to suit various requirements as shown in the RATINGS CHART. The individual units in types 10C-40-2 and 10C-40-3 are not electrically interconnected but are independently wired following the type 10C-40 connections. Under "KNOB ROTATION", rotating the knob in the direction indicated will INCREASE the output voltage. The dial is marked for clockwise rotation only.

- Jumper provided in standard common position should be moved or removed as required.
- 10C type ratings are when unit(s) are mounted on a metal panel. When mounted on a bracket or nonmetallic panel, derate to 1.75 amperes for Constant Current Load and 2.5 amperes for Constant Impedance Load.
- 12C type ratings are when unit(s) are mounted on a metal panel. When mounted on a bracket or nonmetallic panel, derate to 0.5 amperes for Constant Current Load and 0.75 amperes for Constant Impedance Load.
- Fuses are recommended (not supplied) on all units as shown (§).
- COMMON shown in the CONNECTION DIAGRAMS is used as third leg in 3-phase open delta, or neutral in single-phase 3-wire and 3-phase 4-wire wye configurations. COMMON is not used in single-phase 2-wire or 3-phase 3-wire wye configurations. Jumper(s) provided in standard common position should be moved or removed as


RATINGS CHART 40 VOLT, SINGLE PHASE







CONNECTION **DIAGRAMS**

(Viewed from Knob End)





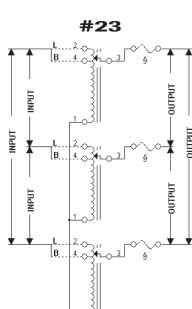

COMMON

IN PANEL AT 120°

FOR 1/4" - .20 BOLTS

#22 OUTPUT INPUT COMMON TUTTUC

PANEL DRILLING TEMPLATE

(Viewed from Knob End) Ganged Assemblies 10C UNITS 12C UNITS 65° 1-1_{1/16} R. 5/8" HOLE IN PANEL TO CLEAR SHAFT AND NUT 3 HOLES