


Compact, Resistant to Mutual Interference, and Ideal for Picking a Variety of Parts.

- Mounts to a parts rack and uses indicators to show parts picking procedures. Functions as a mistake-proofing Sensor.
- Models with direct UNI-WIRE connection are also available.
- Use either the built-in LED indicators or external picking indicators.

 Be sure to read *Safety Precautions* on page 8.




Features

Sensing Distance of 3 m

Selectable Display Mode: All Lighting, All Flashing, Elevator-like Lighting, Accordion-like Lighting

- Six picking indicators provide very clear displays.
- Selectable display speed (slow/fast)

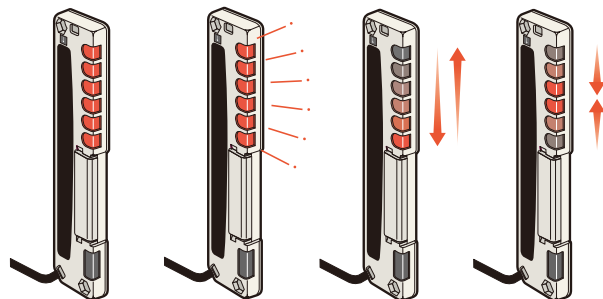


External Picking Indicators Can Be Connected

An external indicator can be directly connected to the Picking Sensor and mounted in an easy-to-see location.



Models with Direct UNI-WIRE Connection Enable Simplification of the Picking System Wiring

Up to 64 Picking Sensors can be connected to a single UNI-WIRE Interface Unit.

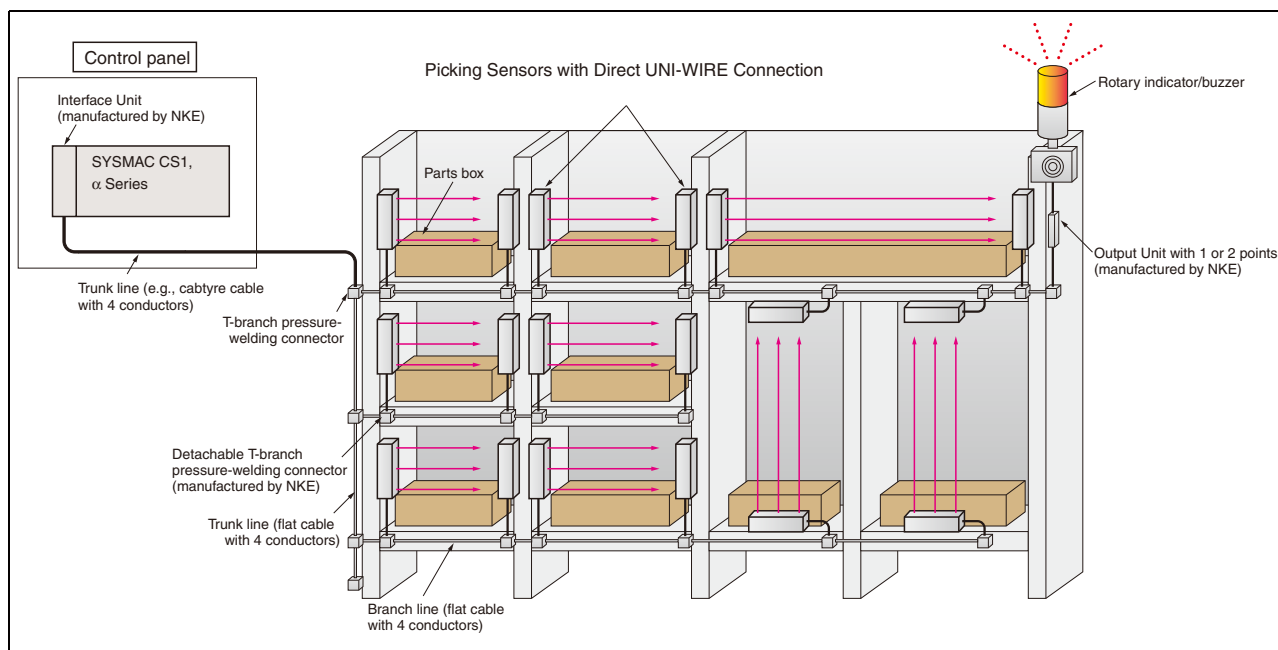

Ordering Information

Sensors

Infrared LED

Sensing method	Appearance	Connection method (cable length)	Sensing distance	Beams		Sensing width (mm)	Output type	External indicator	Model
				Gap	Qty				
Through-beam		Pre-wired (5 m)	3 m	25 mm	5	100	NPN open collector	---	F3W-D052A *2
		Pre-wired connector (2 m)						Possible	F3W-D052AP *2
								---	F3W-D052B *2, 3
		Pre-wired (2 m)						Possible	F3W-D052BP *2, 3
								---	F3W-D052U
		Possible						F3W-D052UP	

*1. The UNI-WIRE SYSTEM is a wire-saving system developed jointly by NKE Corporation and Kuroda Precision Industries, Ltd.

*2. Models with PNP outputs are also available. To order PNP Models, replace A with C in the model number for a Pre-wired Model and B with D in the model number for a Pre-wired Connector Model (Example: F3W-D052C).

*3. The XS2F-D521-□G0 is the applicable connector cable. The colors of the external sheathes of the conductors, however, are different. Refer to the XS2.

Accessories (Order Separately)

Mounting Brackets


Appearance	Model	Qty	Remarks
	F39-L10	2	L-shaped Mounting Bracket (mounting screws included)
	F39-L11	2	Flat Mounting Bracket (mounting screws included)

Protective Bracket


Appearance	Model	Qty
	F39-L12	One each for Emitter and Receiver (mounting screws included)

F3W-D






Y-shaped Joint Plugs and Sockets (Cable with Connectors on Both Ends)

Appearance	Overall length	Model	Qty
	2 m	XS2R-D526-S001-2	1
	5 m	XS2R-D526-S001-5	1

Y-shaped Joint Plugs and Sockets without Cable




Appearance	Model	Qty	Remarks
	XS2R-D526-S003	1	Connecting cable: <ul style="list-style-type: none"> • Cable with connectors on both ends: XS2W Series • Cable with connector on one end: XS2F Series 4-conductor models

NKE UNI-WIRE System Peripheral Devices

Name	Appearance	Model	Remarks
C200H/CS1 UNI-WIRE Interface Unit		OMC02-HUW-Z285	Applicable PLCs: C200H/HS C200HE/HG/ HX CS1
1-point DC Input Unit		L6S-H1F20-Z285	Small I/O Distribution Units
2-point DC Input Unit		L6S-H2F20-Z285	
1-point Transistor Output Unit		L6P-H1B20-Z285	
2-point Transistor Output Unit		L6P-H2B20-Z285	
1-point DC Input/ 1-point Transistor Output Unit		L6X-H2FB20-Z285	
Detachable T-branch IDC		MAF-S407FO	---
		MAF-S407FEO	
		MAF-P405CO	

Note: Consult an NKE sales office for purchasing information.

UNI-WIRE Direct Connection Peripheral Devices

Name	Appearance	Model	Qty	Remarks
Flat cable		SCA1-4F10	1	4 × 0.75 mm ² 100 m
Extension IDC		SCN1-TH4E	1	---
T-branch IDC		SCN1-TH4	1	

Ratings and Specifications of NKE UNI-WIRE Interface Unit

Item	Model	OMC02-HUW-Z285
Transmission method		Bi-directional: Orthogonal frequency division multiplexing
Synchronization method		Bit synchronization
Transmission protocol		UNI-WIRE protocol
Baud rate		7.35 kbps (Z12)
Transmission distance		100 m (trunk line) + 20 m (branch line)
Transmission delay		128 points: 66 ms max., 256 points: 120 ms max.
Connection method		Multi-drop
Number of I/O points		128 points or 256 points
Number of connected units		Picking Sensors: 64
Connecting cable		D and G trunk lines: 2 mm ² min. Branch lines: 0.75-mm ² flat cable

Note: Contacts for inquiries regarding the UNI-WIRE Interface Unit
 NKE Corporation
 Sales office
 Tokyo Sales Office, 2-12-2 Taito, Taito-ku, Tokyo 110-0016 (Fuji DIC Building)
 TEL(03)3833-5330 FAX(03)3833-5350

Osaka Sales Office, 1-2-13 (Shinmachi Building) Shinmachi, Nishi-ku, Osaka 550-0013
 TEL(06)6538-7136 FAX(06)6538-7138

Nagoya Sales Office, 2-13-22 Iseyama, Naka-ku, Nagoya 460-0026 (ITOH Building)
 TEL(052)322-3481 FAX(052)322-3483

Kyoto Sales Office, 336-1 Hazukashi Hishikawacho, Fushimi-ku, Kyoto 612-8487
 TEL(075)924-3293 FAX(075)924-3290
 Toll-free TEL number: 0120-77-2018 (Only in Japan)

Ratings and Specifications

Sensing method		Through-beam		
Item	Model	F3W-D052A (P) *1	F3W-D052B (P) *1	F3W-D052U (P) *1
Sensing distance		3 m, switchable between LONG mode (1 to 3 m) and SHORT mode: (0.05 to 1 m), factory-set to SHORT mode.		
Beam gap		25 mm		
Number of beams		5		
Sensing width		100 mm		
Standard sensing object		Opaque, 35 mm dia. min.		
Light source (emission wavelength)		Infrared LED (860 nm)		
Power supply voltage		12 to 24 VDC±10% (ripple (p-p): 10% max.)		24 VDC ±10%, ripple (p-p) 10% max. (supplied by UNI-WIRE SYSTEM, other power supply also possible)
Power consumption		Emitter: 0.6 W max., Receiver: 0.7 W max.		Emitter/Receiver: 0.6 W max.
Control output		NPN open collector with 100 mA max. at 30 VDC NPN open collector output type Dark-ON or Light-ON (selectable)		Transmission output (output address set using DIP switch 3 control output address setting switch)
Picking instruction indicator input		Open collector with relay or transistor input Indicator ON: Input voltage of 0 to 2 V Indicator OFF: Open (with leakage current of 0.1 mA max.)		Transmission input (input address set using DIP switch 2 instruction input address setting switch)
Protection circuits		Reverse-connection protection, output short protection, and mutual interference prevention function (set with frequency switch)		
Response time		Operate/Reset: 10 ms max.		Operate/release: 39 ms (64-bit), 66 ms (128-bit), or 120 ms (256-bit) max.*2
Indicators	Receiver	Operation indicator (orange), stability indicator (green), and 6 picking indicators (orange), UNI-WIRE Direct Connection Models: Transmission indicator (orange) *3		
	Emitter	Power indicator (green), different frequency indicator (green), and 6 picking indicators (orange), UNI-WIRE Direct Connection Models: Transmission indicator (orange) *3		
Ambient temperature		Operating: -10° to 55°C, Storage: -25° to 70°C (with no icing or condensation)		
Ambient humidity		35% to 85% (with no condensation)		
Insulation resistance		20 MΩ min. (at 500 VDC)		
Dielectric strength		1,000 VAC 50/60 Hz for 1 min		
Vibration resistance (destruction)		10 to 50 Hz, 1.5-mm double-amplitude for 2 hours each in X, Y and Z directions		
Shock resistance (destruction)		500 m/s ² , 3 times each in X, Y and Z directions		
Degree of protection		IEC60529: IP62 (with the operation cover closed)		
Connection method		Pre-wired Standard cable length: 5 m *4	Pre-wired connector (M12 5-pin connector) Standard cable length: 2 m *4	Pre-wired Standard cable length: 2 m
Weight (packed state)		Approx. 360 g	Approx. 230 g	Approx. 220 g
Materials	Case, indicator windows	ABS resin		
	Lens	Acrylic resin		
	Operation cover	Nylon (PA6)		
Accessories	Instruction manual			

*1. The F3W-D052□P Emitters are provided with the external picking indicator output line shown in the following table.

Item	F3W-D052AP, F3W-D052BP, F3W-D052UP
Connection method	Pre-wired (standard cable length: 300 mm)
Electrical specifications	Output current: 50 mA max. Output voltage: Fixed at Sensor power supply voltage

*2. Response time includes transfer delay time.

*3. The transmission indicator indicates bus transmission status.

*4. The following cable lengths are also available.


F3W-D052A (P): 2 m, 7 m
F3W-D052B (P): 1 m, 3.5 m

F3W-D


Engineering Data (Typical)

Parallel Operating Range


LONG Mode

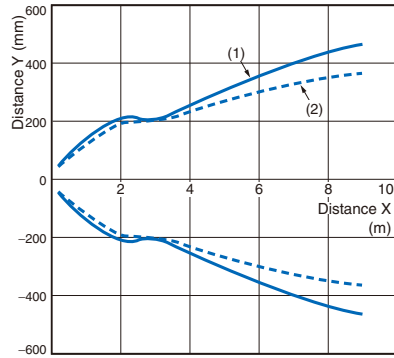

SHORT Mode

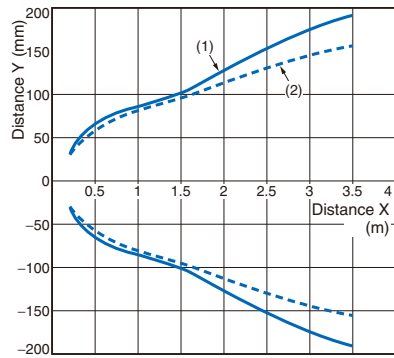


(1) Horizontal Movement Characteristics (2) Vertical Movement Characteristics




Angle Characteristics


LONG Mode: Tilt

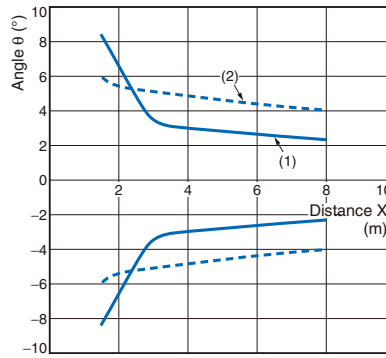


LONG Mode: Rotation

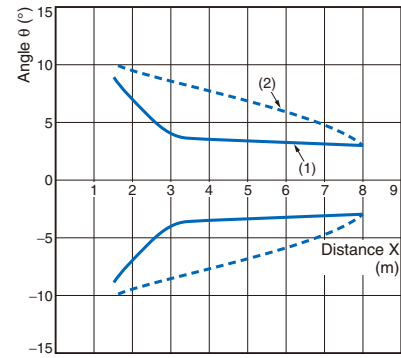


SHORT Mode: Tilt

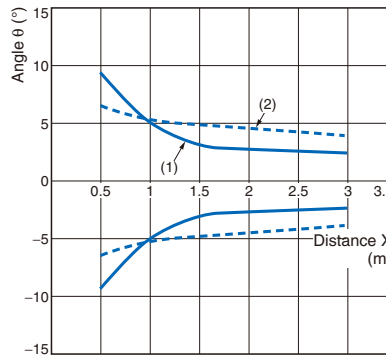

SHORT Mode: Rotation

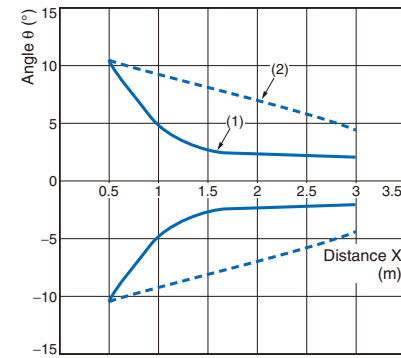

(1) Emitter Angle Characteristics (2) Receiver Angle Characteristics

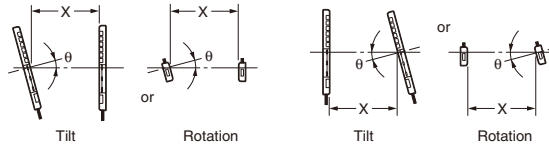

I/O Circuits

NPN Open-collector Outputs

Model	Operation mode	Timing chart	Mode selector switch	Output circuit
F3W-D052A F3W-D052AP F3W-D052B F3W-D052BP	Dark-ON mode ON: One beam or more is interrupted OFF: No beam is interrupted		D-ON (DARK ON)	<p>Note: The circled numbers represent the pin numbers for Pre-wired Connector Models. *1. The sections surrounded by single-dashed lines are applicable to the F3W-D052AP-L/BP-L only. *2. The circled numbers represent external picking indicator output pin numbers.</p> <p>The following diagram shows the relationship between the picking instruction input, picking indicator status, and external picking indicator output. DIP switch 1 is used to switch the picking display mode between all lighting, all flashing, elevator-like lighting, and accordion-like lighting. It is also possible to switch the external picking indicator display mode between lighting and flashing.</p>
	Light-ON mode ON: No beam is interrupted OFF: One beam or more is interrupted		L-ON (LIGHT ON)	<p>The following diagram shows the relationship between the picking instruction input, picking indicator status, and external picking indicator output. DIP switch 1 is used to switch the picking display mode between all lighting, all flashing, elevator-like lighting, and accordion-like lighting. It is also possible to switch the external picking indicator display mode between lighting and flashing.</p>

UNI-WIRE Transmission Outputs

Model	Operation Mode	Timing chart	Mode selector switch	Output circuit
F3W-D052U F3W-D052UP	Dark-ON mode ON: One beam or more is interrupted OFF: No beam is interrupted		D-ON (DARK ON)	<p>*1. The sections surrounded by single-dashed lines are applicable to the F3W-D052UP-L only. *2. The circled numbers represent external picking indicator output pin numbers.</p> <p>The following diagram shows the relationship between the picking instruction input, picking indicator status, and external picking indicator output. DIP switch 1 is used to switch the picking display mode between all lighting, all flashing, elevator-like lighting, and accordion-like lighting. It is also possible to switch the external picking indicator display mode between lighting and flashing. The instruction input address is set with DIP switch 2.</p>
	Light-ON mode ON: No beam is interrupted OFF: One beam or more is interrupted		L-ON (LIGHT ON)	<p>The following diagram shows the relationship between the picking instruction input, picking indicator status, and external picking indicator output. DIP switch 1 is used to switch the picking display mode between all lighting, all flashing, elevator-like lighting, and accordion-like lighting. It is also possible to switch the external picking indicator display mode between lighting and flashing. The instruction input address is set with DIP switch 2.</p>

F3W-D

Setting Method


NPN Open-collector Output Models DIP Switch 1 Mode Switching

Emitters

DIP switch 1	Function	OFF(left) (<input type="checkbox"/>)	ON(right) (<input type="checkbox"/>)
1	Flash Pattern (picking display mode setting)	See table below. *1	
2	Flash Time *2 (picking indicator flashing speed setting)	Slow	Fast
3	External Flash Pattern (external picking display mode setting) *3	Lit	Flashing
4	Not used.	---	---
5	Frequency Setting *4	A (frequency A)	B (frequency B)

*1. DIP Switch 1 Picking Display Mode Setting

DIP switch 1	SW 1-1	SW 1-2	Display mode
	OFF	OFF	All lighting (All six indicators light.)
	ON	OFF	All flashing (All six indicators flash simultaneously.)
	OFF	ON	Elevator-like lighting (Two adjacent indicators simultaneously light so that lighting moves up and down.)
	ON	ON	Accordion-like lighting (Some or all indicators simultaneously light so that lighting moves like an accordion.)

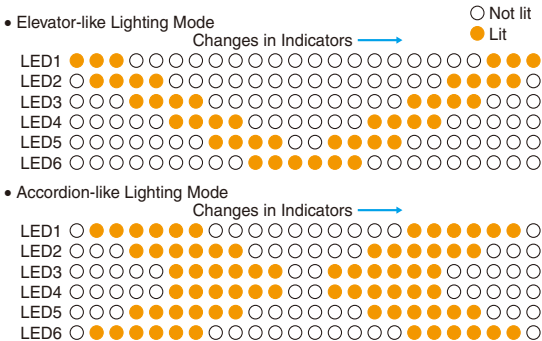

- *2. The flashing speed can be changed in picking display mode (all flashing, elevator-like lighting, or accordion-like lighting) or in external picking display mode. The flashing speed varies with each display mode.
- *3. This setting is supported for F3W-D052□P-L Emitters only.
- *4. Mutual Interference Prevention Function:
The frequency selector is used to switch the emitting frequency between A and B. Making the emitting frequencies of two Sensors different helps prevent malfunction caused by mutual interference.

Receivers

DIP switch 1	Function	OFF(left) (<input type="checkbox"/>)	ON(right) (<input type="checkbox"/>)
1	Flash Pattern (picking display mode setting)	See table below. *1	
2	Flash Time *2 (picking indicator flashing speed setting)	Slow	Fast
3	Operation mode setting	Dark-ON	Light-ON
4	Sensing distance (sensitivity) setting	LONG mode (1 to 3 m)	SHORT mode (0.05 to 1 m)
5	Frequency Setting (F3W-D052U□ only) *4	A (frequency A)	B (frequency B)

Models with Direct UNI-WIRE Connection Setting Addresses

- Set the picking instruction input address using DIP switch 2 on the Emitter and Receiver.
- Set the control output addresses using DIP switch 3 on the Receiver.

- The total number of switch addresses set to ON determines the set address (e.g., address 22 in the diagram at right).
- Make sure that the addresses of the picking instruction inputs of the Emitter and the Receiver that are used as a set are the same.

DIP switches 2 and 3	Number of addresses
1 <input type="checkbox"/> <input type="checkbox"/>	1
2 <input type="checkbox"/> <input type="checkbox"/>	2
3 <input type="checkbox"/> <input type="checkbox"/>	4
4 <input type="checkbox"/> <input type="checkbox"/>	8
5 <input type="checkbox"/> <input type="checkbox"/>	16
6 <input type="checkbox"/> <input type="checkbox"/>	32
7 <input type="checkbox"/> <input type="checkbox"/>	64
8 <input type="checkbox"/> <input type="checkbox"/>	128

Transmission Status

The transmission indicator indicates the status of bus transmission as follows:

- Flashing: Normal operation
 - ON or OFF: Transmission error
- Only one picking indicator flashing also indicates a transmission error.

Weight

The weight of the F3W-D052U in the UNI-WIRE SYSTEM is the weight of one terminal consisting of the Emitter and Receiver pair.

IDs

IDs are set separately for the Emitter and the Receiver.

Emitter: The picking instruction input address setting is the ID address.

Receiver: The control output address setting is the ID address.

Note: The ID is an identification number for broken wire position detection.

Power Supply

If a power voltage drop occurs in a remote section, consider using a local (separate) power supply.

Nomenclature


NPN Open Collector Output Models

Emitter

F3W-D052A(P)-L
F3W-D052B(P)-L

Receiver

F3W-D052A(P)-D
F3W-D052B(P)-D

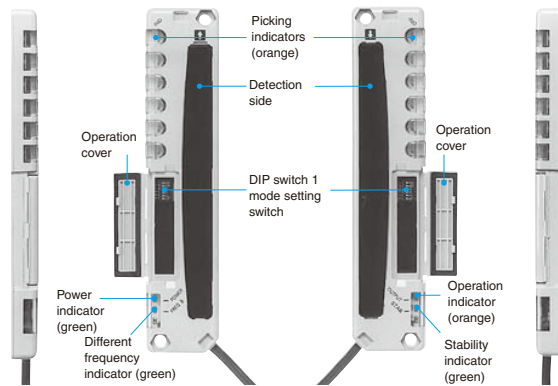


UNI-WIRE Direct Connection Models

Emitter

F3W-D052U(P)-L

Receiver

F3W-D052U(P)-D

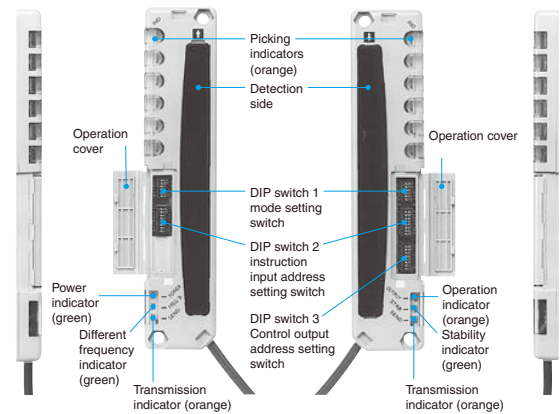

Safety Precautions

Refer to *Warranty and Limitations of Liability*.

⚠ WARNING

Do not apply the F3W-D as safety mechanisms used in pressing machines or any other safety mechanisms for protecting the human body from danger.



- (1) Do not apply the F3W-D as safety mechanisms used in pressing machines, shears, rolling machines, spinning machines, cotton mill machines, or robots for the protection of an operator's hands and body.
- (2) The F3W-D is designed for detection of the human body or moving objects in the detection area but not for protection against danger.
- (3) The F3W-D or any product incorporating the F3W-D may be exported to any country. Should the F3W-D cause any problem conflicting with local laws or related to product liability locally, however, OMRON shall, without exception, assume no responsibility for it.

⚠ CAUTION

Before using more than one F3W-D Sensor in parallel or series, take necessary countermeasures against mutual interference so that the Sensors will not malfunction. Refer to *Mutual Interference Prevention Function* on the right.

Precautions for Safe Use

● Operating Environment

- Do not use the Sensor in an environment containing flammable or volatile gases.
- Do not use the Sensor underwater.
- Do not disassemble, repair, or modify the Sensor.
- Always turn OFF the system power before installing or replacing the Sensor.

Precautions for Correct Use

Do not use the product in atmospheres or environments that exceed product ratings.

● System Design

Mutual Interference Prevention Function

(1) Two Sets of Sensors:

Set these Sensors to different frequencies with the frequency selector. Refer to *DIP Switch 1 Mode Switching* on page 7. If the mutual interference prevention function is not used, and there are two Sensors with the same frequency setting, a beam from the Emitter of one Sensor may hit the Receiver of the other Sensor, resulting in malfunction.

This function cannot prevent mutual interference between the F3W-D Sensor and a Photoelectric Sensor of a different model.

(2) Three or More Sets of Sensors:


When 3 or more sets of Sensors are used in parallel, mutual interference may result in malfunction. Take the following measures to prevent mutual interference, and check for mutual interference.

While in LONG mode, the Sensors are more easily affected by interference. Therefore, if the distance between the Emitter and Receiver of a Sensor is 1 m or less, use the SHORT mode.


F3W-D

- The distance between two adjacent sets of Sensors must be at least l_1 or l_2 , which does not cause mutual interference between two Sensors with the same frequency setting. l_1 or l_2 is at least 1.5 times the distance shown in Parallel Operating Range of the Engineering Data.

Vertical Installation

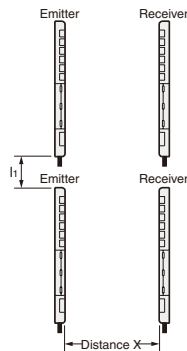

Horizontal Installation



- Install a baffle so that there will not be mutual interference between Sensors with the same frequency setting. (See Figure 1.) A light reflection from the wall or floor may go around a baffle and reach the Receivers. Install a baffle so that it will also block any light reflection. (See Figure 2.)

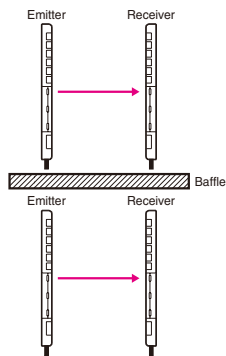


Figure 1

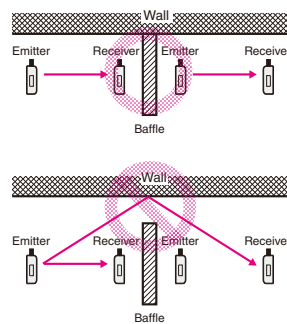


Figure 2

Wiring Precautions

Connection

- Before turning ON the power, make sure that the supply voltage is within the maximum allowable voltage range.
- Always connect the sync lines.
- Be very careful not to get metal chips in the connector, especially during wiring.
- Incorrect wiring may damage the equipment. Make sure that the cable length and routing are appropriate to prevent the connectors and cables from getting disconnected.
- Always leave the operation cover closed during operation.
- Applying excessive force to the mode switch may result in damage. Do not apply a force of more than 5 N.

Cables


Make sure that the bending radius is 25 mm or more.

Installation Precautions

Installation

- Install the Sensor so that its sensing face will not receive light from the sun, fluorescent lamps, incandescent lamps, and other light sources.
- Do not strike the Sensor with a hammer or any other tool during installation, otherwise the internal circuits of the Sensor may be damaged.

- Install the Emitter and Receiver in the same orientation as shown in the following figure. (The cables must be in the same direction.)

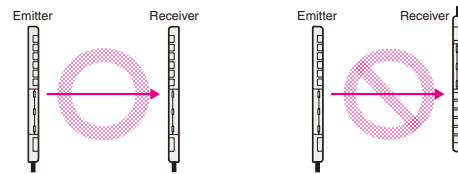


- Use M4 screws to secure the Sensor body.
- Secure the case to a tightening torque of 1.2 N·m or less.


Reflection from Wall or Floor

If the Emitter and Receiver are installed as shown in the following illustration, all the axes may not be interrupted due to light reflection from the floor or wall. Make sure that the Emitter and Receiver detect the sensing object properly before using the F3W-D in actual operation.

Side View




Top View

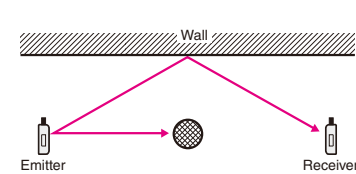

Adjustment

Operation and Stability Status Display

- The following illustration shows the indicator status corresponding to each incident level.
- Install the Receiver so that the green stability indicators are both ON in light receiving status.

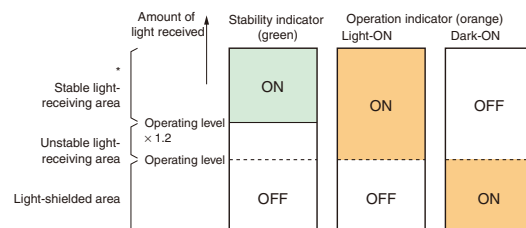


* If the Receiver is set to the stable light-receiving area, it will become more resistant to environmental fluctuations such as temperature, voltage, dust, and setting deviation after installation. For applications where a stable light-receiving area is not obtained, attention must be paid to environmental fluctuations.

Error Display

F3W-D052 Picking Sensors are provided with only one error display mode.

If an error occurs, the indicator on the Sensor's Receiver, as indicated by the arrow in the diagram on the right, will flash. The error indicated in this example is a synchronization error.



The possible causes are as follows:

1. The sync line is not connected.
2. The sync line is shorted with another line.
3. UNI-WIRE communications are not being performed (when an F3W-D052U UNI-WIRE Direct Connection Model is being used).

Dimensions

(Unit: mm)

Sensors


F3W-D

Emitter

F3W-D052A(P)-L
F3W-D052B(P)-L
F3W-D052U(P)-L



F3W-D052B(P)-L:





Two, M4 nut holes (Depth: 1 mm)


F3W-D052A(P)-L:
Vinyl-insulated round cable with four conductors, 4 dia.
Conductor: 0.2 mm²
Insulation: 1.1 mm dia.
Standard length: 5 m

F3W-D052U(P)-L:
Vinyl-insulated round cable with four conductors, 4 dia.
Conductor: 0.3 mm²
Insulation: 1.2 mm dia.
Standard length: 2 m

F3W-D052(P)-L

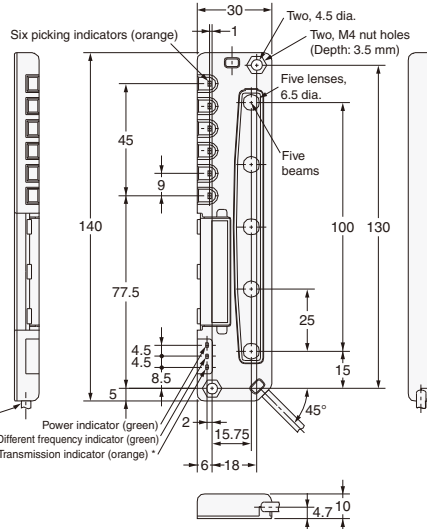

Mounting Hole Dimensions

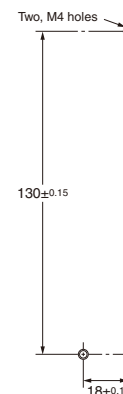


* F3W-D052U(P)-L only.

Receiver

F3W-D052A(P)-D
F3W-D052B(P)-D
F3W-D052U(P)-D


F3W-D052B(P)-D:




Two, M4 nut holes (Depth: 1 mm)

F3W-D052A(P)-D:
Vinyl-insulated round cable with five conductors, 4 dia.
Conductor: 0.2 mm²
Insulation: 1.1 mm dia.
Standard length: 5 m

F3W-D052U(P)-D:
Vinyl-insulated round cable with four conductors, 4 dia.
Conductor: 0.3 mm²
Insulation: 1.2 mm dia.
Standard length: 2 m

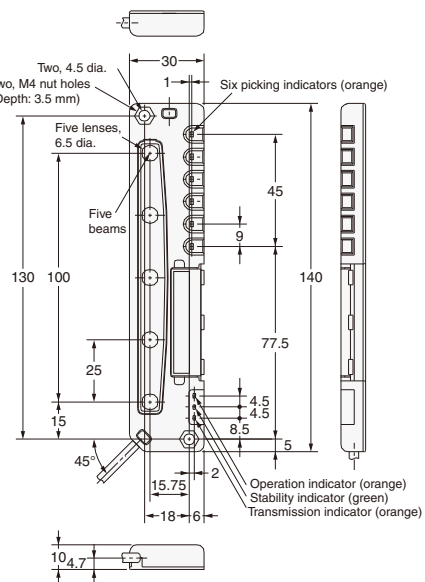

Mounting Hole Dimensions

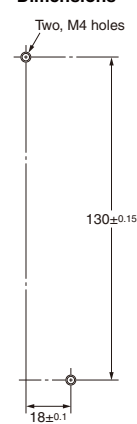

* F3W-D052U(P)-D only

F3W-D


Accessories (Sold Separately)

Mounting Brackets


F39-L10(L-shaped)



Material: Iron
(Thickness: 2 mm)
Mounting screws provided.

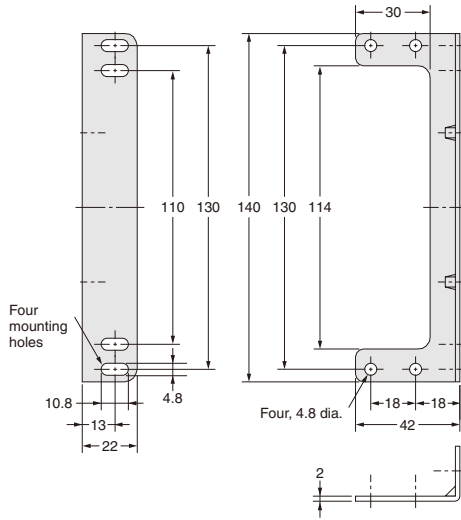

F3W-D052A-D with Mounting Bracket

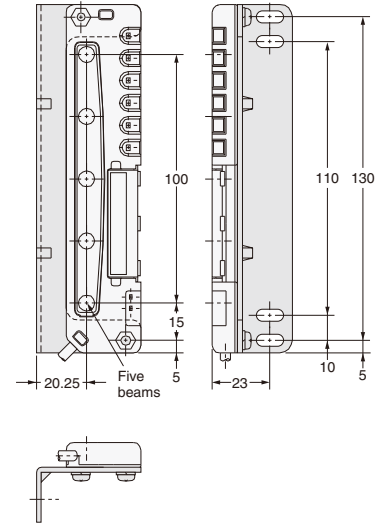


Mounting Brackets


F39-L11 (Flat)



Material: Iron
(Thickness: 2 mm)
Mounting screws provided.

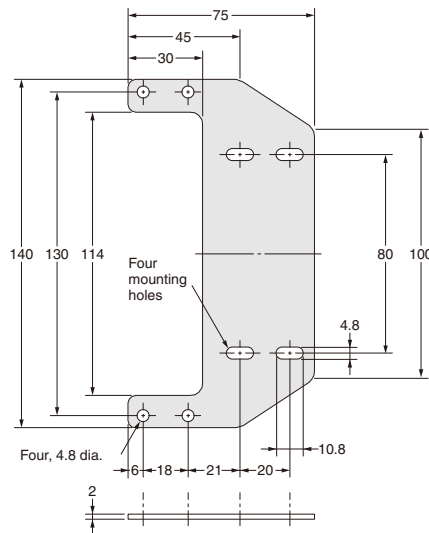

F3W-D052A-D with Mounting Bracket

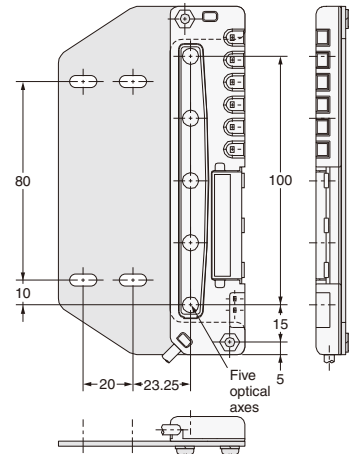


Protective Bracket

F39-L12(Receiver)




Material: Iron
(Thickness: 1.6 mm)
Mounting screws provided.

Note: The Emitter and Receiver are axially symmetrical.

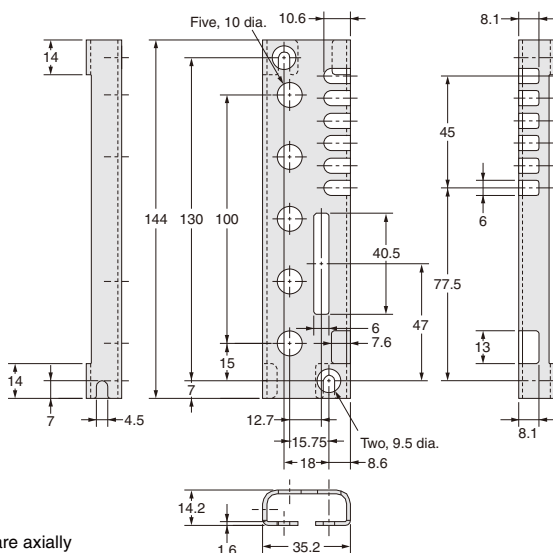


F3W-D052A-D with Protective Bracket

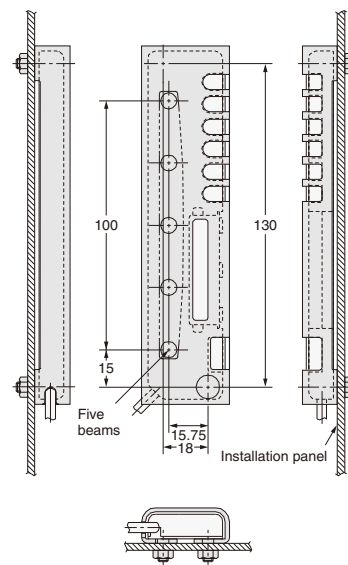


Y-shaped Joint Plugs and Sockets (Cable with Connectors on Both Ends)

XS2R-D526-S001-2 (L=2,000 mm)

XS2R-D526-S001-5 (L=5,000 mm)

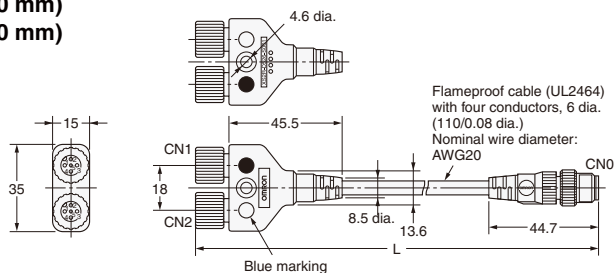


Wiring Diagram




Y-shaped Joint Plugs and Sockets without Cable

XS2R-D526-S003

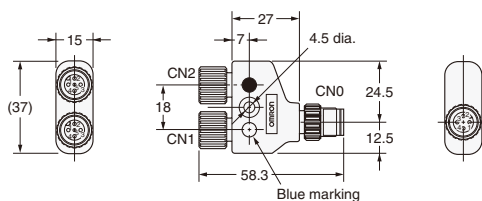

Wiring Diagram



Read and Understand This Catalog

Please read and understand this catalog before purchasing the products. Please consult your OMRON representative if you have any questions or comments.

Warranty and Limitations of Liability

WARRANTY

OMRON's exclusive warranty is that the products are free from defects in materials and workmanship for a period of one year (or other period if specified) from date of sale by OMRON.

OMRON MAKES NO WARRANTY OR REPRESENTATION, EXPRESS OR IMPLIED, REGARDING NON-INFRINGEMENT, MERCHANTABILITY, OR FITNESS FOR PARTICULAR PURPOSE OF THE PRODUCTS. ANY BUYER OR USER ACKNOWLEDGES THAT THE BUYER OR USER ALONE HAS DETERMINED THAT THE PRODUCTS WILL SUITABLY MEET THE REQUIREMENTS OF THEIR INTENDED USE. OMRON DISCLAIMS ALL OTHER WARRANTIES, EXPRESS OR IMPLIED.

LIMITATIONS OF LIABILITY

OMRON SHALL NOT BE RESPONSIBLE FOR SPECIAL, INDIRECT, OR CONSEQUENTIAL DAMAGES, LOSS OF PROFITS, OR COMMERCIAL LOSS IN ANY WAY CONNECTED WITH THE PRODUCTS, WHETHER SUCH CLAIM IS BASED ON CONTRACT, WARRANTY, NEGLIGENCE, OR STRICT LIABILITY.

In no event shall responsibility of OMRON for any act exceed the individual price of the product on which liability is asserted.

IN NO EVENT SHALL OMRON BE RESPONSIBLE FOR WARRANTY, REPAIR, OR OTHER CLAIMS REGARDING THE PRODUCTS UNLESS OMRON'S ANALYSIS CONFIRMS THAT THE PRODUCTS WERE PROPERLY HANDLED, STORED, INSTALLED, AND MAINTAINED AND NOT SUBJECT TO CONTAMINATION, ABUSE, MISUSE, OR INAPPROPRIATE MODIFICATION OR REPAIR.

Application Considerations

SUITABILITY FOR USE

OMRON shall not be responsible for conformity with any standards, codes, or regulations that apply to the combination of products in the customer's application or use of the product.

At the customer's request, OMRON will provide applicable third party certification documents identifying ratings and limitations of use that apply to the products. This information by itself is not sufficient for a complete determination of the suitability of the products in combination with the end product, machine, system, or other application or use.

The following are some examples of applications for which particular attention must be given. This is not intended to be an exhaustive list of all possible uses of the products, nor is it intended to imply that the uses listed may be suitable for the products:

- Outdoor use, uses involving potential chemical contamination or electrical interference, or conditions or uses not described in this catalog.
- Nuclear energy control systems, combustion systems, railroad systems, aviation systems, medical equipment, amusement machines, vehicles, safety equipment, and installations subject to separate industry or government regulations.
- Systems, machines, and equipment that could present a risk to life or property.

Please know and observe all prohibitions of use applicable to the products.

NEVER USE THE PRODUCTS FOR AN APPLICATION INVOLVING SERIOUS RISK TO LIFE OR PROPERTY WITHOUT ENSURING THAT THE SYSTEM AS A WHOLE HAS BEEN DESIGNED TO ADDRESS THE RISKS, AND THAT THE OMRON PRODUCT IS PROPERLY RATED AND INSTALLED FOR THE INTENDED USE WITHIN THE OVERALL EQUIPMENT OR SYSTEM.

Disclaimers

CHANGE IN SPECIFICATIONS

Product specifications and accessories may be changed at any time based on improvements and other reasons.

It is our practice to change model numbers when published ratings or features are changed, or when significant construction changes are made. However, some specifications of the product may be changed without any notice. When in doubt, special model numbers may be assigned to fix or establish key specifications for your application on your request. Please consult with your OMRON representative at any time to confirm actual specifications of purchased product.

DIMENSIONS AND WEIGHTS

Dimensions and weights are nominal and are not to be used for manufacturing purposes, even when tolerances are shown.

ERRORS AND OMISSIONS

The information in this catalog has been carefully checked and is believed to be accurate; however, no responsibility is assumed for clerical, typographical, or proofreading errors, or omissions.

PERFORMANCE DATA

Performance data given in this catalog is provided as a guide for the user in determining suitability and does not constitute a warranty. It may represent the result of OMRON's test conditions, and the users must correlate it to actual application requirements. Actual performance is subject to the OMRON Warranty and Limitations of Liability.

PROGRAMMABLE PRODUCTS

OMRON shall not be responsible for the user's programming of a programmable product, or any consequence thereof.

COPYRIGHT AND COPY PERMISSION

This catalog shall not be copied for sales or promotions without permission.

This catalog is protected by copyright and is intended solely for use in conjunction with the product. Please notify us before copying or reproducing this catalog in any manner, for any other purpose. If copying or transmitting this catalog to another, please copy or transmit it in its entirety.